

ACWA Power Zarqa CCGT Project

Zarqa, Jordan

Updated Environmental and Social Impact Assessment

Volume 4 – Appendices



Prepared for:
ACWA Power

July 2016

Document Information

Project	ACWA Power Zarqa CCGT Project
Project Number	1305/001/010
Report Title	Updated Environmental and Social Impact Assessment – Volume 4
Client	ACWA Power
Project Manager	Max Burrow
Project Director	Ken Wade

Document Control

Issue	Issue Date	Description	Author	Reviewed	Approved
1	20/04/2016	ESIA Volume 4	MKB	KRW	KRW
2	14/06/2016	ESIA Volume 4	MKB	KRW	KRW
3	02/07/2016	Updated ESIA Volume 4	MKB	KRW	KRW

Appendices

Contents

Appendix A	Project Registration Letter and Response from MoE (Screening)
Appendix B	Environmental Scoping Study – MoE Approval Letter
Appendix C	Water Balance Diagrams
Appendix D	Construction Programme
Appendix E	Project Plan (and plans for construction laydown areas)
Appendix F	Scoping Consultation Report
Appendix G	Diffusion Tube Laboratory Results (2016)
Appendix H	Continuous Air Quality Monitoring Results (2016)
Appendix I	Predictive Emissions Dispersion Modelling Report
Appendix J	Noise Modelling Report
Appendix K	Soil Quality Laboratory Results (2016)
Appendix L	Groundwater Quality Laboratory Results (2016)
Appendix M	Hydrogeology Study
Appendix N	EIA Approval from Ministry of Environment in Jordan
Appendix O	Project Land Use Breakdown
Appendix P	Project Well Licenses
Appendix Q	Projects Cut/Fill Balance Document
Appendix R	EPC Camp Land Lease Agreement
Appendix S	Projects Permits Required
Appendix T	SEPCO III Security Risk Assessment and Security Plan
Appendix U	SEPCO III Potential Noise Barrier Design
Appendix V	BAT Analysis

Appendix A

Project Registration Letter and Response from MoE (Screening)

شركة محطة الزرقاء لتوليد الطاقة الكهربائية م.خ.م.

Date : 05.01.2016

Reference : Z/MoE/001

Ministry of Environment,
EIA Directorate,
Building No: 83
King Faisal bin Abdul Aziz Street
Postal Code: 11941
PO Box: 1408
Amman, Jordan

Tel: +962 556 1136

F.A.O. Mr Izzat Ahmad Salman Abu Humra, (Director, Licensing and Guidance, EIA Directorate)

SUBJECT: HUSSEIN THERMAL POWER STATION: EXPANSION PROJECT

His Excellency Minister of Environment

ACWA Power is proposing to expand the existing Hussein Thermal Power Station located in the industrial sector of Zarqa, Zarqa Governorate, Jordan, through their 100% owned "Al Zarqa Electric Power Generation PSC".

The project will be located within the current Hussein Thermal Power Station (TPS) site boundary, on land belonging to the plant. The existing plant was built in 4 stages between 1973 & 1984 and currently has a net capacity of 321 MW, operating on Heavy Fuel Oil (HFO).

The proposed combined cycle gas turbine expansion will increase operational capacity to approximately 485 MW at a higher generating efficiency. The operational fuel will be natural gas.

This letter has been prepared to notify the Ministry of Environment's EIA Directorate of the proposed expansion project and to request that the project is registered in the applicable Ministry systems.

Al Zarka would like to outline its commitment to fully undertake an EIA in line with the Jordanian EIA requirements, in order to obtain the necessary project environmental clearances.

For and on behalf of
Zarka Power Generation Co.

Yours sincerely,



Mr. Sanjiv Iyer

Authorized Signatory



الرقم ٤٦٤/١/١٩
التاريخ
الموافق ٢٠١٦/١/١٩

السادة شركة محطّة الزرقاء لتوليد الطاقة الكهربائية م.خ.م.

الموضوع: توسعة محطة الحسين الحرارية

تحية طيبة وبعد،،،

إشارة لكتابكم رقم Z/MoE/001 تاريخ 2016/1/5 بخصوص المتطلبات البيئية لمشروع توسعة محطة طاقة الحسين الحرارية الحالية في محافظة الزرقاء.

أرجو التكرم بالعلم بأن المشروع أعلاه يتطلب إجراء دراسة تقييم أثر بيئي شامل قبل البدء بأي نشاط يتعلق بالمشروع وذلك استناداً لنظام تقييم الأثر البيئي رقم 37 لسنة 2005، علماً بأن قائمة الجهات الاستشارية المعتمدة لإجراء دراسات تقييم الأثر البيئي مبيّنة على موقع الوزارة الإلكتروني: (www.moenv.gov.jo)

وتفضلوا بقبول فائق الاحترام،،،

الدكتور طاهر راضي الشخشير

وزير البيئة

المهندس أحمد القطارنه
الأمين العام

ENGLISH TRANSLATION

Date: 19/1/2016

Attn: Al Zarqa power station Company

Subject: Hussein Thermal power station expansion

Greetings,,,

Reference to your letter number Z/MoE/001 dated 5/1/2016 regarding the environmental requirements of the expansion project of Hussein existing thermal station in Al ZARQA .

Kindly be informed that the above project requires a comprehensive environmental study before taking any action related to the project based on the system of environmental impact assessment of No. 37 for the year 2005 noting that the official qualified consultant parties list to conduct environmental impact assessment studies are indicated on the ministry's website.

Dr. Taher Radi Al Shakhsheer

Environment Ministry

الجهات الاستشارية المؤهلة لعام 2015

صندوق البريد	فاكس	هاتف	الفئة	المجال	اسم المستشار	رقم التأهيل	الرقم المتكامل
	5606606	5604200	1	البيئة	دار العمران ودار العمران للبيئة التحكيفية والبيئة (تأهيل مشترك) ^{3 2}	1	1
عمان 962070/ 11196	4655390	4641884-4613198	1	البيئة	شركة بيطار مهندسون مستشارون	9	2
صن 8049 / 11121	5660188	5668188-5659991	1	البيئة	الدار العربية للهندسة	20	3
20076/ الرمز 1118	5678320	5661031-5662612	1	البيئة	شركة سيجما مهندسون مستشارون	29	4
9532 / 11191	5824532	5857167	1	البيئة	شركة ارباك جرداته مهندسون ومعماريون	38	5
926963/ 11190	4602130	4602120	1	البيئة	شركة المستشار للهندسة	39	6
830746/ الرمز 11183	4612380	4612377	1	البيئة	شركة اتحاد المستشارين للهندسة والبيئة	42	7
1075/ الحبيبة 11941	5333585	5347516	1	البيئة	مكتب الشامل للهندسة	129	8
941400/ 11194	5697264	0797681010 5699769	1	البيئة	الاتجاهات الجديدة للاستشارات (ECO Consult)	147	9
11814/140011	5347332	5347332-0777425839	1	البيئة	الرواسي لاستشارات البيئة والطاقة	157	10
942365-11194	5690057	5681000	1	البيئة	شركة دار العمران للبيئة التحكيفية والبيئة - مهندسون مستشارون	162	11

الجهات الاستشارية المؤهلة لعام 2015

صندوق البريد	فاكس	هاتف	الجهة	المجال	اسم المستشار	رقم التأهيل	الرقم المتسلسل
830690-11183	5339776	5339446-0797718090	1	البيئة	المستشاره لحلول البيئة والطاقة	170	12
2084-11821	065923601	065662783-5663611	1	البيئة	شركة المستقبل للاستشارات الهندسية والبيئية	175	13
143182/11814	5371022	5371019-5371018	2	البيئة	شركة سبيل الهندسه	140	14
140011-11814	4721230	0799901061-4721230	2	البيئة	حمى لاستشارات البيئة والإدارة	174	15
	5344806	5344701	-	اعتماد الوزارة	الجمعية العلمية الملكية	-	16
	05-3532312	05-3491111	-	اعتماد الوزارة	جامعة البلقاء التطبيقية	-	17
	02-7201076	02 - 7201000	-	اعتماد الوزارة	مركز الملكة رانيا العبدالله - جامعة العلوم والتكنولوجيا الاردنية	-	18
	053826870 5344806	053903333 فرعي 4163/ فرعي 41912/	-	اعتماد الوزارة	مركز الدراسات البيئية - الجامعة الهاشمية	-	19
11942 الجامعة الاردنية	5355511 21035 5300803	21120 فرعي 5355000	-	اعتماد الوزارة	مركز المياه والطاقة والبيئة - الجامعة الاردنية	-	20

Appendix B

Environmental Scoping Study – MoE Approval Letter



الرقم ٥٥٨١ / ٧ / ٤
التاريخ
الموافق ٤ / ١٦ / ٢٠١٥

السادة مكتب الاتجاهات الجديدة للاستشارات

تحية طيبة وبعد ،،

إشارة لكتابكم رقم 16-06-ECS/ وزارة البيئة/ 2/224 تاريخ 2015/3/14 ومرفقه تقرير
الأسس المرجعية لدراسة تقييم الأثر البيئي لمشروع توسعة محطة الحسين الحرارية الحالية في محافظة
الزرقاء.

أوافق على الأسس المرجعية لدراسة المشروع أعلاه شريطة أن يتم اجراء القياسات المرجعية للضجيج
لمدة ساعة خلال فترة النهار وساعة خلال فترة الليل ولمدة ثلاثة أيام متواصلة مع الأخذ بعين الاعتبار عدم
وجود مصادر ضجيج خارجية بالقرب من مواقع المراقبة المحددة في التقرير وذلك استناداً إلى توصية اللجنة
الفنية لمراجعة دراسات تقييم الأثر البيئي للمشاريع.

وتفضلوا بقبول فائق الاحترام ،،،

الدكتور طاهر راضي الشخشير

وزير البيئة

المهندس أحمد القطار
الأمين العام

ENGLISH TRANSLATION

Ministry of the Environment

No. 4/7/208

Date:

Corresponding to:

To: New Directions Consulting Co.

After greetings,

With reference to your letter no ECS-06-16/Ministry of the Environment/224/2, on 14/3/2015, to which the terms of reference report of the environmental impact study for the exiting thermal plant extension project in Zarqa Governorate is attach,

I declare approving the terms of reference for the above project study, provided that noise reference measurements are taken for one-hour during the day and one-hour at night, for three consecutive days, while taking into consideration that no external noise sources are existing nearby the monitoring locations defined in the report. This is based upon the recommendation of the technical committee that projects' environmental impact studies must be revised.

Best regards,

Dr. Tahir Radi Shakhshir
(Signature)
Minister of the Environment

(Seal [Eng. Ahmed Qatarneh - Secretary-General])

Appendix C

Water Balance Diagrams

OWNER



OWNER'S ENGINEER



EPC CONTRACTOR



DESIGNER



PROJECT

ACWA Power Zarqa CCGT Project

A	27/04/2016	First issue	DFA	DLA	ACB
REV.	DATE	DESCRIPTION	DONE	CHECKED	APPROVED
STATUS	FOR INFORMATION	<input type="checkbox"/>	EPC CONT. SIGNATURE 		DATE
	FOR APPROVAL	<input checked="" type="checkbox"/>			
	FOR PURCHASE	<input type="checkbox"/>			
	FOR CONSTRUCTION	<input type="checkbox"/>			
	AS BUILT	<input type="checkbox"/>			
DOCUMENT OWNER					
DOCUMENT NUMBER		DOCUMENT NAME			
APZ01-00-Y__-PCR-IDM-0580		WATER BALANCE			



DOCUMENT: APZ01-00-Y__-PCR-IDM-0580

PROJECT:

ACWA Power Zarqa CCGT Project

WATER BALANCE

REV.

DATE

A

27/04/2016

INTRODUCTION

General

This document provides the water balance of the entire plant for several operating cases. The selection of operating cases is made to include relevant cases as guarantee cases or cases at extreme ambient conditions, as these cases are in general the cases demanding maximum and minimum flows.

In general, the flows shown in the water balances are average flows. Actual instantaneous flows can be higher or lower, specially for water treatment plant units that will normally operate to produce flow at nominal capacities. In cases when the average flow exceeds the nominal capacity of a unit, it means that the corresponding tank is supplying the difference. On the other side, when the average is lower than the nominal capacity of a unit, it means that the corresponding tank is storing the difference.

Tank and water treatment plant capacities

The capacity of the tanks and water treatment plant (WTP) units is based on contractual requirements and the needs identified by the water balance.

For the water treatment plant units, the capacities are defined with ample margin (over average demand flow) and taking into account the size of the tanks (as they provide some buffer to match demand and rate of production). The redundancies provided in the WTP are provided as spare units, i.e. it is not designed to operate at the same time for increased production.

Document index

This document As in the same way the water treatment plant units are provided with capacities that exceed the average demand, the connection from the wells must be

- Cover
- Introduction
- Case index and main inputs
- Tanks capacities
- Water treatment plant capacities
- Water balance for case 1
- Water balance for case 2
- Water balance for case 3
- Water balance for case 4
- Water balance for case 5
- Effluents generation
- Evaporation pond sizing



DOCUMENT: APZ01-00-Y__-PCR-IDM-0580

PROJECT:

ACWA Power Zarqa CCGT Project

WATER BALANCE

REV.

DATE

A

27/04/2016

CASE INDEX

Water balance is provided for the following cases:

Case	Fuel used	Evap. Cooler	Season	Ambient temperature, °C
1	NG	ON	Summer	36
2	NG	OFF	Summer	36
3	LDO	ON	Summer	36
4	LDO	OFF	Summer	36
5	LDO	OFF	Winter	13

Notes:

Case with natural gas at winter conditions is not given as differences in water demand are minimum.

Case with LDO at winter conditions is given as this is specially stringent due to higher water demand for NOx control.

The temperatures used for summer and winter are based on typical conditions for the site in summer and winter seasons.

MAIN INPUTS

The following considerations have been taken into account for water balances

Evaporative coolers cycles of concentration	4
Water treatment plant efficiencies	
Filtration unit	97 %, backwashing is done with RO 1st pass reject
RO 1st pass	75 %
RO 2nd pass	85 %, reject is recirculated to the inlet of RO 1st pass
Mixed beds	95 %
Waste RO	45 %
HRSG blowdown in drums	1 %
ACC cleaning frequency	3 times per year
ACC cleaning water demand	5200 m3 per year
Condensate losses	0,25 % of condensate flow
HRSG sampling streams	
Number of streams	30 samples (10 for each HRSG)
Stream flow	70 kg/h
Total flow	2100 kg/h
Streams to be recycled	
HRSG drum blowdown	Yes
Evaporative cooler blowdown	Yes
Sampling streams	Yes



DOCUMENT: APZ01-00-Y__-PCR-IDM-0580

PROJECT:

ACWA Power Zarqa CCGT Project

WATER BALANCE

REV.

DATE

A

27/04/2016

TANKS CAPACITIES

Demineralized water tanks

Requirement		14 days for support of LDO operation	
Water flow	m3/h	58,3	based on LDO operation in winter (case 5)
Volume required	m3	19589	
Tank nominal capacity adopted		2 x 10000 m3	

Service water tank

Requirement		7 days for support operation	
Water flow	m3/h	18,58	based on NG/LDO operation in summer with evap. Cooler (cases 1 and 3)
Volume required	m3	3121	
Tank nominal capacity adopted		1 x 3200 m3	

Fire fighting water tank

Requirement		2 hours at maximum demand	as per NFPA requirements
Water flow	m3/h	HOLD	
Volume required	m3	HOLD	
Tank nominal capacity adopted		HOLD	

Note: this tank is to be defined during design of the fire fighting system

Raw water tank

Requirement		7 days for storage of recycled stream	HRSG blowdown, evap. Cooler blowdown and sampling streams
Water flow	m3/h	10,25	based on NG operation in summer with evap. cooler (case 1)
Volume required	m3	1722	
Tank nominal capacity adopted		1 x 2800 m3	1000 m3 of extra capacity are provided

Note: the considered case is the normal operation with NG fuel. Evap. Cooler operation is not considered as reserve water for this purpose is already considered in the service water tank.



DOCUMENT: APZ01-00-Y__-PCR-IDM-0580

PROJECT:

ACWA Power Zarqa CCGT Project

WATER BALANCE

REV.

DATE

A

27/04/2016

WATER TREATMENT PLANT CAPACITIES

Demineralized water trains (2nd pass RO and mixed bed units)

Requirement		support of NG operation	
Water flow	m ³ /h	10,33	based on NG operation in summer (cases 1 and 2)
Overdesign	%	100	
Trains configuration adopted		2 x 21 m ³ /h	

Note: it is not expected to operate both trains at the same time as the capacity of each is enough to support operation.

Service water train (1st pass RO)

Requirement		support of NG operation (service water demand and feeding of demi water train)	
Water flow	m ³ /h	31,37	based on NG operation in summer with evap. cooler (case 1)
Overdesign	%	50	
Trains configuration adopted		2 x 47 m ³ /h	

Note: it is not expected to operate both trains at the same time as the capacity of each is enough to support operation.

Filtration unit

Requirement		to support operation of 1st pass RO	
Water flow	m ³ /h	47	based on capacity of the 1st pass RO trains
Overdesign	%	0	
Trains configuration adopted		2 x 47 m ³ /h	also N+1 is possible (i.e. 3 x 50%, or 4 x 33%, etc.)

Note: it is not expected to operate both trains at the same time as the capacity of each is enough to support operation.

Wells supply system


Requirement		to support operation of filtration unit	without considering recycle of other streams
Water flow	m ³ /h	47	based on capacity of the filtration unit
Overdesign	%	20	
Capacity required	m ³ /h	58	this is the minimum capacity as per water balance requirement

Case: 1


Fuel: Gas

Conditions: Summer


Evaporative coolers: ON

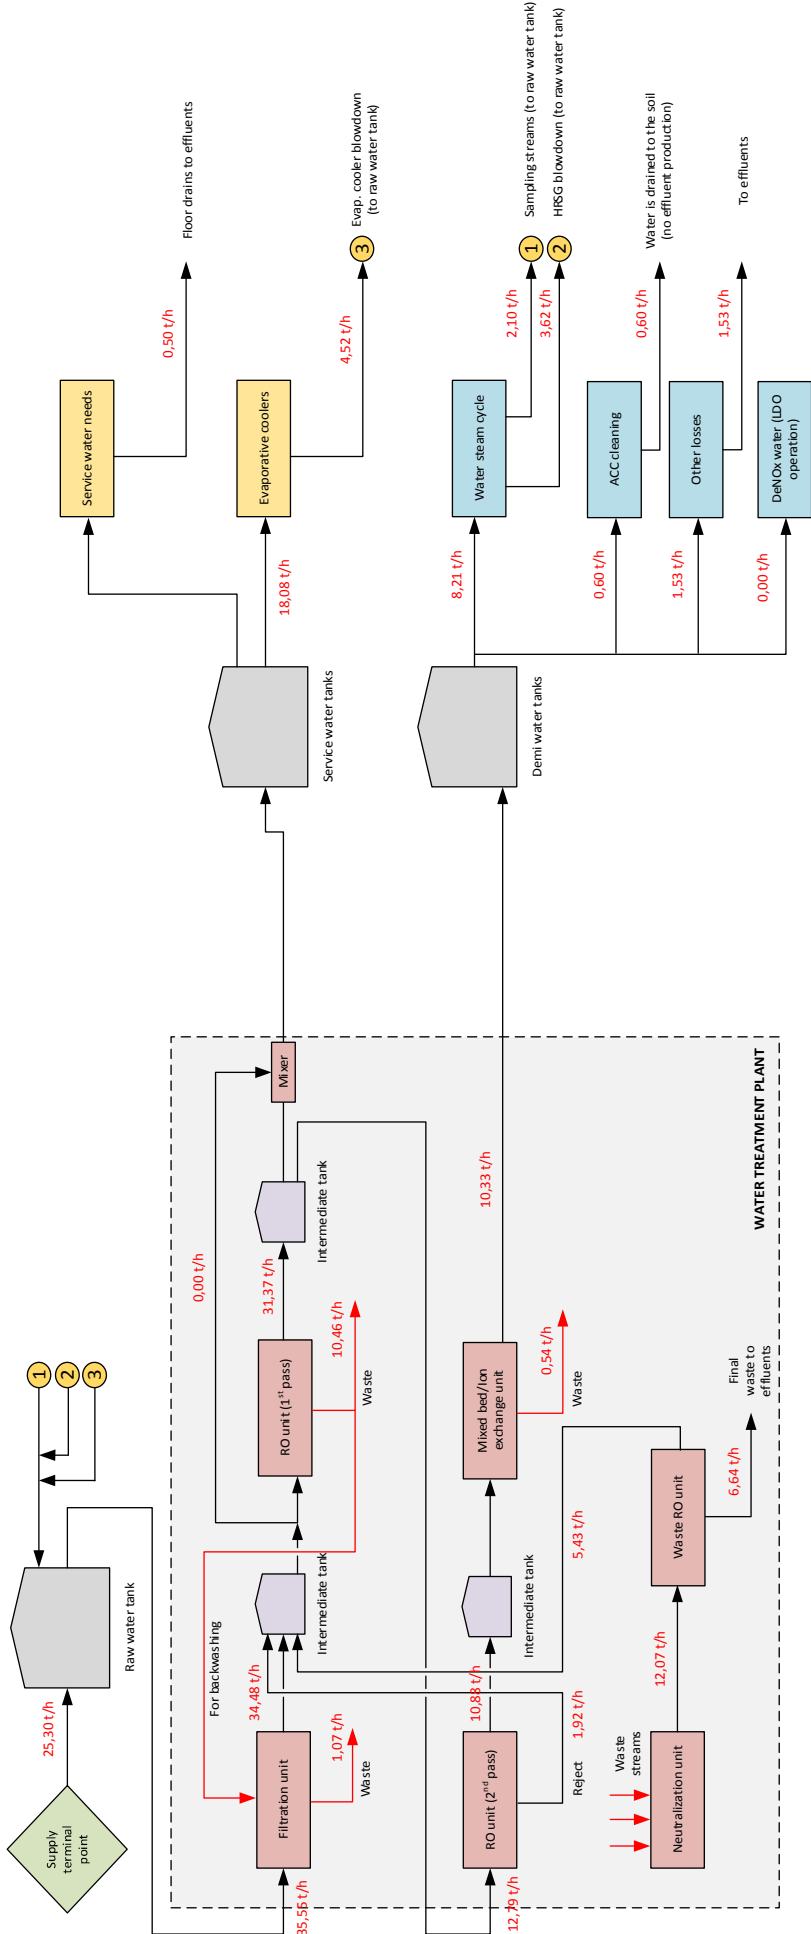

- Notes:**
1. In water steam cycle it is included the make up required due to drum blowdown and also the water for the sampling streams.
 2. Part of the drum blowdown if lost to the atmosphere due to flashing in the HRSB blowdown tank. Liquid fraction is reused as raw water.
 3. In other losses it is included the condensate losses of the plant.

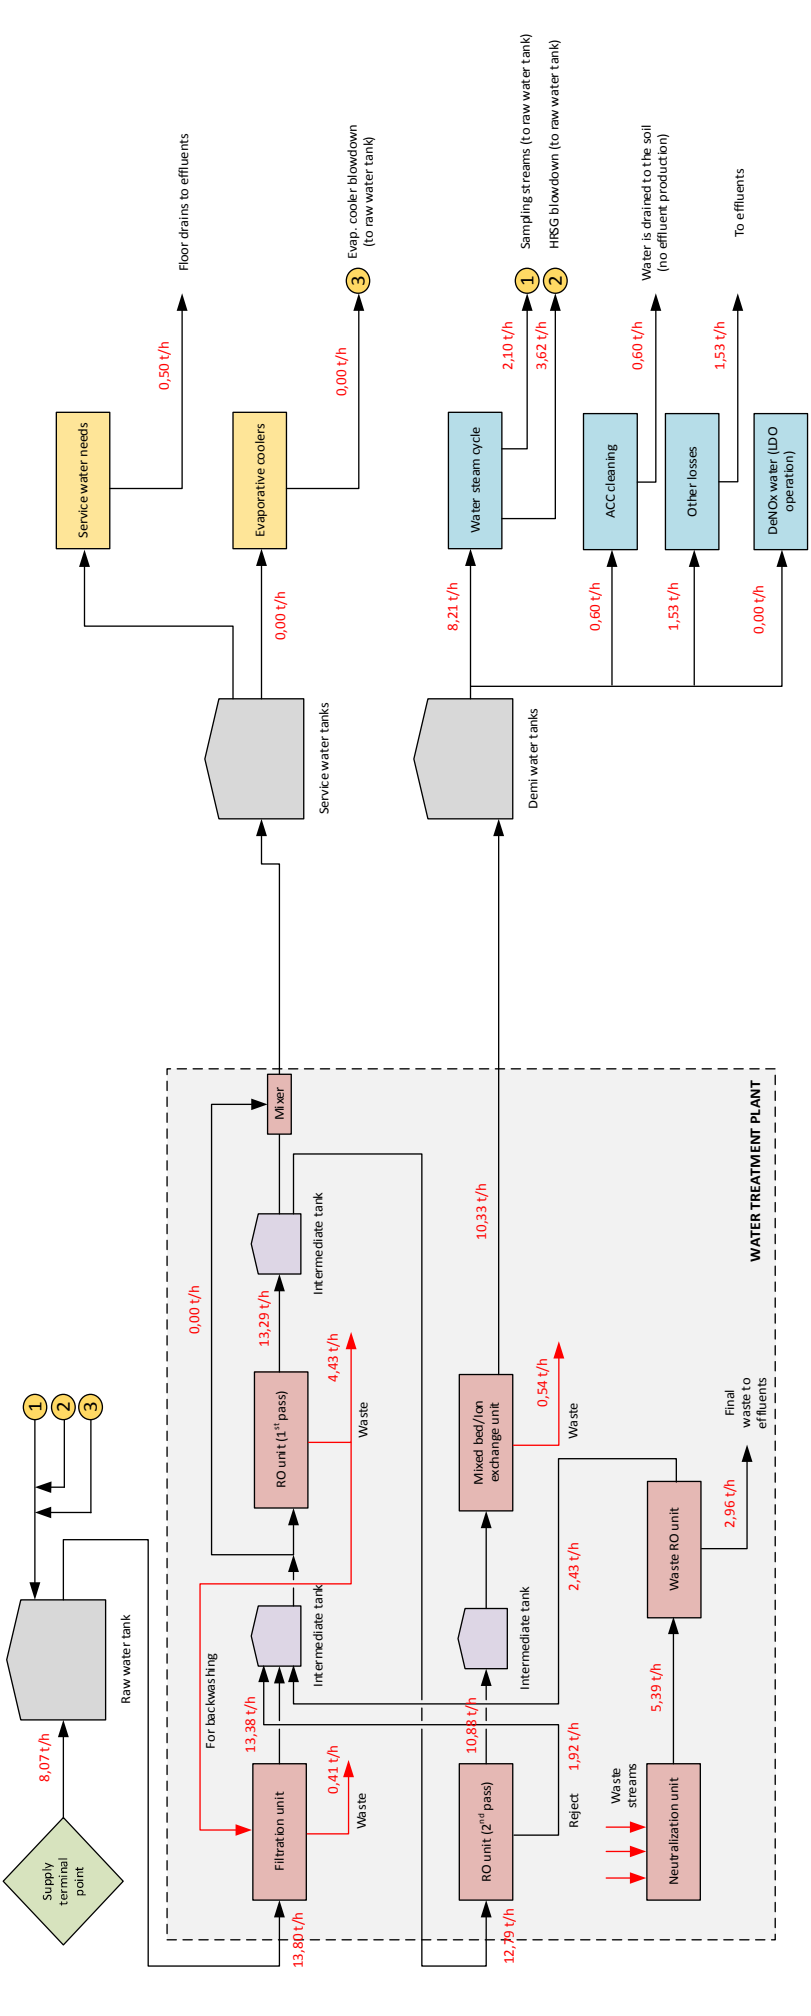


- Notes:**
1. In water steam cycle it is included the make up required due to drum blowdown and also the water for the sampling streams.
 2. Part of the drum blowdown if lost to the atmosphere due to flashing in the HRSG blowdown tank. Liquid fraction is reused as raw water.
 3. In other losses it is included the condensate losses of the plant.

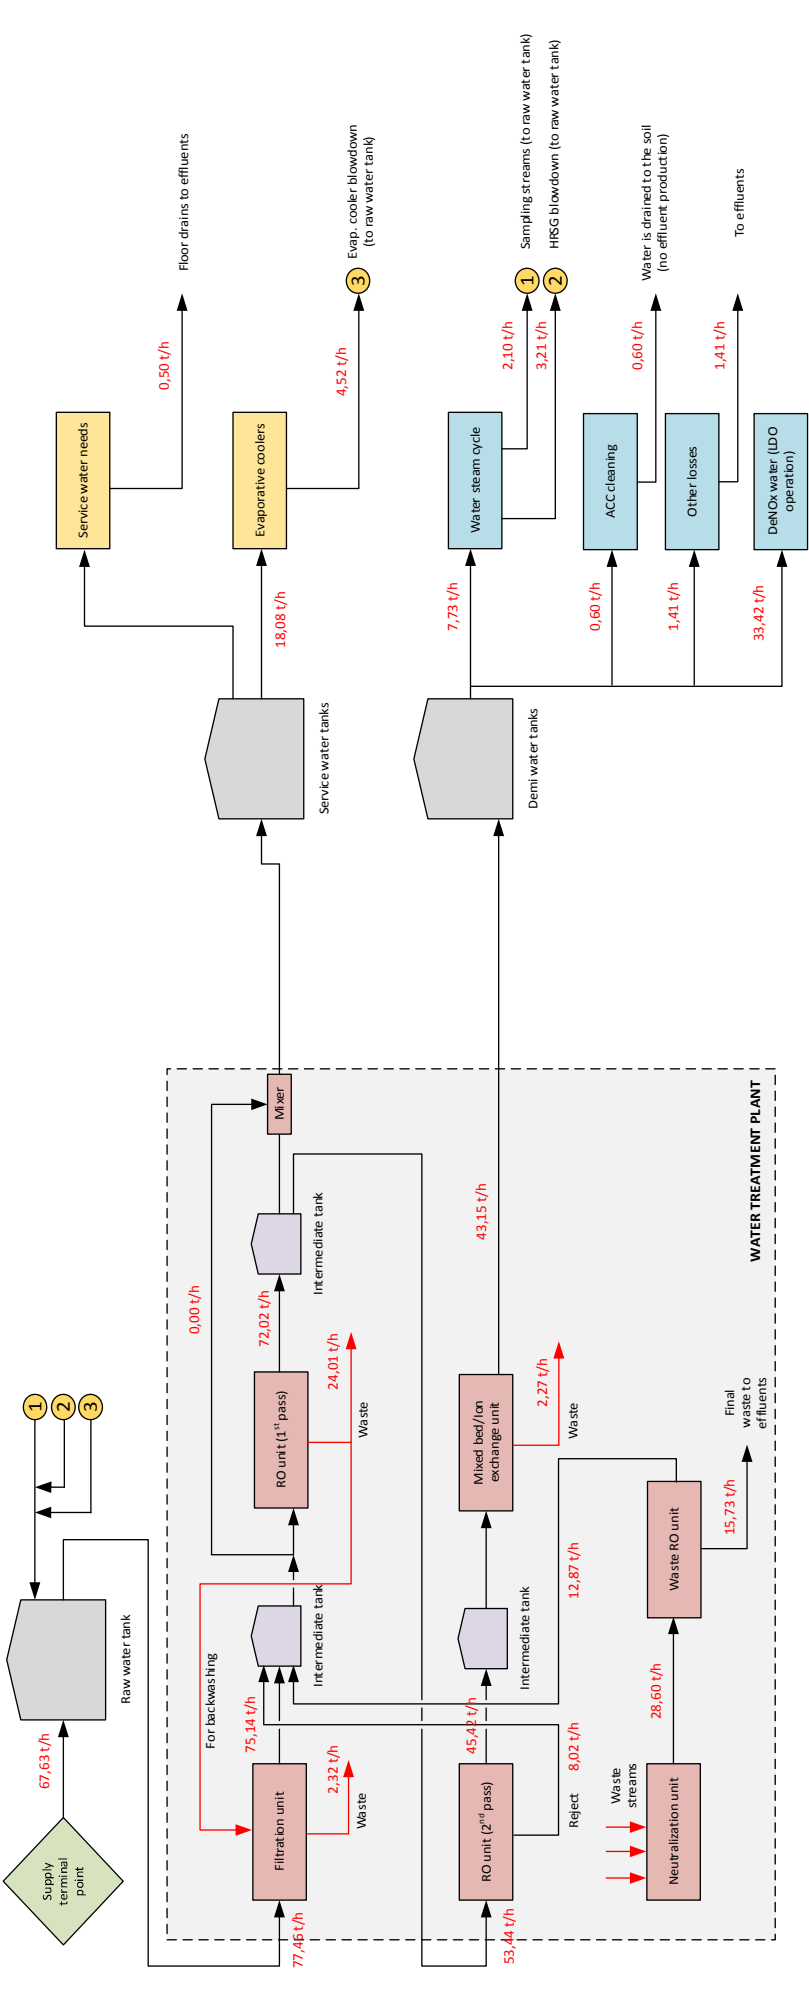


Notes:

1. In water steam cycle it is included the make up required due to drum blowdown and also the water for the sampling streams.
2. Part of the drum blowdown if lost to the atmosphere due to flashing in the HRSG blowdown tank. Liquid fraction is reused as raw water.
3. In other losses it is included the condensate losses of the plant.

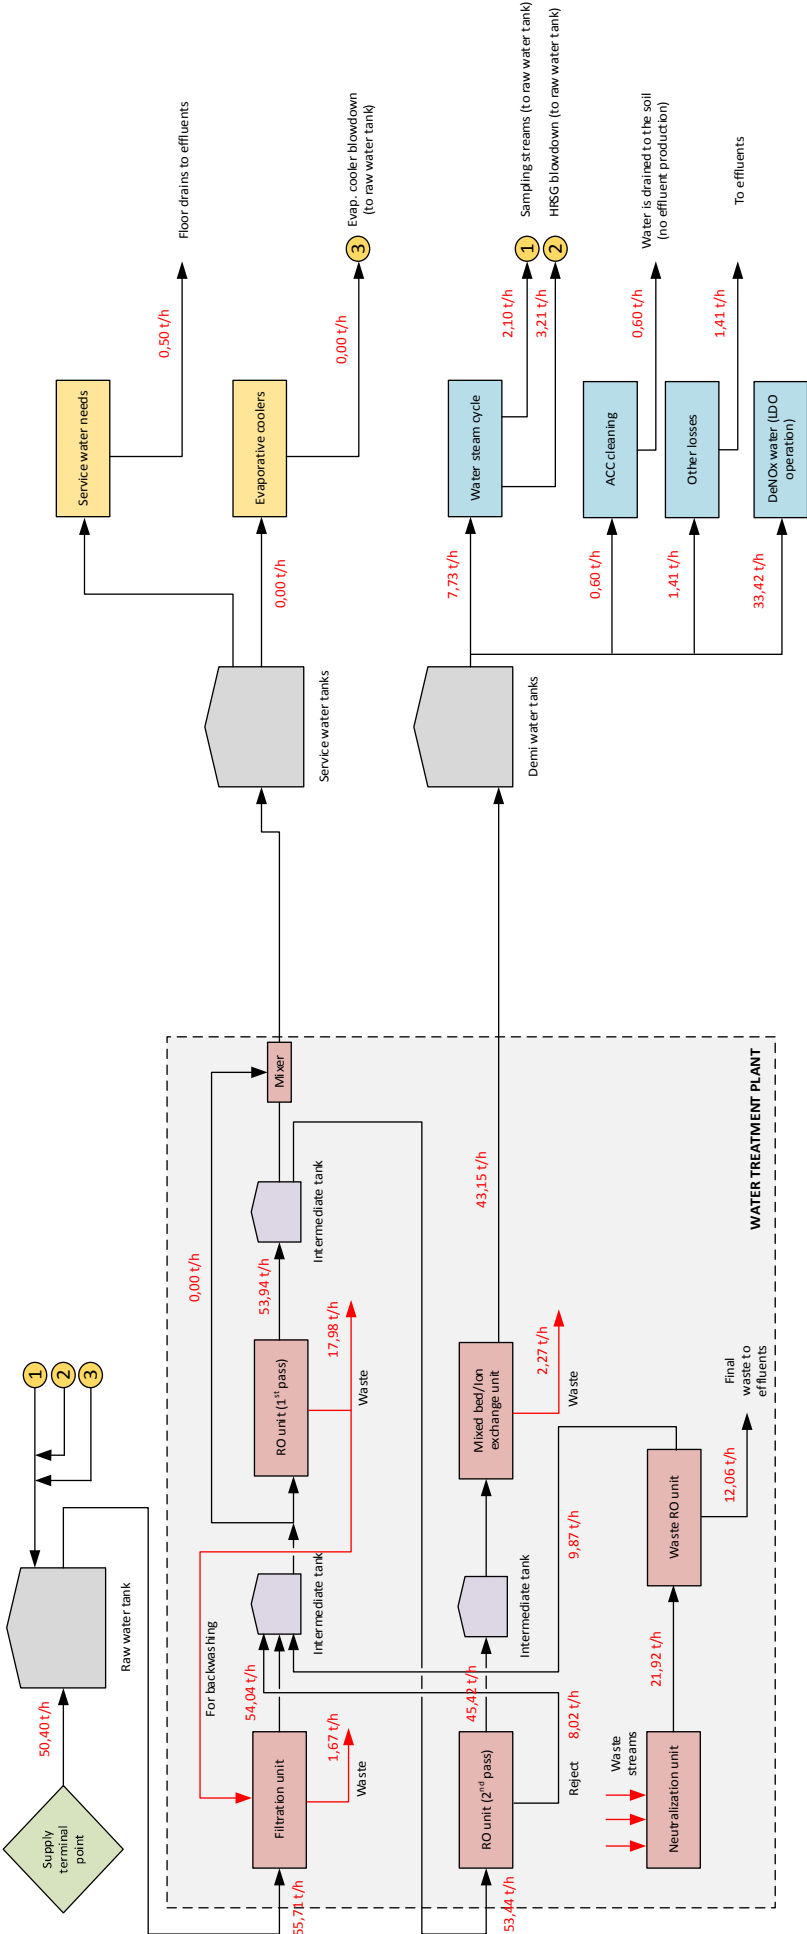

Total effluents generated:	WTP effluents	12,06 ton/h
	Service water effluents	0,50 ton/h
	Water-steam cycle effluents	1,41 ton/h
	Total	13,96 ton/h

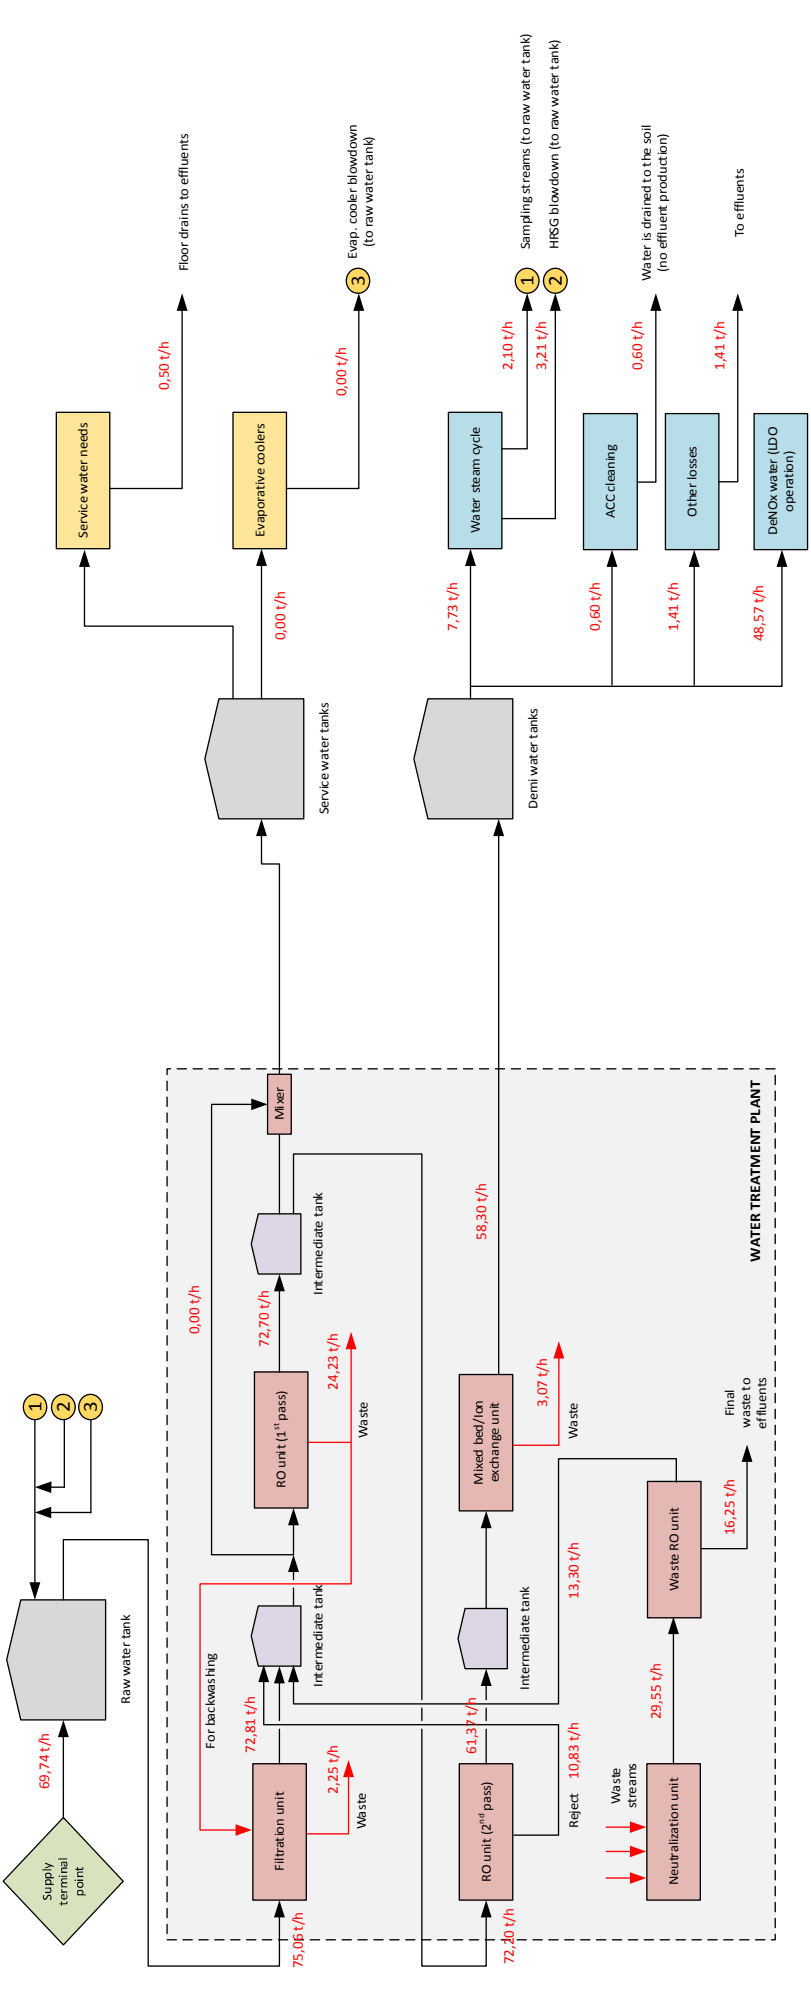

Total effluents generated:	WTP effluents	16,25 ton/h
	Service water effluents	0,50 ton/h
	Water-steam cycle effluents	1,41 ton/h
	Total	18,16 ton/h

- Notes:**
1. In water steam cycle it is included the make up required due to drum blowdown and also the water for the sampling streams.
 2. Part of the drum blowdown if lost to the atmosphere due to flashing in the HRSG blowdown tank. Liquid fraction is reused as raw water.
 3. In other losses it is included the condensate losses of the plant.



DOCUMENT: APZ01-00-Y__-PCR-IDM-0580

PROJECT:

ACWA Power Zarqa CCGT Project

WATER BALANCE

REV.

DATE

A

27/04/2016

EFFLUENTS GENERATION

For effluent generation estimation, the following operation scenario is assumed:

Month	Operating days with NG	Operating days with LDO	Shutdown days	Days with evaporative cooler ON	Effluents generated (volume), m3	Effluents generated (flow), m3/h
Jan	0,0	30,4			13254	18,1
Feb	30,4				3645	5,0
Mar	30,4				3645	5,0
Abr	30,4				3645	5,0
May	30,4				3645	5,0
Jun	30,4			12,0	4702	6,4
Jul	30,4			30,0	6288	8,6
Ago	30,4			30,0	6288	8,6
Sep	30,4			11,0	4614	6,3
Oct	30,4				3645	5,0
Nov	30,4				3645	5,0
Dic	15,4		15,0		1849	2,5
Total effluent generation for an entire year					58866	6,7

For the above table, the following assumptions has been considered:

- 30 days/year of operation with LDO (it is assumed in winter as this result in higher effluent generation)
- 15 days/year of plant in shutdown
- Rest of the year operation at full load with natural gas
- Evaporative cooler is used 2000 hours/year (it is assumed in the worst months from water consumption point of view)

EVAPORATION POND SIZING

INPUT DATA	VALUE	UNIT	SOURCE / NOTES
Evaporation rate:	2	m ³ /(m ² ·y)	data provided by Owner
HRSg blowdown:	1	%	
LDO operation:	720	h/y	
GT evap. Cooler operation:	2000	h/y	Note: The most stringent hours per year (the ones with major evaporation) have been considered in the estimation; hours that happen during the months of May, June, July
Plant operating hours	8400	h/y	Assumed 15 days/y of plant not in operation
Average annual cumulative rainfall:	139,1	mm/y	MTS
Concentration cycles in evap. Coolers			Assumed 4 (based on the use of permeate as make up)
Current available surface for the pond (empty):	28035	m ²	This is the area of the bottom section
Current available surface for the pond (with 2 meter of water)	36935	m ²	This is the area when liquid level is at 2 m
Current surface of the pond for rain collection:	43962	m ²	This is the total area including the slopes that will collect rain

PROCESS EFFLUENTS	VALUE	UNIT	NOTES
Total annual process effluents to the pond	58866	m ³	

RAIN COLLECTED IN THE POND	VALUE	UNIT	NOTES
Annual rainfall	139,1	mm/y	
Total are in the pond for rain collection	43962	m ²	
Total annual process effluents to the pond	6115	m ³	

EVAPORATION POND SURFACE CALCULATION	VALUE	UNIT	NOTES
Total annual water to the pond	64981	m ³	
Pond minimum surface to evaporate water collected	32490	m ²	Based on the evaporation rate given by Owner of 2 m ³ /(m ² ·year)
Current average pond surface	32485	m ²	This is the pond surface with liquid level at 1 m
Design pond height	2	m	This is the minimum recommended height in order to have some margin for high rain years (note 1)

NOTES:

1. As evaporation occurs thorough the entire year as effluents are generated, the expected water level in the pond (with normal rain) is expected to be around 1 m.

Appendix D


Construction Programme


 Remaining Level of Effort
 Actual Work
 Critical Remaining Work
 Summary
 WBS Summary Progress


 Actual Level of Effort
 Remaining Work
 Milestone
 WBS Summary Activity


Page 1 of 15

2015-12-28

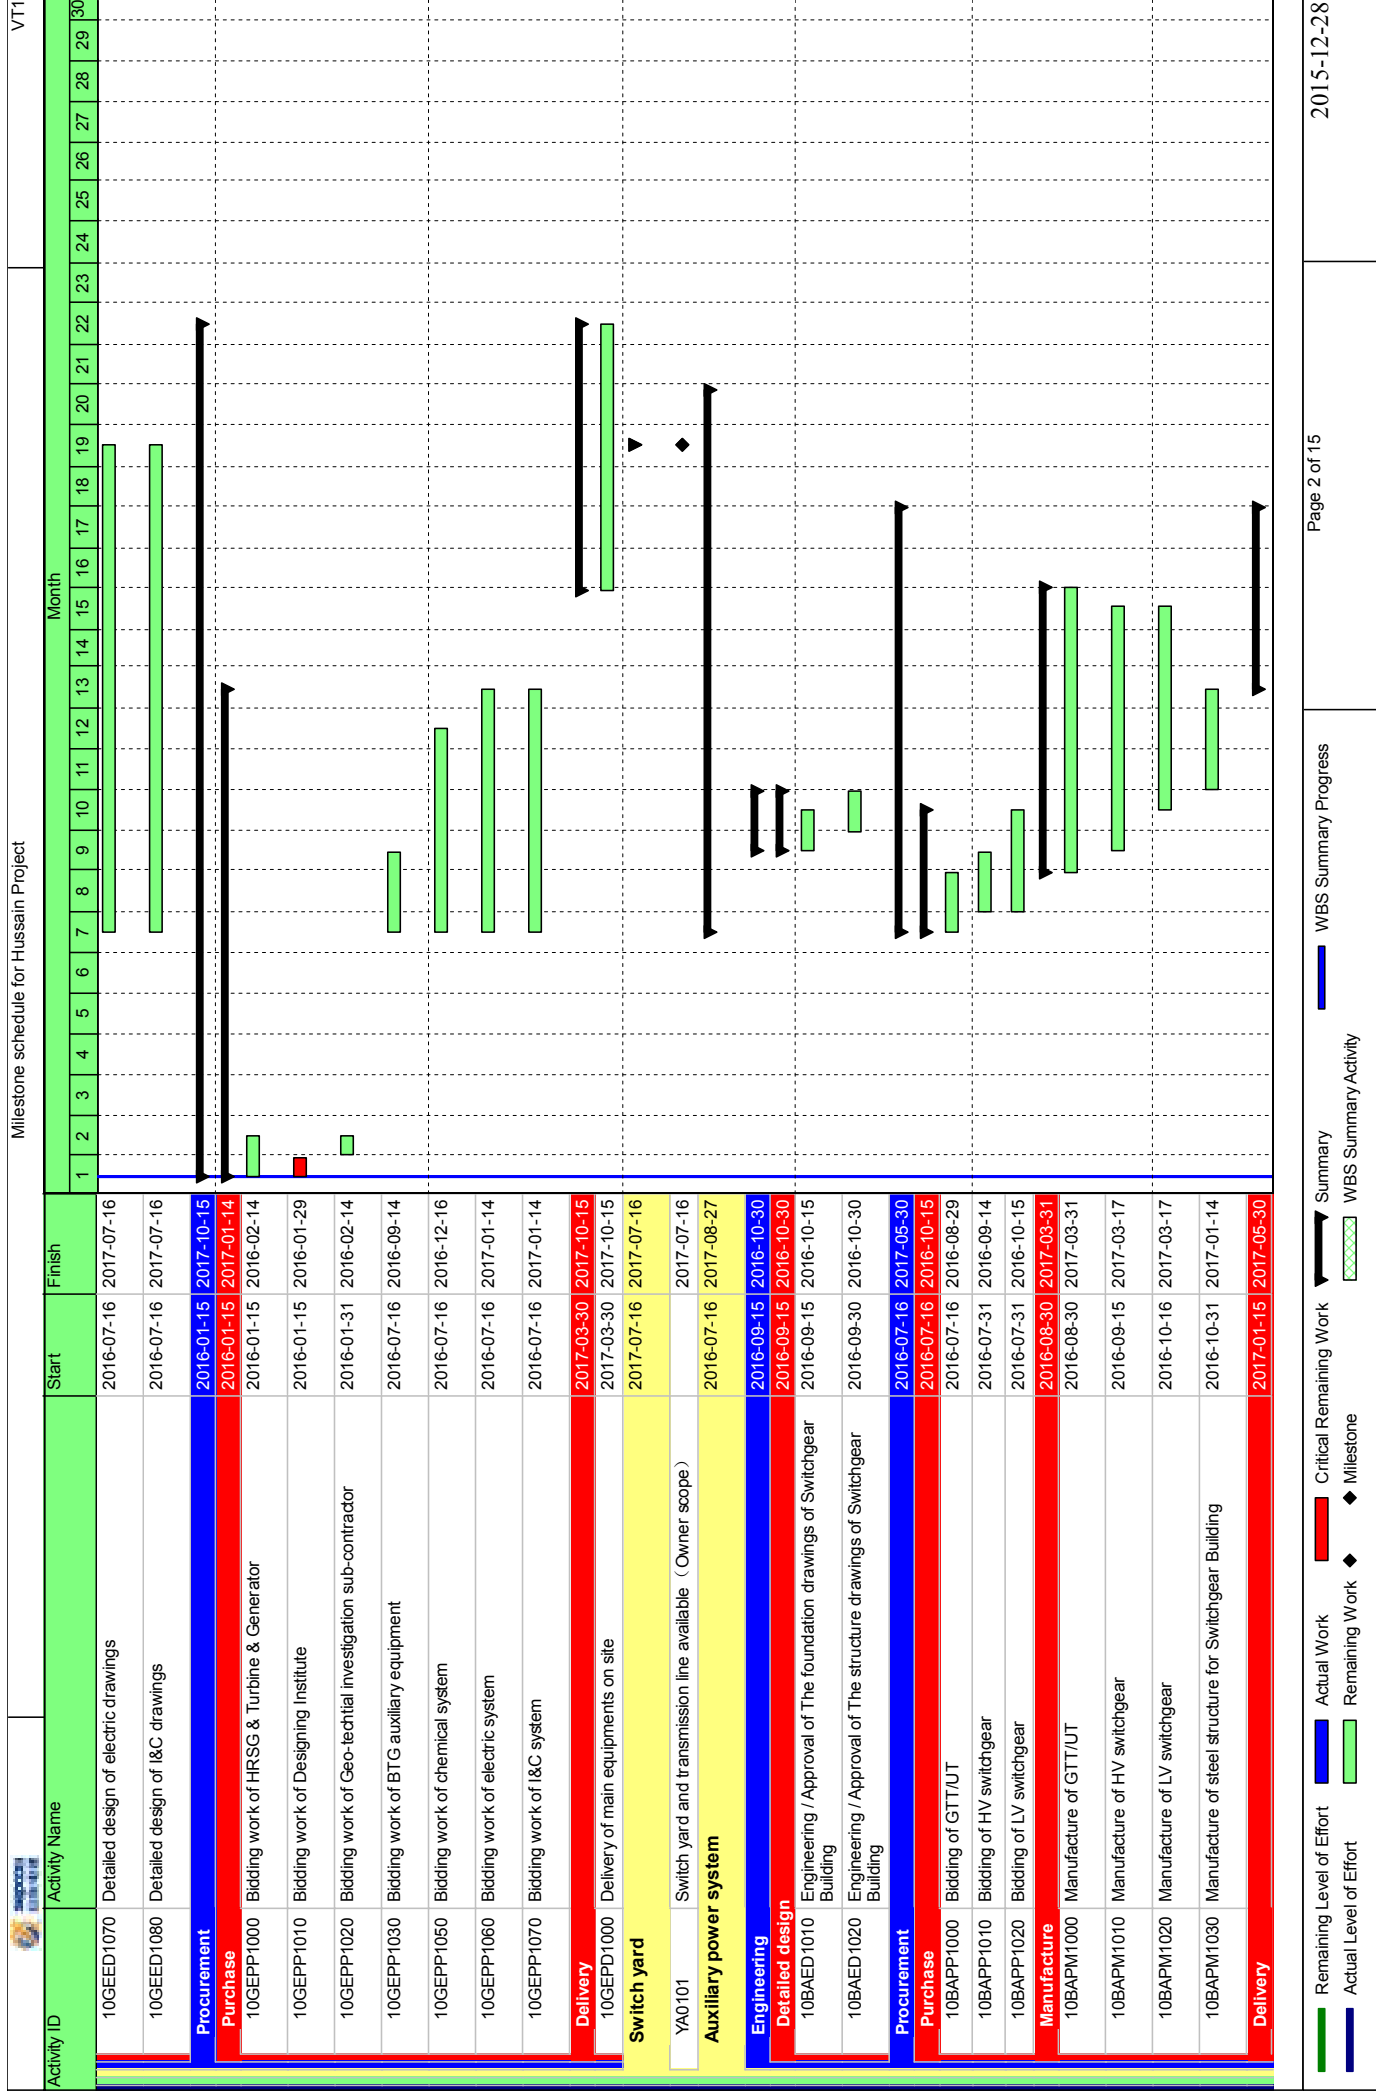


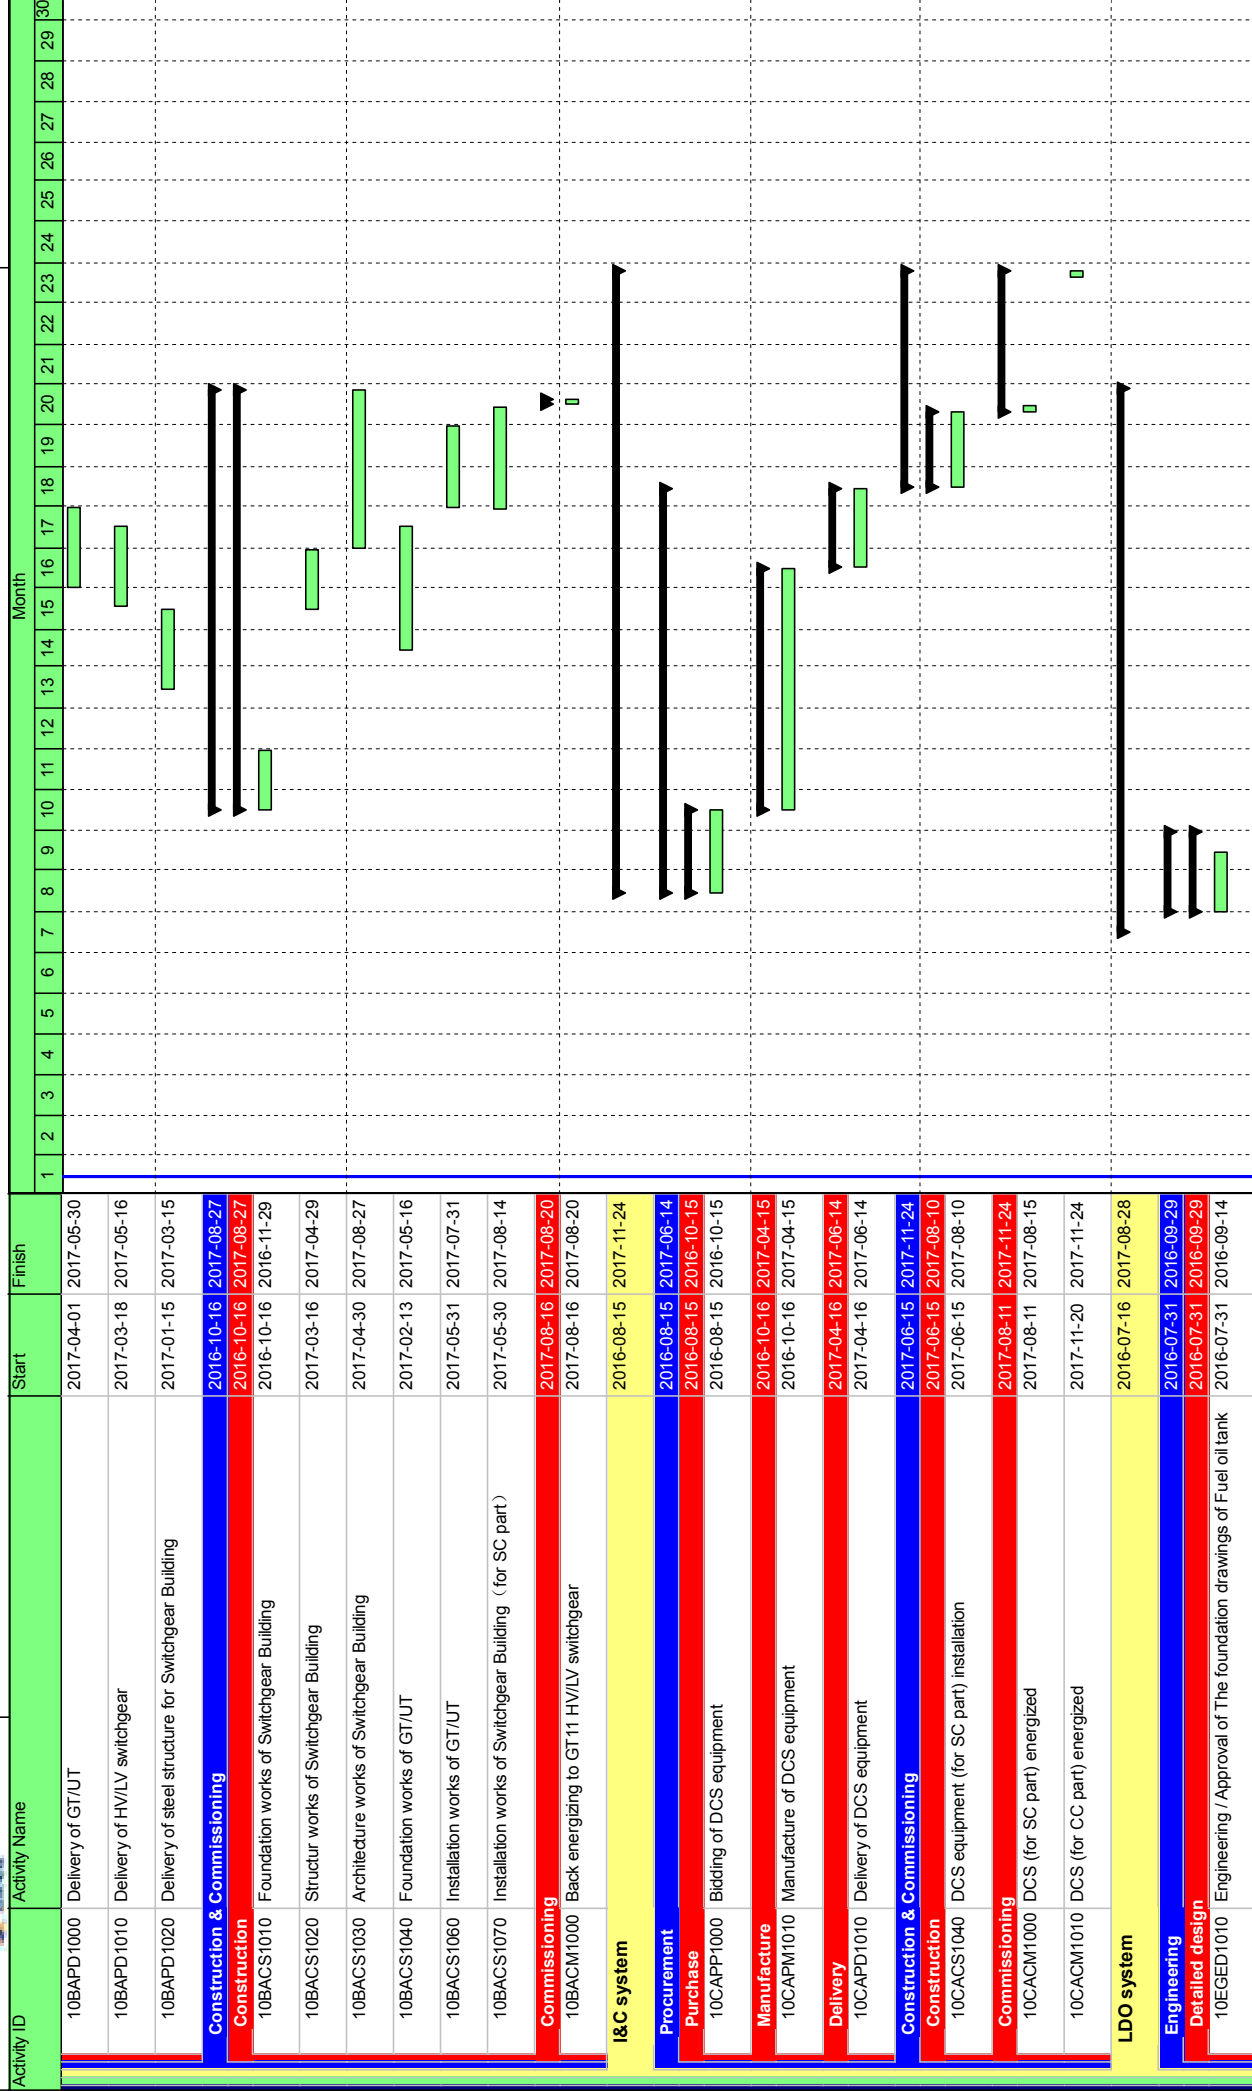

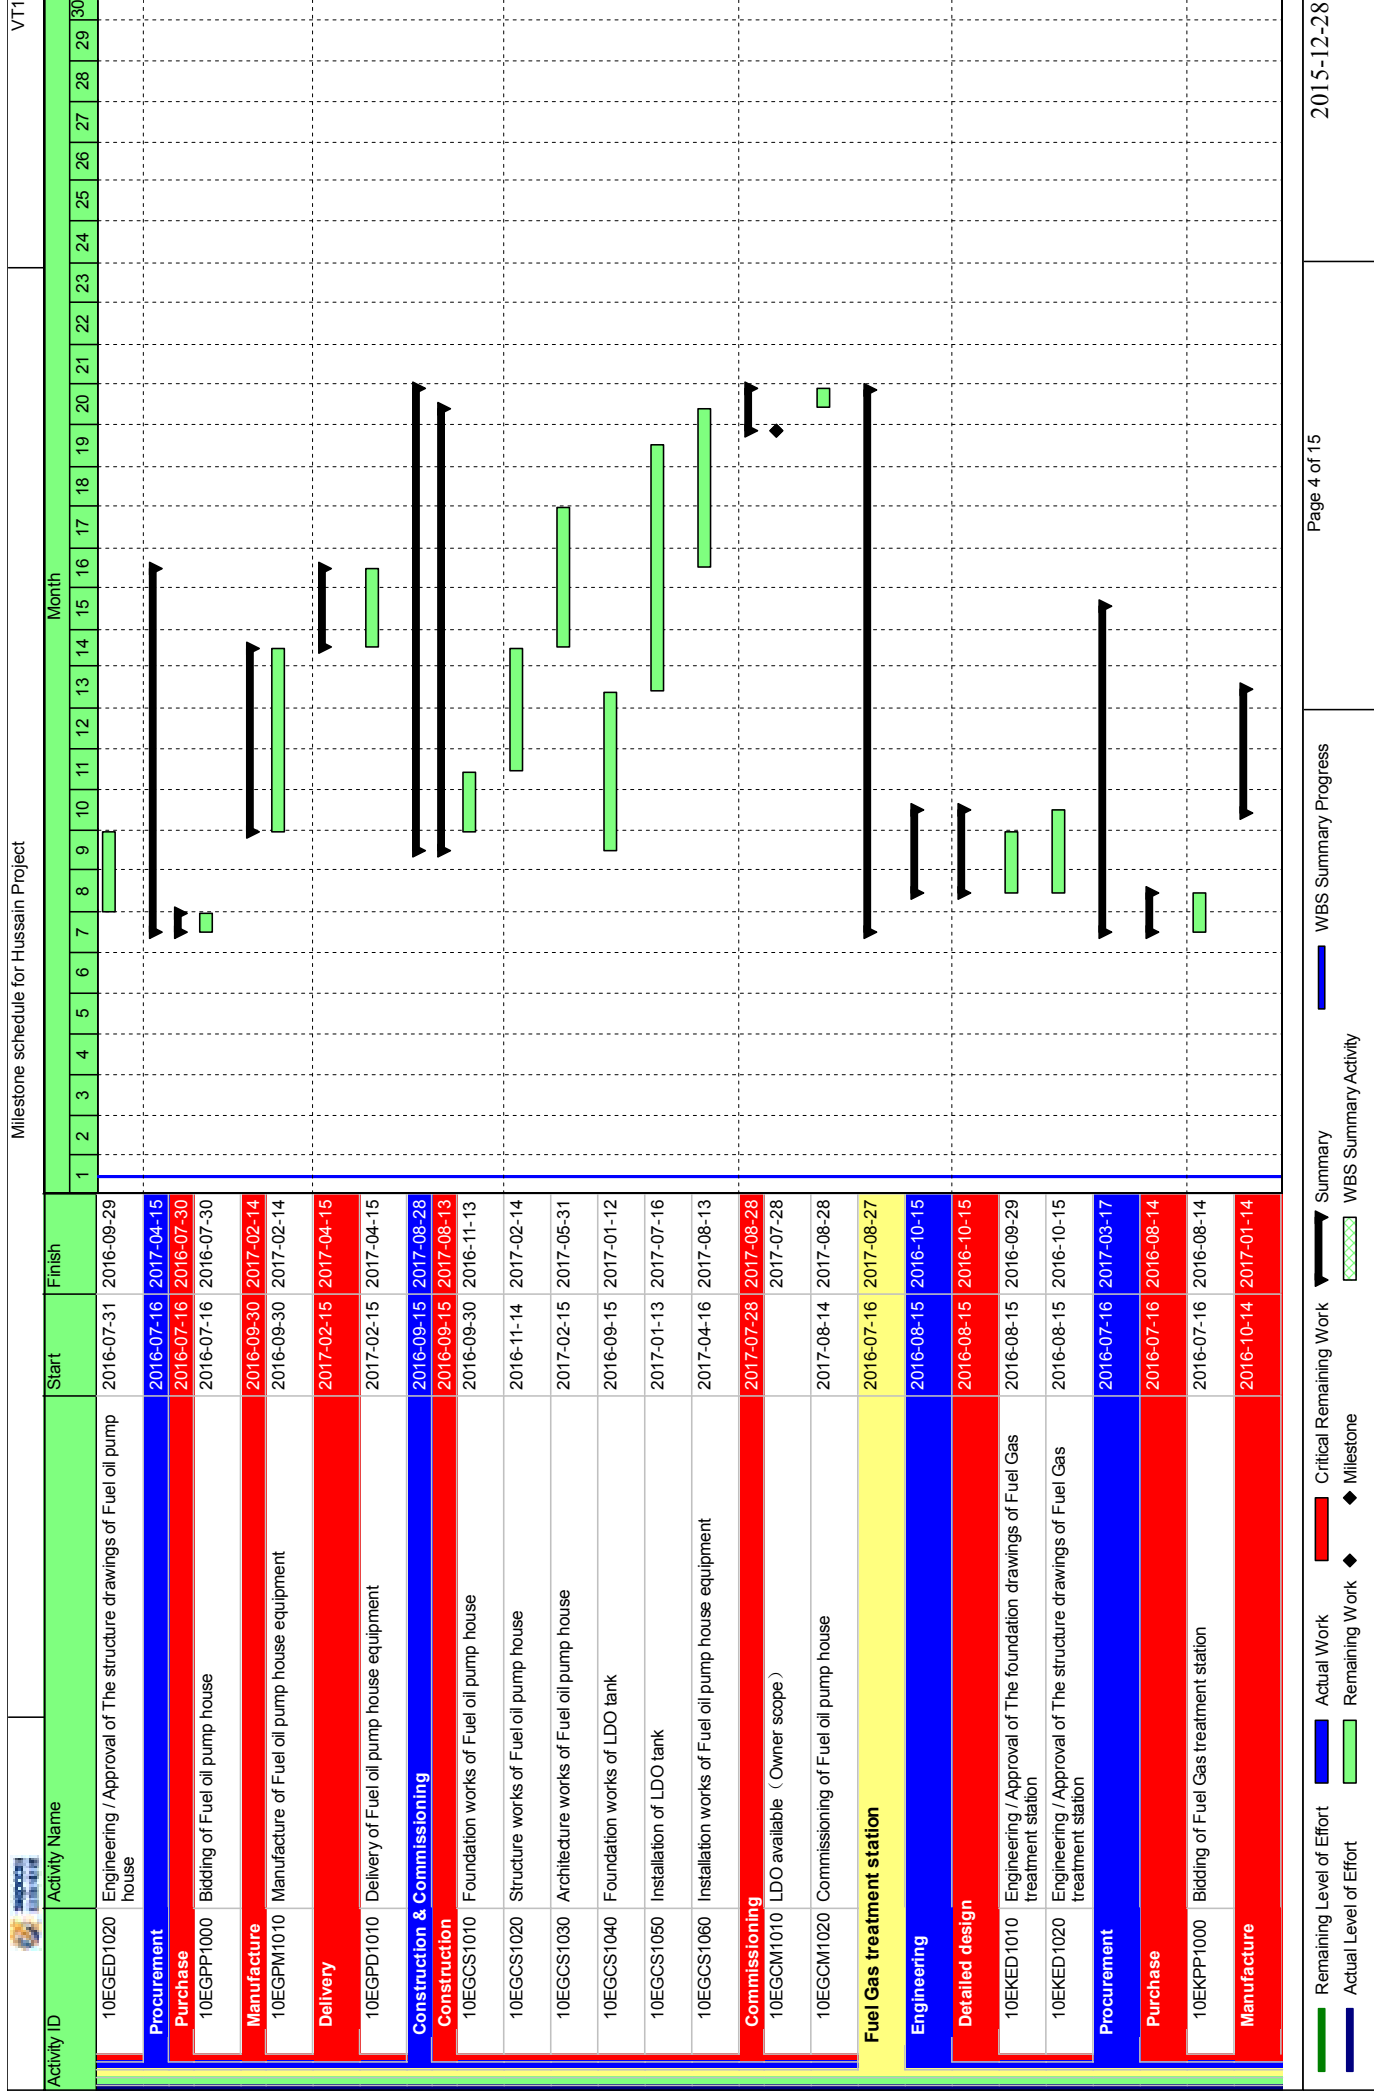

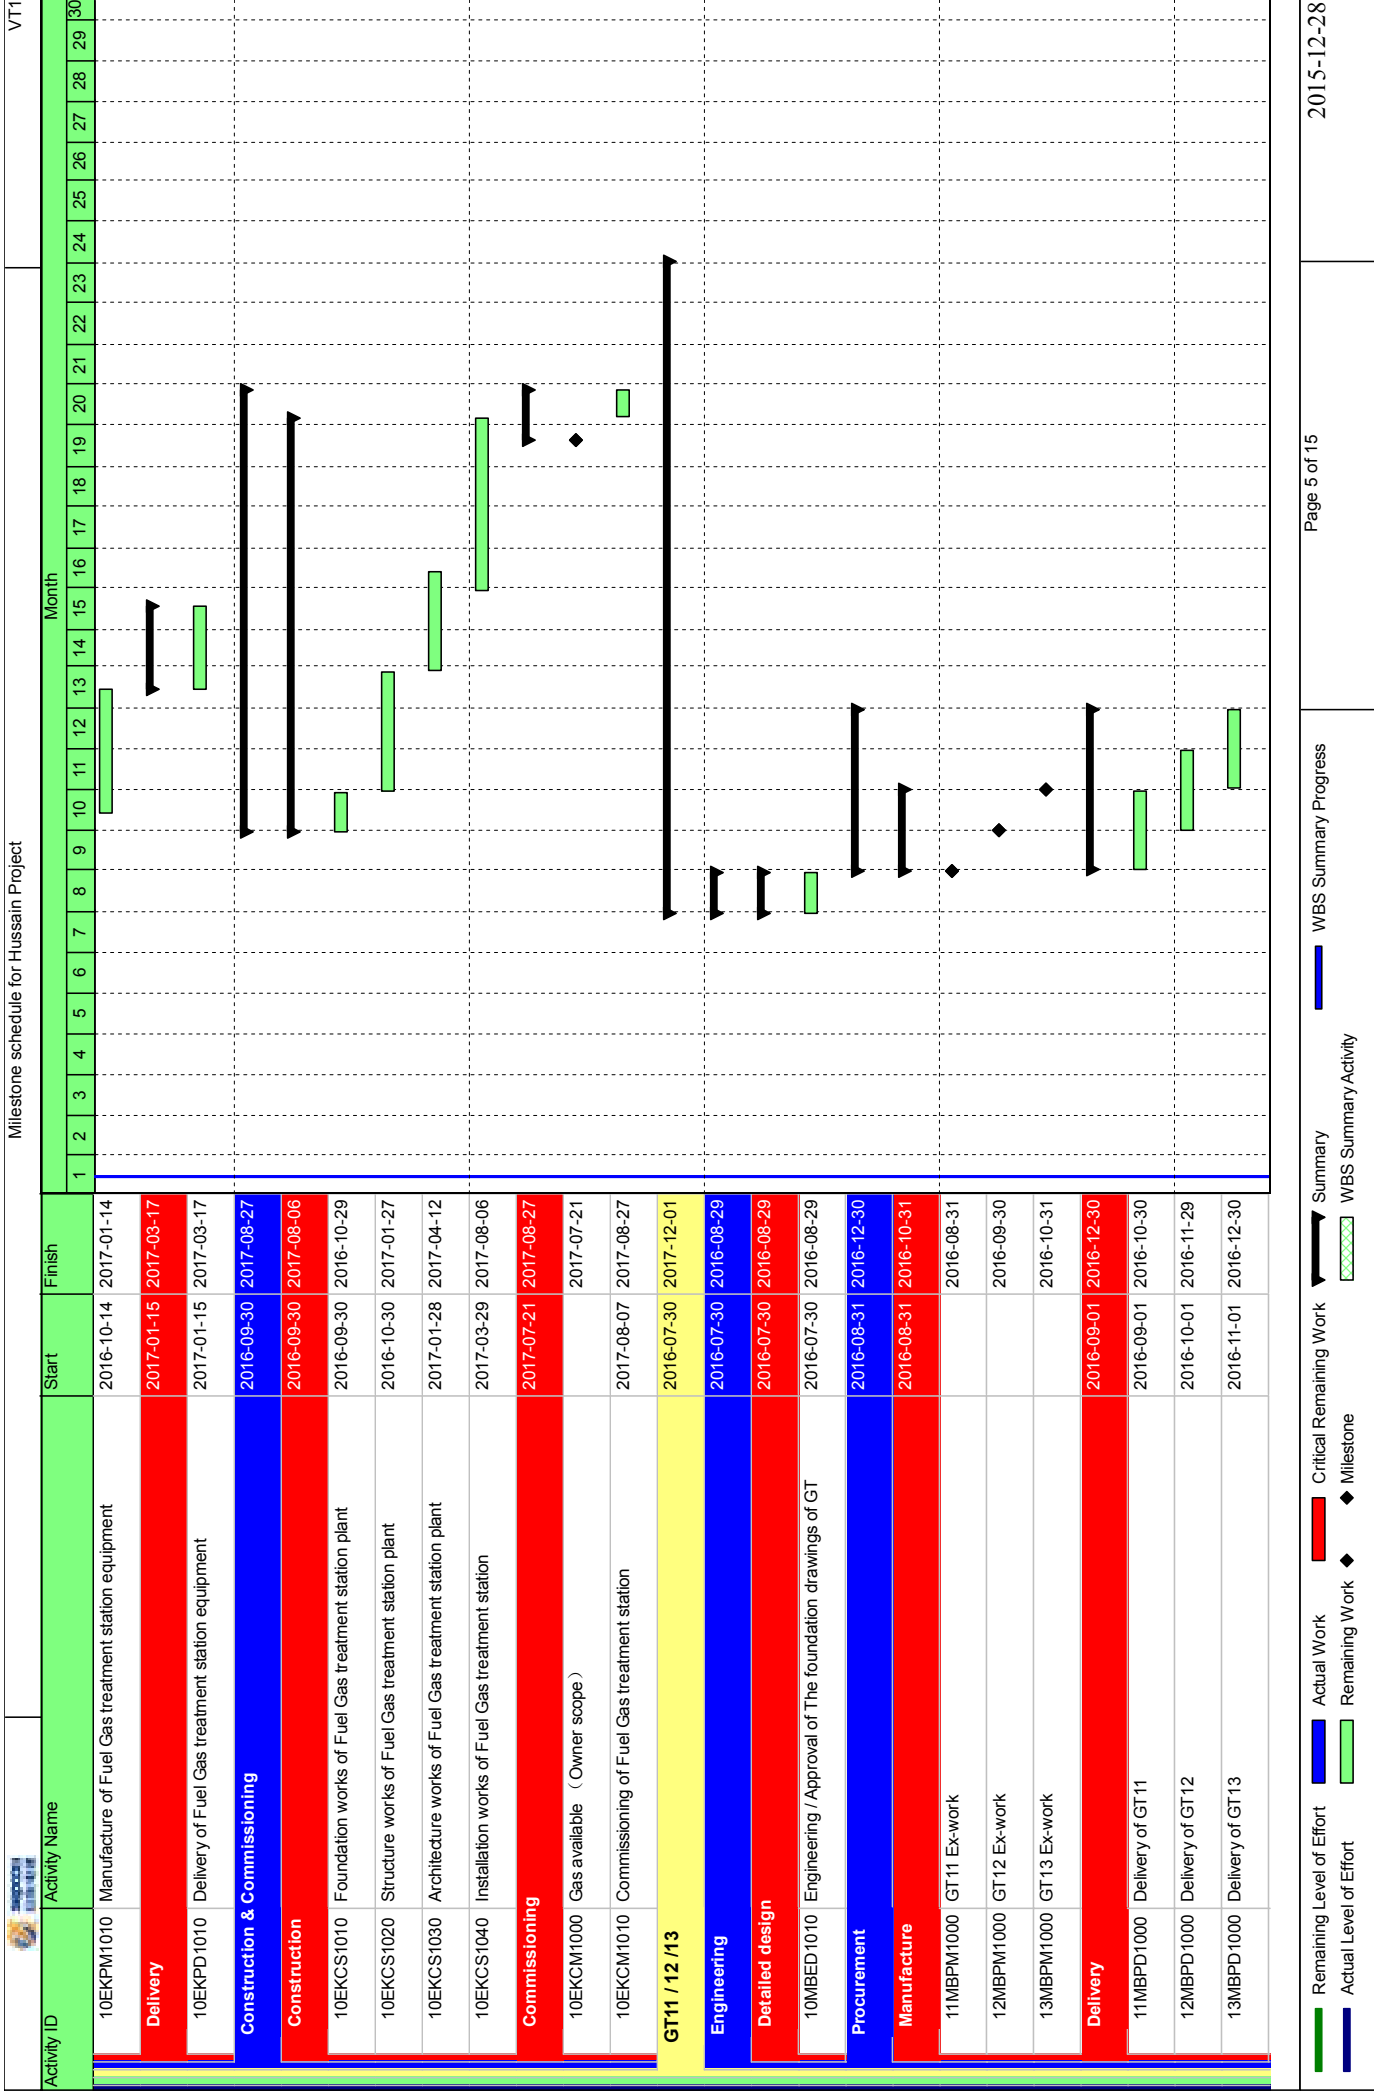

Milestone schedule for Hussain Project			Month																														VT				
Activity ID	Activity Name	Start	Finish	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30				
Construction & Commissioning																																					
Construction																																					
11MBCS1010	Foundation works of GT11	2016-08-30	2017-12-01																																		
11MBCS1020	Placing of GT11	2016-08-30	2017-08-03																																		
11MBCS1030	Erection works of GT11	2016-08-30	2017-01-10																																		
12MBCS1010	Foundation works of GT12	2017-01-11	2017-01-20																																		
12MBCS1020	Placing of GT12	2017-01-21	2017-07-02																																		
12MBCS1030	Erection works of GT12	2016-09-29	2017-02-09																																		
13MBCS1010	Foundation works of GT13	2017-02-10	2017-02-19																																		
13MBCS1020	Placing of GT13	2017-02-20	2017-07-19																																		
13MBCS1030	Erection works of GT13	2016-10-29	2017-03-11																																		
		2017-03-12	2017-03-21																																		
		2017-03-22	2017-08-03																																		
Commissioning																																					
11MBCM1000	Oil flushing & Cold Commissioning of GT11	2017-07-03	2017-12-01																																		
11MBCM1010	First Fire of GT11	2017-07-03	2017-08-31																																		
11MBCM1020	Hot Commissioning of GT11	2017-09-01																																			
11MBCM1030	Reliability Run of GT11	2017-09-01	2017-10-01																																		
11MBCM1040	Performance Test of GT11	2017-10-02	2017-10-16																																		
11MBCM1050	Put into commercial operation of GT11	2017-10-17	2017-10-31																																		
			2017-10-31																																		
12MBCM1000	Oil flushing & Cold Commissioning of GT12	2017-10-31																																			
12MBCM1010	First Fire of GT12	2017-07-20	2017-09-17																																		
12MBCM1020	Hot Commissioning of GT12	2017-09-18																																			
12MBCM1030	Reliability Run of GT12	2017-09-18	2017-10-17																																		
12MBCM1040	Performance Test of GT12	2017-10-18	2017-11-01																																		
12MBCM1050	Put into commercial operation of GT12	2017-11-02	2017-11-16																																		
			2017-11-16																																		
13MBCM1000	Oil flushing & Cold Commissioning of GT13	2017-10-02	2017-10-31																																		
		2017-08-04	2017-10-02																																		

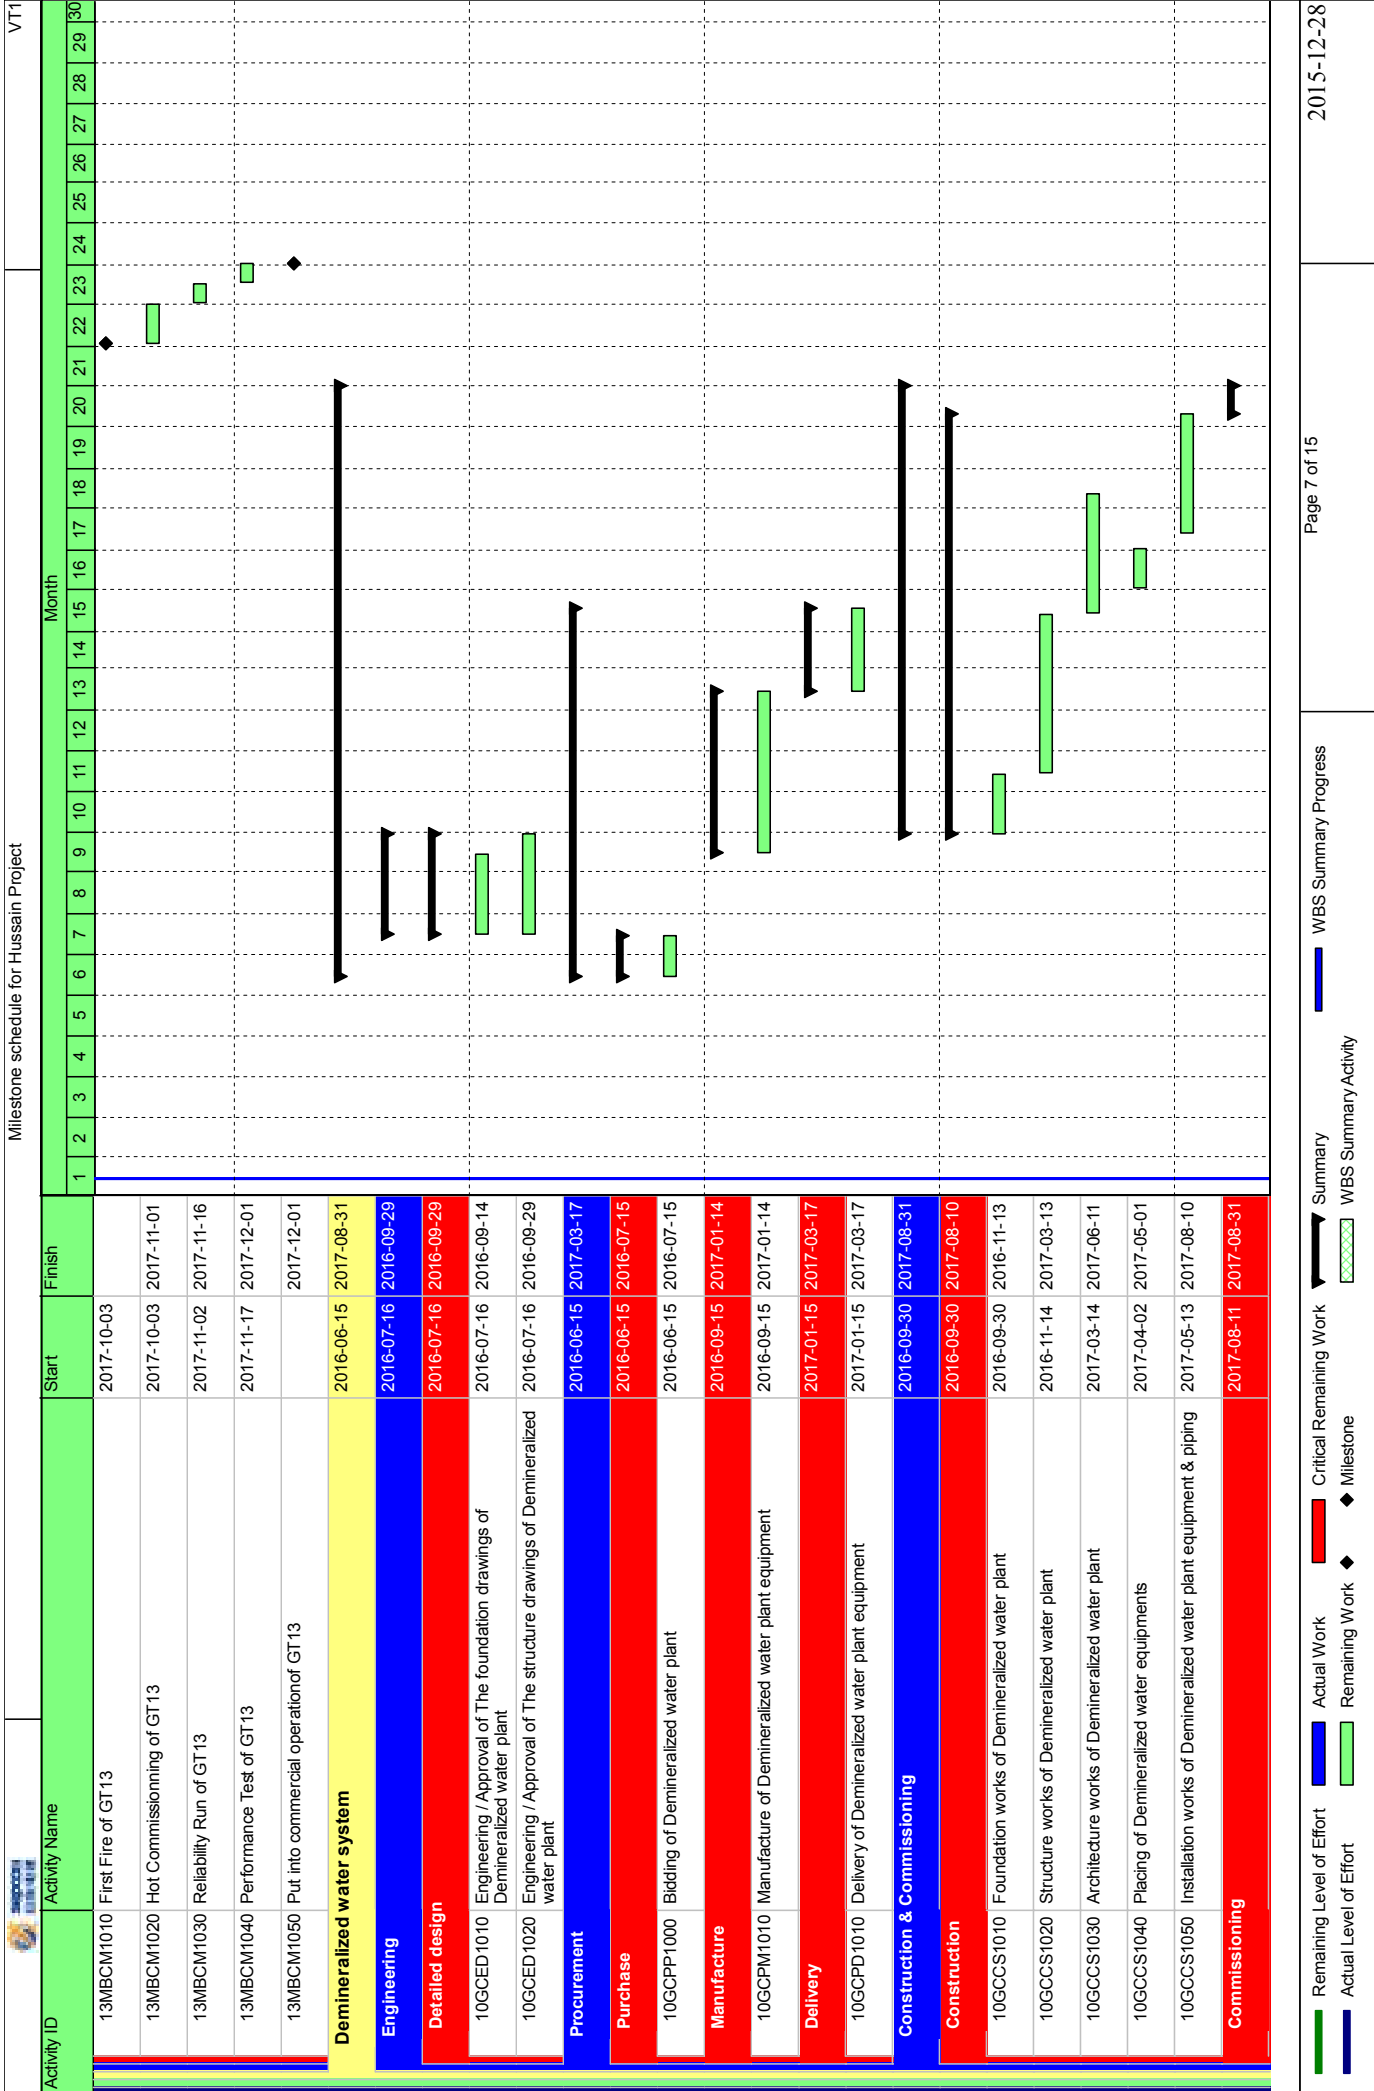

Milestone schedule for Hussain Project			Month																														VT				
Activity ID	Activity Name	Start	Finish	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30				
10GCCM1000	Commissioning of Demineralized water plant	2017-08-11	2017-08-31																																		
Waste water treatment system																																					
Engineering																																					
Detailed design																																					
10GNED1000	Detailed foundation drawing of Waste water treatment plant	2016-08-30	2016-12-27																																		
Procurement																																					
Purchase																																					
10GNPP1000	Bidding of Waste water treatment system equipment	2016-07-16	2016-08-29																																		
Manufacture																																					
10GNPM1000	Manufacture of Waste water treatment system equipment	2016-08-30	2017-02-14																																		
Delivery																																					
10GNPD1000	Delivery of Waste water treatment system equipment	2017-02-15	2017-04-15																																		
Construction & Commissioning																																					
Construction																																					
10GNCS1000	Civil works of Waste water pool	2016-10-29	2017-08-16																																		
10GNCS1010	Civil works of Waste water treatment pump house	2016-10-29	2017-06-14																																		
10GNCS1020	Installation works of Waste water treatment equipment & piping	2016-11-13	2017-04-15																																		
Commissioning																																					
10GNCM1000	Commissioning of Waste water treatment system	2017-08-17	2017-08-31																																		
HRSG11 & HRSG12 & HRSG13																																					
Engineering																																					
Detailed design																																					
10HBED1010	Engineering of The foundation drawings of HRSG	2016-07-16	2016-10-15																																		
10HBED1020	Approval of The foundation drawings of HRSG	2016-07-16	2016-09-15																																		
Procurement																																					
		2016-01-15	2017-06-15																																		
2015-12-28																																					

Remaining Level of Effort

Actual Level of Effort

Actual Work

Remaining Work

Critical Remaining Work

Milestone


Summary


WBS Summary Activity







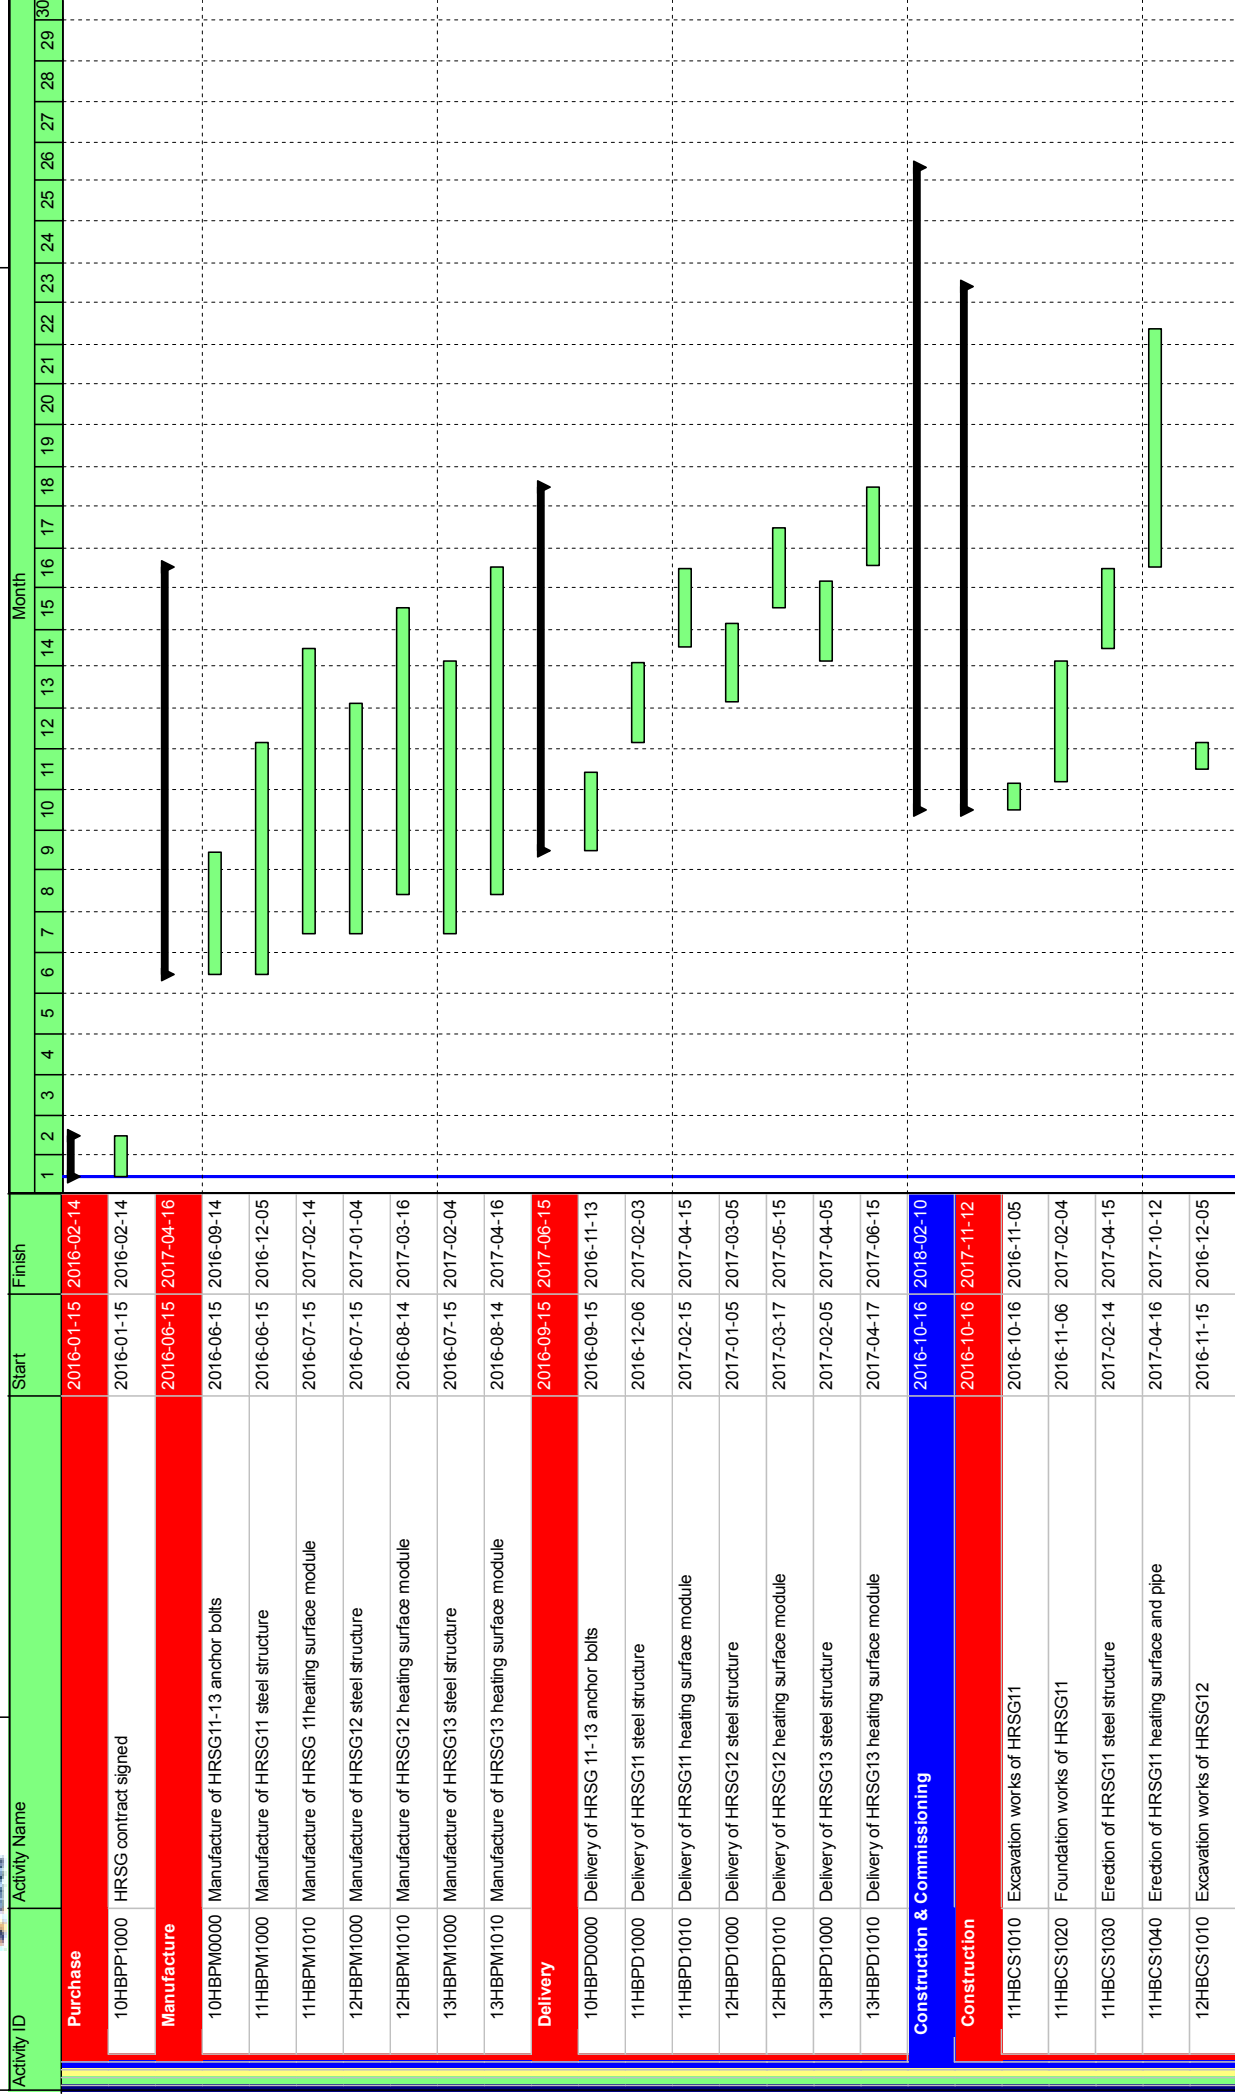

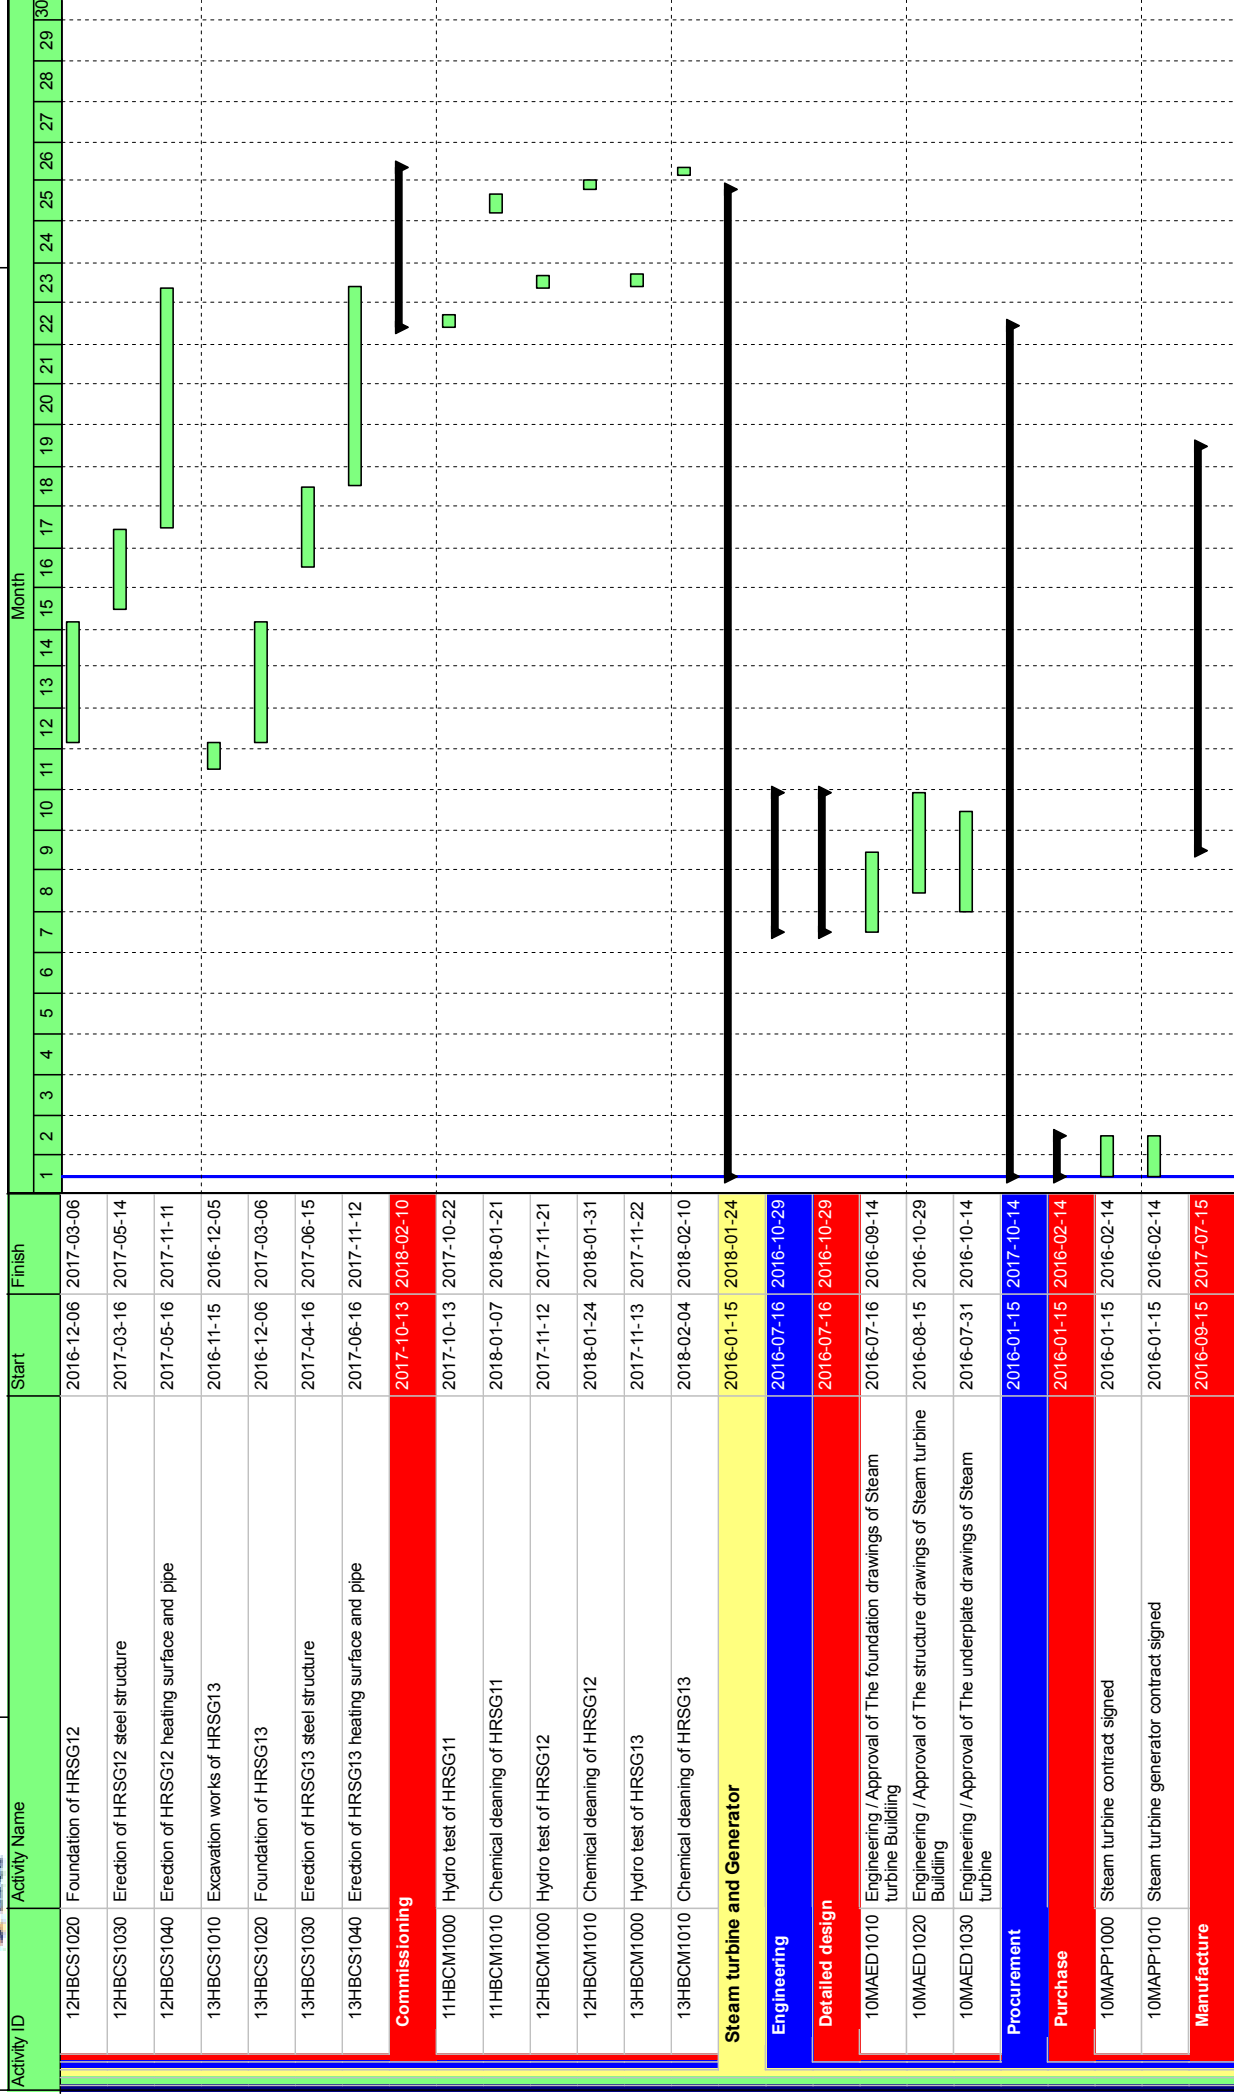
WBS Summary Progress


Page 8 of 15


2015-12-28







 Remaining Level of Effort  Actual Level of Effort  Actual Work  Remaining Work  Critical Remaining Work  Milestone  WBS Summary Activity  Summary  WBS Summary Progress	Page 11 of 15	2015-12-28
---	---------------	------------

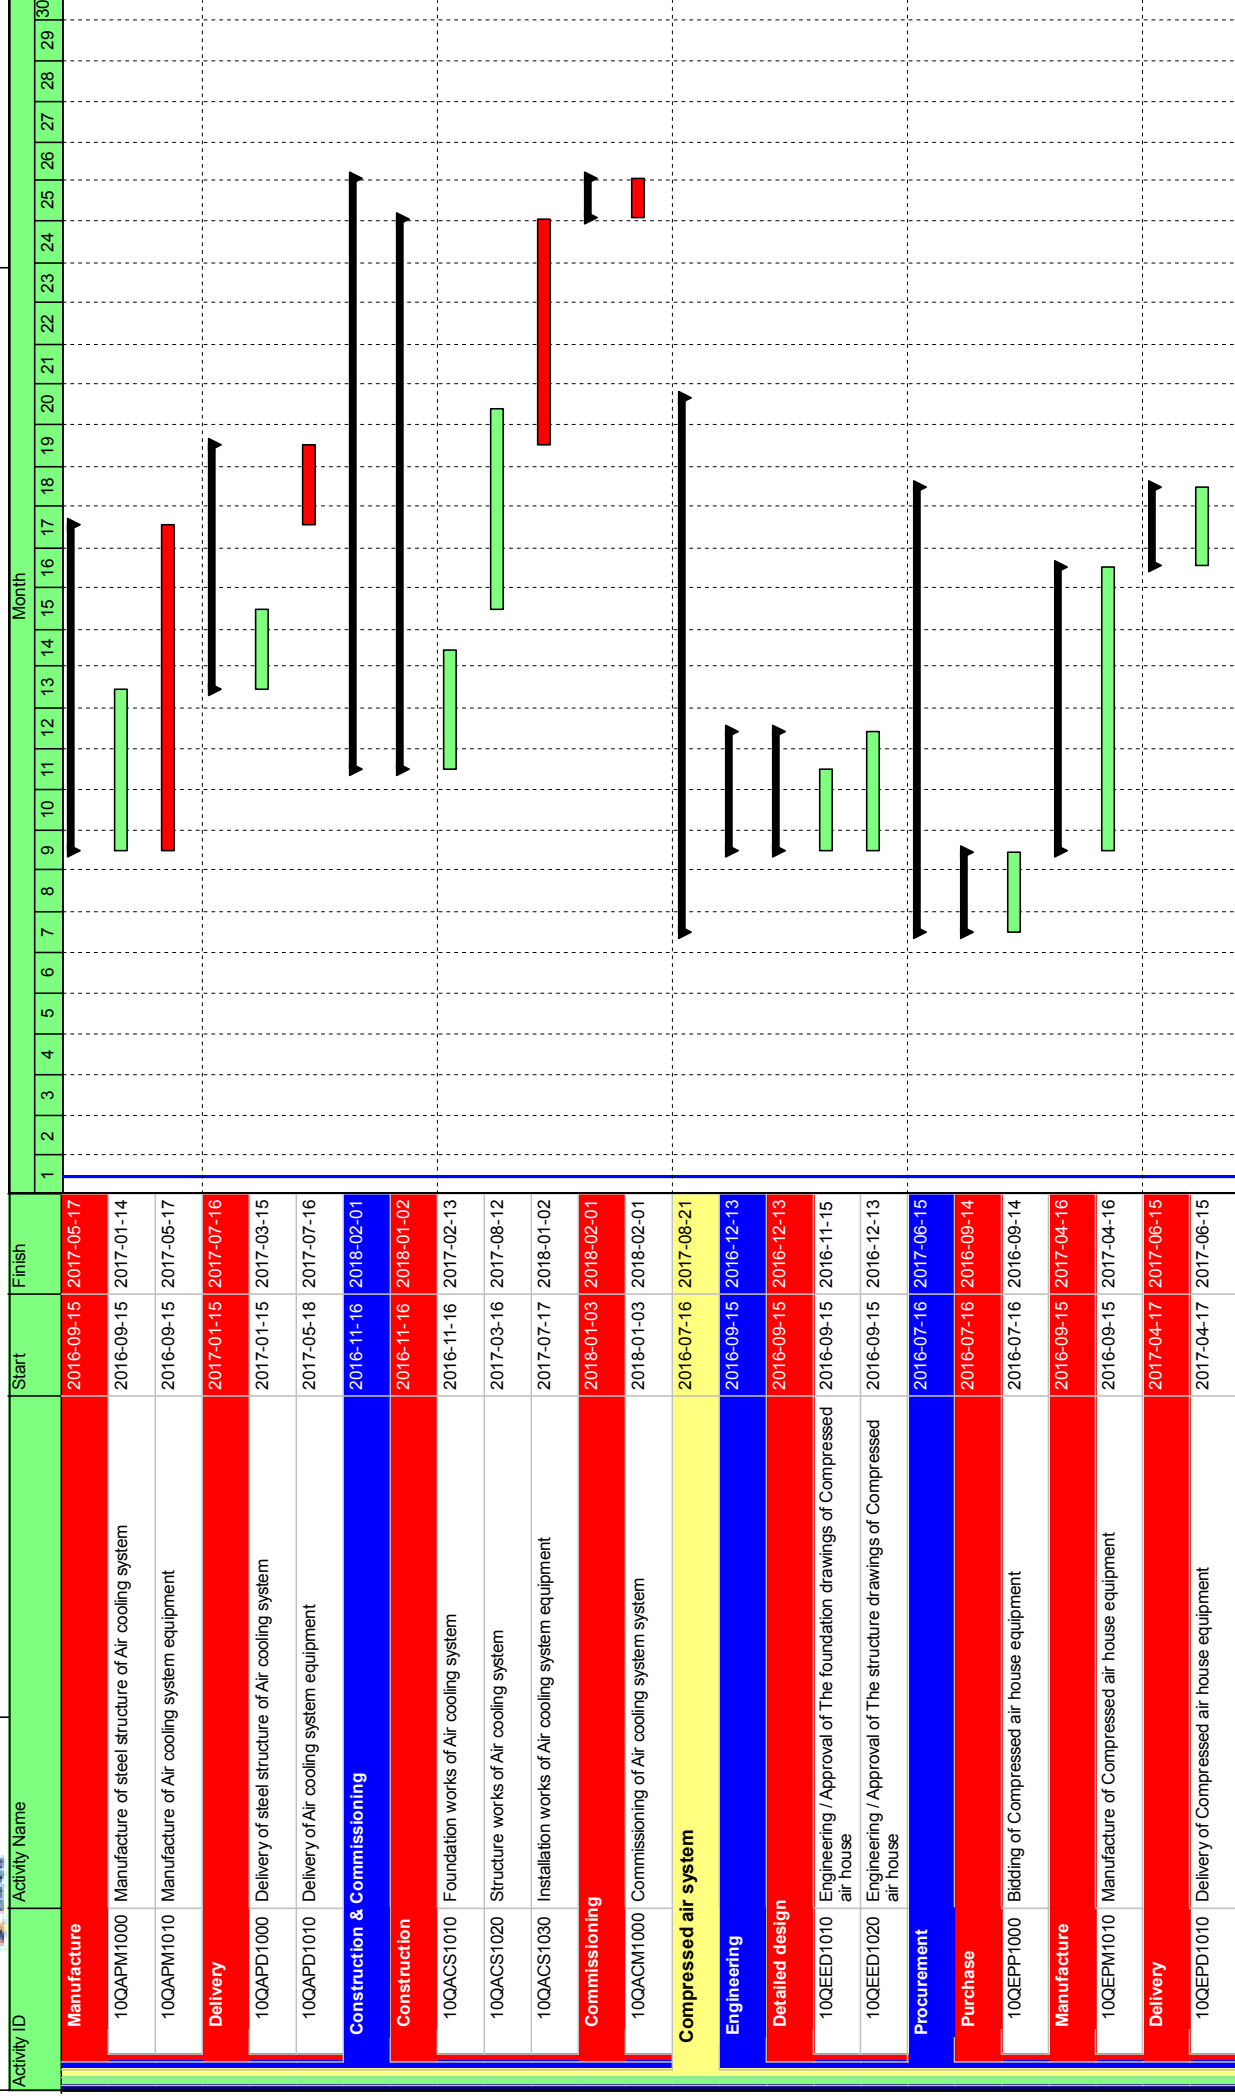

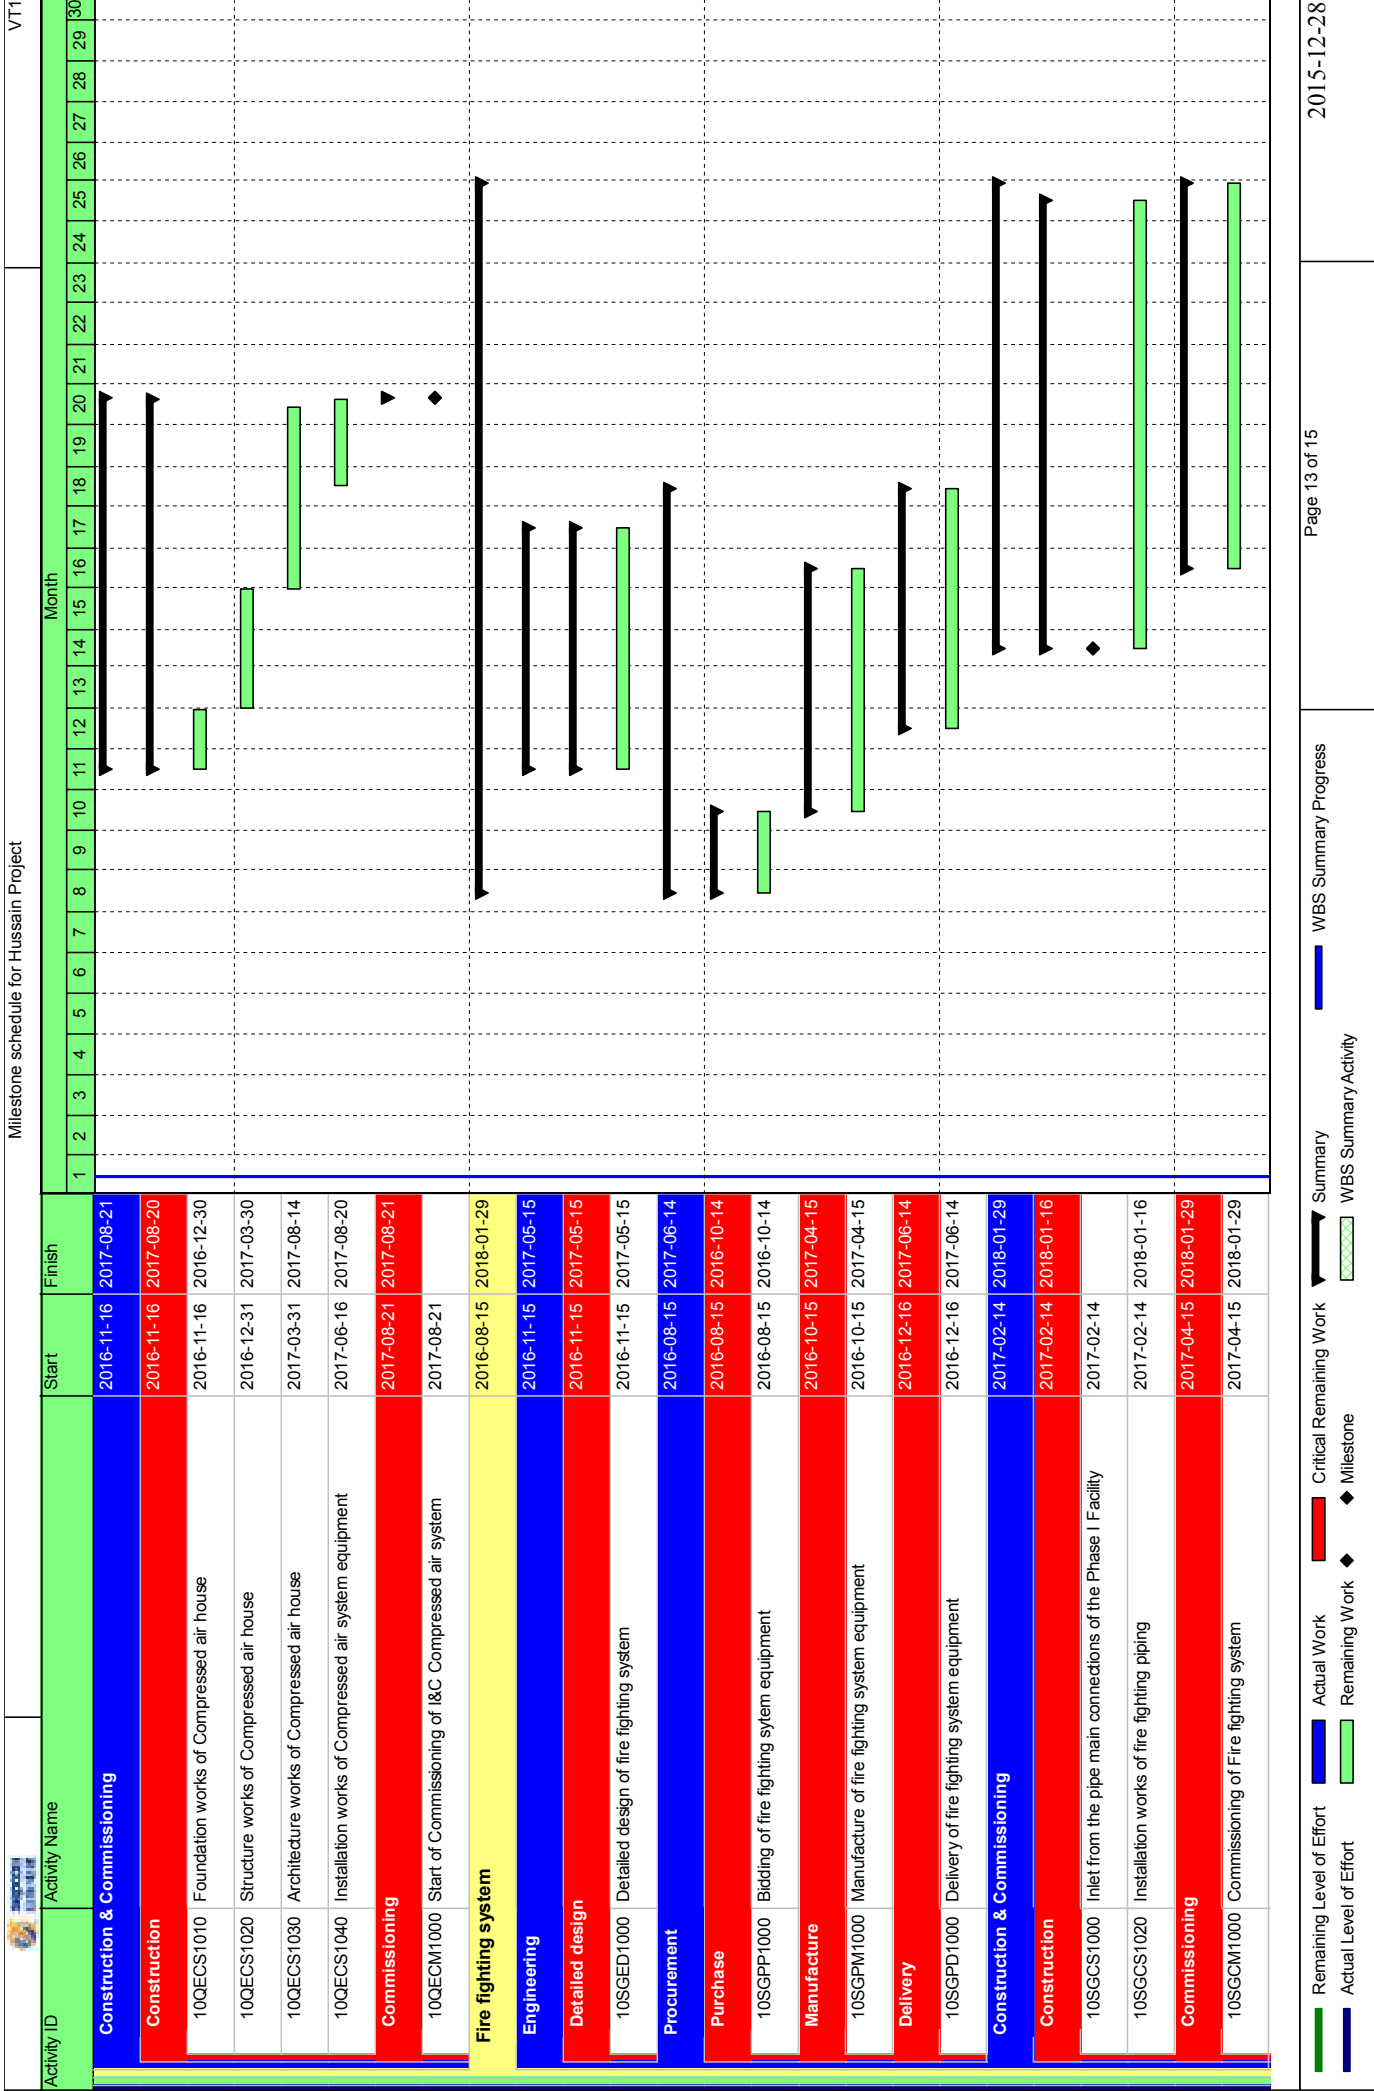


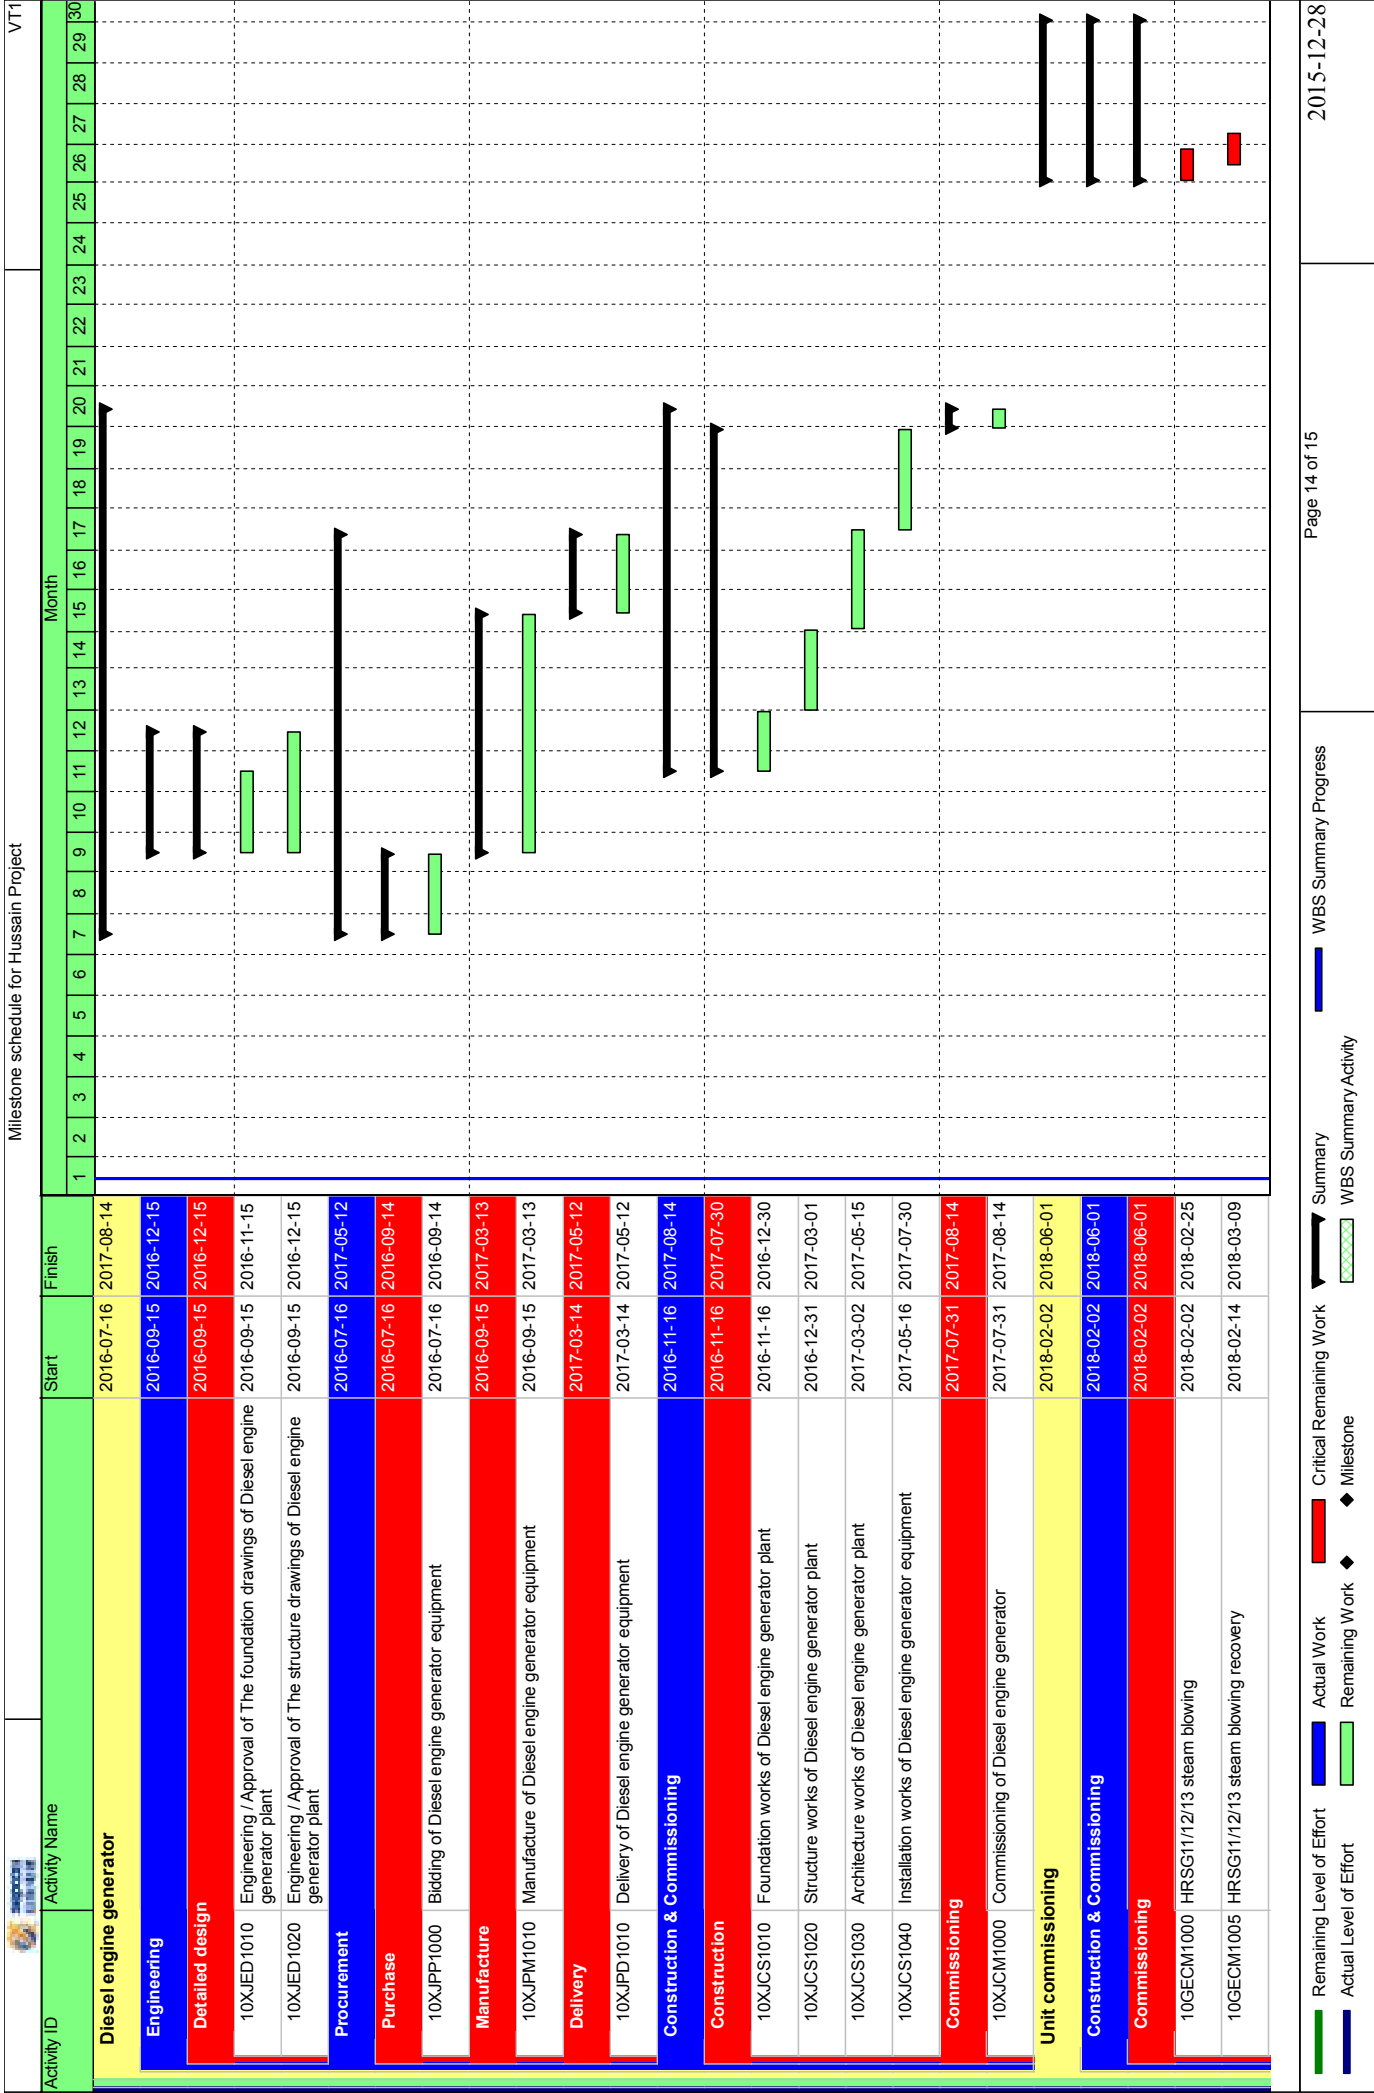

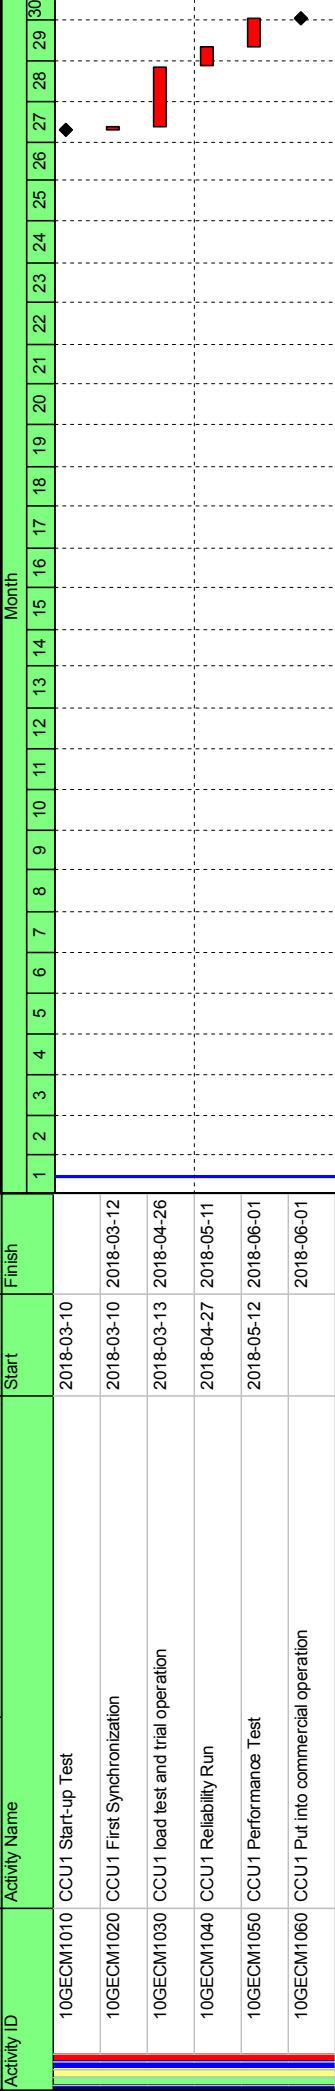

Appendix E

Project Plan (and plans for construction laydown areas)

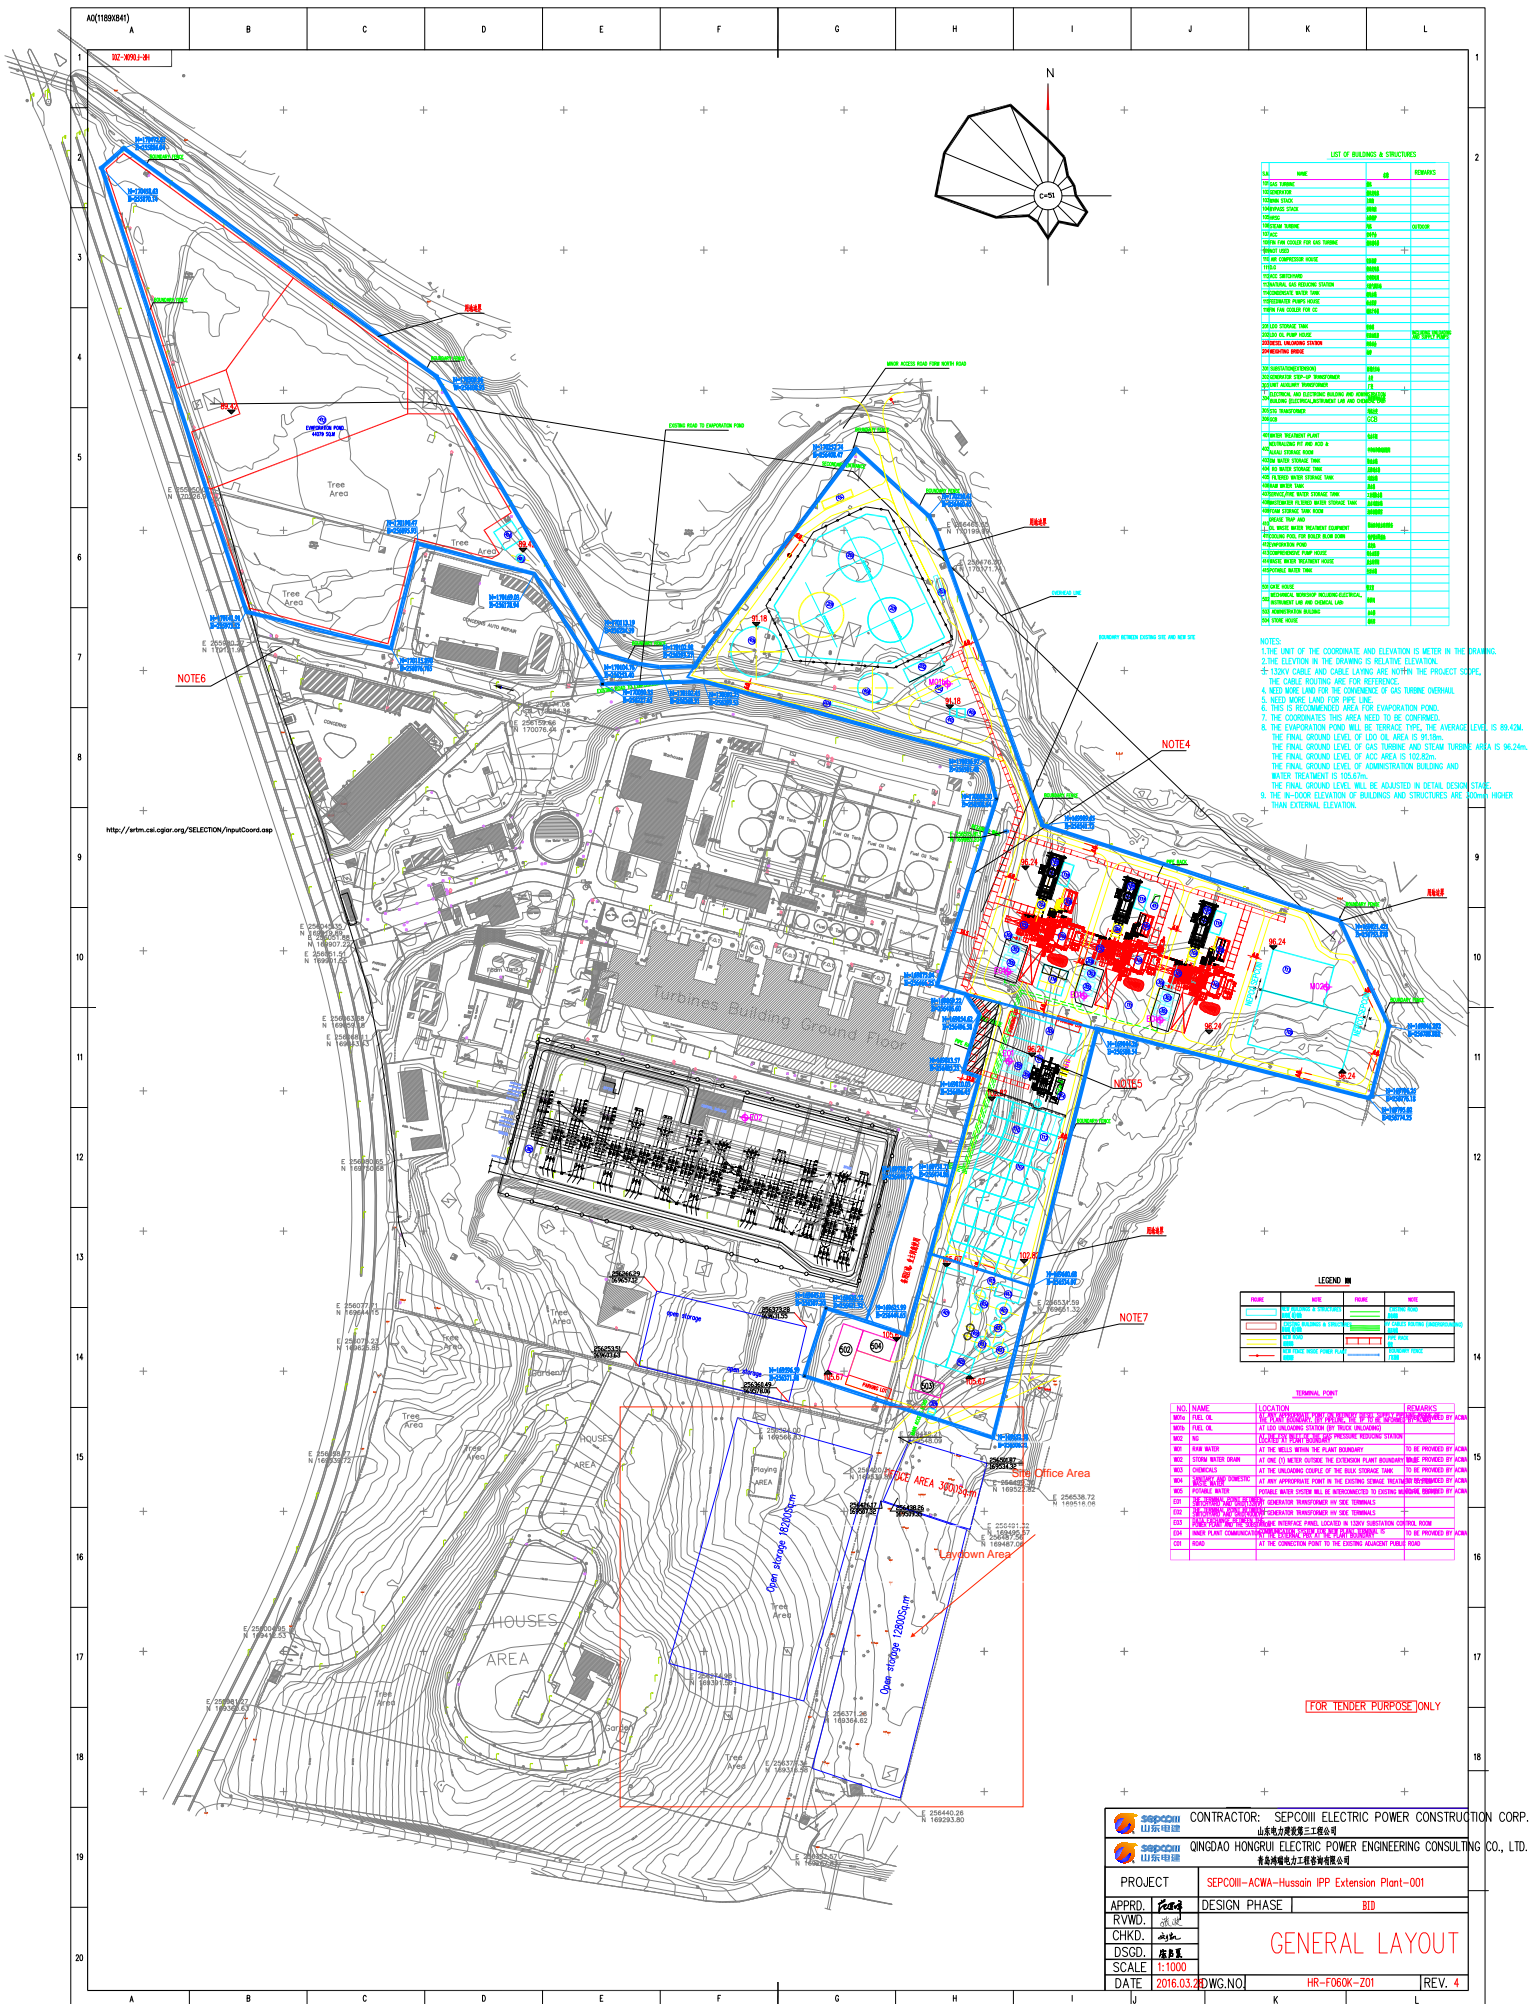

LIST OF BUILDINGS & STRUCTURES			
NO.	NAME	AREA	REMARKS
1	1-1 TURBINES BUILDING	10000.00	
2	2-1 TURBINES BUILDING	10000.00	
3	3-1 TURBINES BUILDING	10000.00	
4	4-1 TURBINES BUILDING	10000.00	
5	5-1 TURBINES BUILDING	10000.00	
6	6-1 TURBINES BUILDING	10000.00	
7	7-1 TURBINES BUILDING	10000.00	
8	8-1 TURBINES BUILDING	10000.00	
9	9-1 TURBINES BUILDING	10000.00	
10	10-1 TURBINES BUILDING	10000.00	
11	11-1 TURBINES BUILDING	10000.00	
12	12-1 TURBINES BUILDING	10000.00	
13	13-1 TURBINES BUILDING	10000.00	
14	14-1 TURBINES BUILDING	10000.00	
15	15-1 TURBINES BUILDING	10000.00	
16	16-1 TURBINES BUILDING	10000.00	
17	17-1 TURBINES BUILDING	10000.00	
18	18-1 TURBINES BUILDING	10000.00	
19	19-1 TURBINES BUILDING	10000.00	
20	20-1 TURBINES BUILDING	10000.00	

NOTES:
1. THE UNIT OF THE COORDINATE AND ELEVATION IS METER IN THE DRAWING.
2. THE ELEVATION IN THE DRAWING IS RELATIVE ELEVATION.
3. THE CABLE AND CABLE LAYING ARE WITHIN THE PROJECT SCOPE.
4. THE CABLE ROUTING ARE FOR REFERENCE.
5. THE CABLE ROUTING ARE FOR REFERENCE.
6. THE CABLE ROUTING ARE FOR REFERENCE.
7. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
8. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
9. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
10. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
11. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
12. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
13. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
14. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
15. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
16. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
17. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
18. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
19. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.
20. THE COORDINATES THIS AREA NEED TO BE CONFIRMED.


NO.	NAME	AREA	REMARKS
1	1-1 TURBINES BUILDING	10000.00	
2	2-1 TURBINES BUILDING	10000.00	
3	3-1 TURBINES BUILDING	10000.00	
4	4-1 TURBINES BUILDING	10000.00	
5	5-1 TURBINES BUILDING	10000.00	
6	6-1 TURBINES BUILDING	10000.00	
7	7-1 TURBINES BUILDING	10000.00	
8	8-1 TURBINES BUILDING	10000.00	
9	9-1 TURBINES BUILDING	10000.00	
10	10-1 TURBINES BUILDING	10000.00	
11	11-1 TURBINES BUILDING	10000.00	
12	12-1 TURBINES BUILDING	10000.00	
13	13-1 TURBINES BUILDING	10000.00	
14	14-1 TURBINES BUILDING	10000.00	
15	15-1 TURBINES BUILDING	10000.00	
16	16-1 TURBINES BUILDING	10000.00	
17	17-1 TURBINES BUILDING	10000.00	
18	18-1 TURBINES BUILDING	10000.00	
19	19-1 TURBINES BUILDING	10000.00	
20	20-1 TURBINES BUILDING	10000.00	

NO.	NAME	LOCATION	REMARKS
1	1-1 TURBINES BUILDING	10000.00	
2	2-1 TURBINES BUILDING	10000.00	
3	3-1 TURBINES BUILDING	10000.00	
4	4-1 TURBINES BUILDING	10000.00	
5	5-1 TURBINES BUILDING	10000.00	
6	6-1 TURBINES BUILDING	10000.00	
7	7-1 TURBINES BUILDING	10000.00	
8	8-1 TURBINES BUILDING	10000.00	
9	9-1 TURBINES BUILDING	10000.00	
10	10-1 TURBINES BUILDING	10000.00	
11	11-1 TURBINES BUILDING	10000.00	
12	12-1 TURBINES BUILDING	10000.00	
13	13-1 TURBINES BUILDING	10000.00	
14	14-1 TURBINES BUILDING	10000.00	
15	15-1 TURBINES BUILDING	10000.00	
16	16-1 TURBINES BUILDING	10000.00	
17	17-1 TURBINES BUILDING	10000.00	
18	18-1 TURBINES BUILDING	10000.00	
19	19-1 TURBINES BUILDING	10000.00	
20	20-1 TURBINES BUILDING	10000.00	

FOR TENDER PURPOSE ONLY

CONTRACTOR: SEPCCOII ELECTRIC POWER CONSTRUCTION CORP.	
QINGDAO HONGRUI ELECTRIC POWER ENGINEERING CONSULTING CO., LTD.	
青島鴻瑞電力工程設計有限公司	
PROJECT SEPCCOII-ACWA-Hussain IPP Extension Plant-001	
DESIGN PHASE BID	
APPROD. [Signature]	
CHKD. [Signature]	
DSGD. [Signature]	
SCALE 1:1000	
DATE 2016.03.01	
DWG.NO. HR-F060K-Z01	
REV. 4	

COORDINATES SCHEDULE									
STATION	NORTHING		STATION	EASTING					
1	2265.91460	1699.14870	25	25006.0610	169839.4000				
2	2265.97420	17008.7000	26	25045.1700	169840.2020				
3	2266.03910	17026.8890	27	25044.1380	169838.7000				
4	2266.10400	17039.3690	28	25017.3500	169820.1000				
5	2266.00710	17028.3000	29	25018.8200	169817.7400				
6	2265.98510	17025.6700	30	25017.8100	169820.1000				
7	2265.12170	17020.1250	31	25017.1160	169737.7200				
8	2265.06410	17016.6410	32	25016.9040	169728.4400				
9	2264.91980	17014.8500	33	25019.2400	169735.2400				
10	2264.94180	17026.6400	34	25009.3300	169716.6400				
11	2264.94370	17028.4600	35	25008.6100	169838.9000				
12	2264.94100	17025.3000	36	25012.6000	169835.4000				
13	2264.88400	17015.5300	37	25011.1000	169728.5000				
14	2265.01320	17012.3200	38	25007.9300	169843.3100				
15	2264.92300	17005.4000	39	25005.7100	170051.1800				
16	2264.93400	16994.1200	40	25003.1800	170050.8200				
17	2264.70720	16974.9300	41	25002.7500	170045.6100				
18	2264.74210	16974.8200	42	25002.7150	170034.6100				
19	2264.74210	16974.8200	43	25010.9300	170338.1100				
20	2264.75200	16974.5310	44	25015.8400	170293.9800				
21	2264.67300	16973.3500	45	25019.3800	1169901.0500				
22	2265.01400	16972.3600	46	25017.3000	1169902.3600				
23	2264.94170	16972.7800	47	25016.3000	1169932.1000				
24	2265.03380	16964.7400	48	25005.0089	1169841.2940				

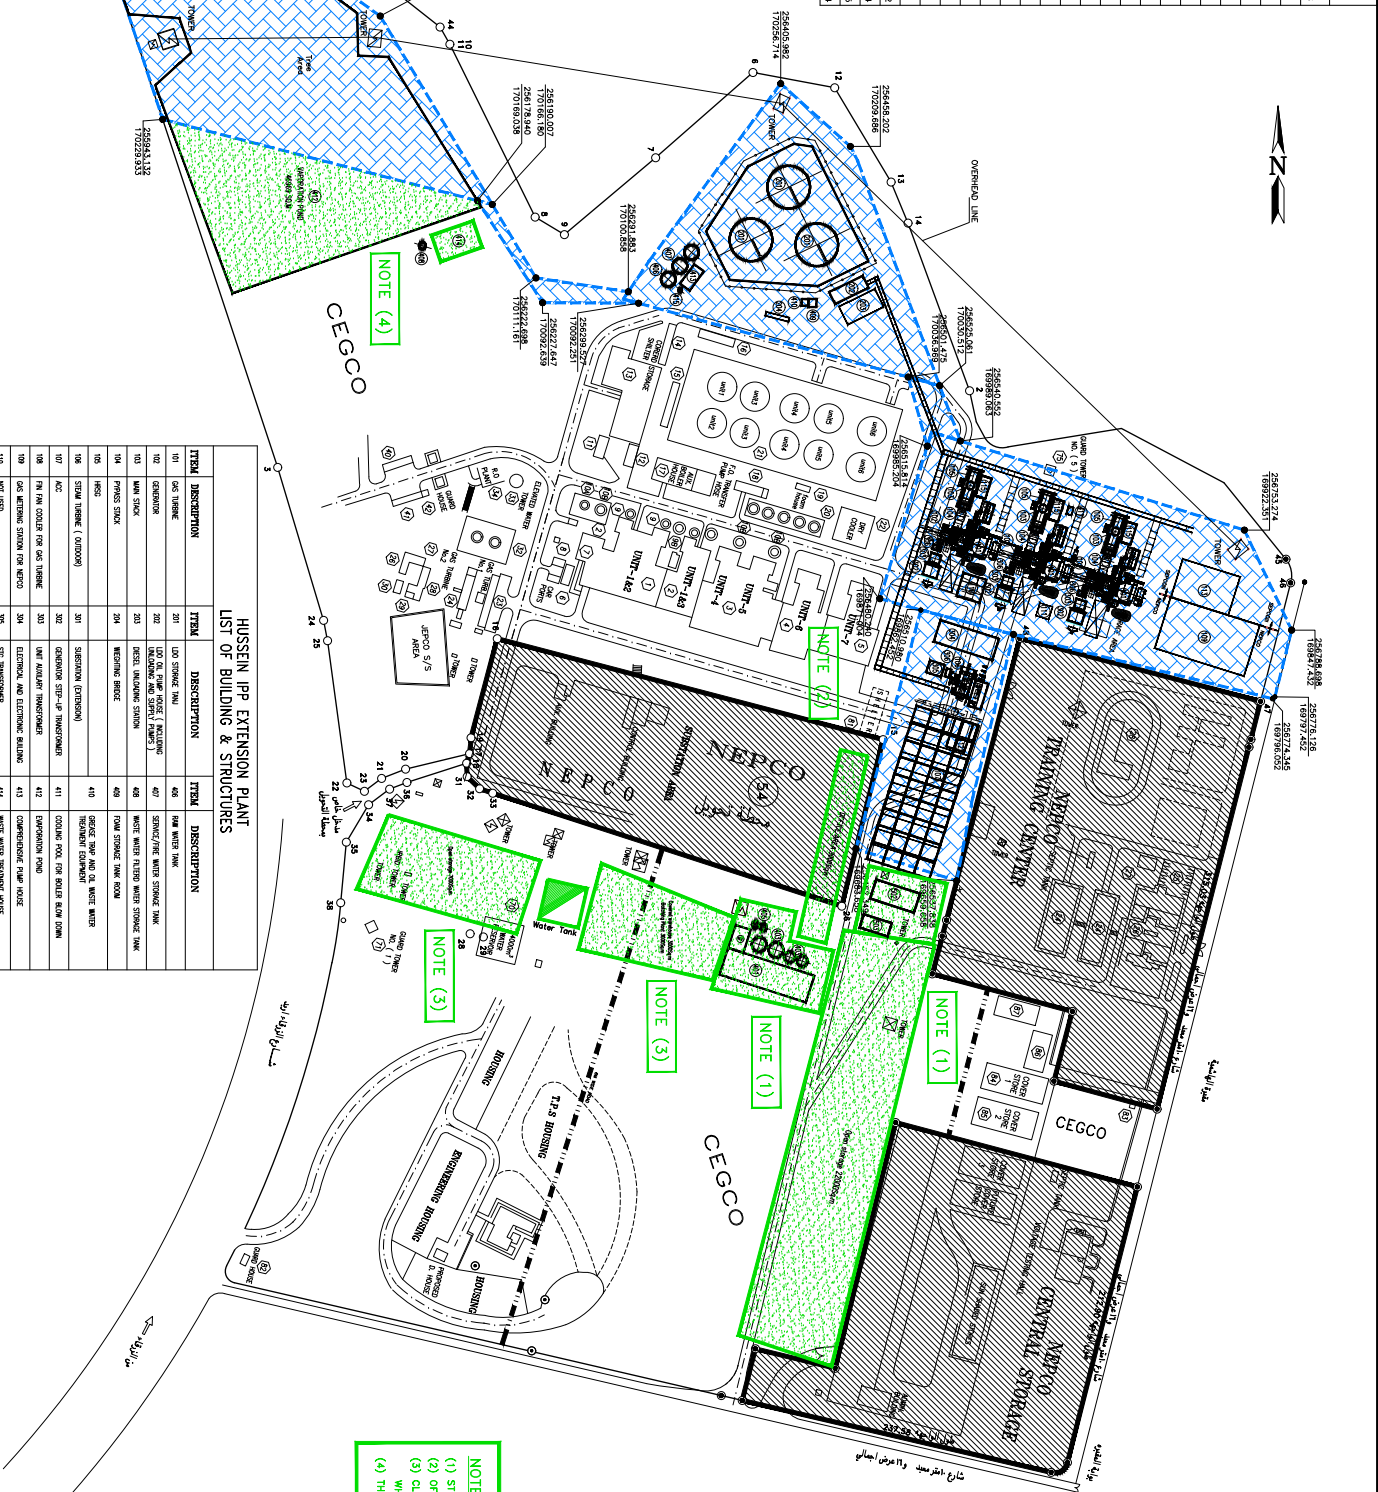

ITEM	DESCRIPTION	ITEM	DESCRIPTION	ITEM	DESCRIPTION
1	THIRING BUILDING UNIT 1A2	1	ELECT. TRANS.	1	OR VEHICLE STORE
2	THIRING BUILDING UNIT 1A3	2	ELEVATOR WITH THERM.	2	UNARMED BUILDING
3	THIRING BUILDING UNIT 1A4	3	GROUND WATER TANK	3	STORE
4	THIRING BUILDING UNIT 1A5	4	ROCKERS ROASTERS	4	PAVED BUILDING
5	THIRING BUILDING UNIT 1A7	5	ACID TANK	5	VEHICLE WORKSHOP
6	LIBRARY BUILDING	6	CONTROL OFF. HOUSE	6	UNARMED BUILDING
7	SCIENCE BUILDING	7	SHELTER	7	OR WATER SEPARATION
8	REF. FARM BUILDING	8	PRESS STAGE	8	OR CLEAN WATER RESERV.
9	CANNERY	9	PAVING STONE	9	OR CLEAN TANK NO. 1
10	FEED TANKS	10	PAVING ROAD	10	OR CLEAN TANK NO. 2
11	PAINTS BUILDING	11	PAVING AREA	11	OR CLEAN TANK NO. 3
12	MAINTENANCE BUILDING	12	PAVING ROAD	12	OR CLEAN TANK NO. 4
13	STORE	13	SCAFFOLD BUILDING	13	OR CLEAN TANK NO. 5
14	MAINTENANCE STORE & WORKSHOP	14	CANAL DRAIN	14	WATER MILL NO. 1
15	SHELTER	15	MAINTENANCE STAGE	15	WATER MILL NO. 2
16	STORE	16	OFFICE & WATER SEPAR.	16	WATER MILL NO. 3
17	WELDING WORKSHOP	17	CONCRETE WATER TANK	17	WATER MILL NO. 4
18	ALUMINUM SHEET BUILDING	18	UNARMED BUILDING	18	WATER MILL NO. 5
19	FEED TANK BUILDING	19	UNARMED BUILDING	19	SHELTER
20	FEED BUILDING	20	UNARMED BUILDING	20	OR CANAL NOZZLE
21	FEED TANK TANKS	21	UNARMED BUILDING	21	OR CANAL NOZZLE
22	WALL TANK TANKS AREA	22	UNARMED BUILDING	22	STORE
23	PER COOLER	23	STORE FOR WORKSHOP	23	STORE
24	ICE BUILDING	24	WORKSHOP	24	SHELTER
25	ICE BUILDING	25	ICEAL COLLECTION	25	PAVED STONE
26	ELECTRICAL MAINTENANCE BUILDING	26	OFFSHORE WORKSHOP		
27	STATISTICS BUILDING	27	PAVING & B. WORKSHOP		
28	MECHANICAL MAINTENANCE & STORE	28	OLD WORKSHOP		
29	WATER STORE	29	STORE FOR WORKSHOP		
30	AN. CONTROL MAINTENANCE	30	ELECTRICAL WORKSHOP		
31	OFFICE OR COLLECTION MAINTENANCE	31	CEMENT TANK AREA		
32	WORKSHOP	32	ORANGE TANK BUILDING		

الأراضي التي تخص شركة الكهرباء الوطنية
الأراضي التي تخص شركة توليد الكهرباء المركزية
الأراضي المؤجرة لمشروع عادة تأهل المصلحة

NOTE :-

- (1) STRUCTURES AND BUILDING LOCATED OUT OF LAND LEASE AREA.
- (2) OFFICE AREA OF 3000sqm LOCATED IN MEFOO AREAS.
- (3) CLOSED WAREHOUSE AND OPEN STORAGE LOCATED WITHIN CEFCO LANDS WHICH NOT INCLUDED IN THE LAND LEASE.
- (4) THIS PART OF EVAPORATION POND OUT OF LAND LEASE.

A	7/7/2016	FIRST ISSUE		
Mr Date		Description	Drawn by	T.A.M.A
Initials			checked	Accepted initials

شركة توليد الكهرباء. المركزية
Central Electricity Generating Co.
(CEGCO)



ZERQA DISTRICT
HUSSEIN THERMAL POWER STATION
HUSSEIN IPP EXTENSION PLANT

مخطط الترس	Tender NO.
A1	
عنوان الترس	Title

LAND LAYOUT

BOUNDARY AND COORDINATE

2-1-21-C1-0002

Appendix F

Scoping Consultation Report

SCOPING SESSION

In accordance with MoEnv's "EIA Regulation No. (37) of the year 2005", a scoping session must be held for those projects which require a comprehensive EIA study; as the case with this Project. Public participation is one of the most important aspects in the Scoping/EIA process as it directly involves the stakeholders whom are expected to be affected by the Project development. In general, the objectives of the scoping session include the following:

- Introduce the Project and its various components to the stakeholders and provide them with all available information at this stage;
- Allow stakeholders to participate in the process of scoping environmental and social impacts of the Project;
- Early consideration of stakeholders concerns and fears regarding the nature and scale of anticipated impacts from the Project; and
- Allow stakeholders to comment on the scope of work and methodology that will be adopted for the EIA study.

In accordance with the above and in coordination with MoEnv, the scoping session for the Project was held on 24 February 2016 at the Le Meridian Hotel in Amman. The list of invitees was identified jointly by the MoEnv and the 'EIA team' taking into account all stakeholder groups which are likely to be affected by the Project directly or indirectly. The list of invitees, list of attendees, and the agenda of the session is presented in Annex I.

Throughout the scoping session, the following presentations were given:

- A welcome speech by **Mr. Imad Daraawi, EIA Engineer from the Ministry of Environment**. Mr. Daraawi started by welcoming the attendees to the scoping session, after which he briefly explained the purpose of the scoping session and stressed on its importance as it aims to take into account the concerns and comments of stakeholders throughout the EIA study.
- A presentation on the Project by **Mr. Maher Tubeishat, Asset Management Executive Manager at CEGCO**. Mr. Tubeishat started by briefly discussing the history of the Hussein Thermal Power Plant, and then he presented in details the Project to include the following: (i) Project's agreements and contractual structure, (ii) Project technology, (iii) Project location and layout, (iv) Project components, (v) Project schedule and duration, and (vi) anticipated job opportunities during the Project's various phases and other social responsibility programs to be implemented.
- A presentation by **Mr. Ibrahim Masri, Consultant from ECO Consult**. Mr. Masri reiterated the objectives of the scoping session and discussed briefly the Project details (location, components and phases) and then moved on to discuss the environmental clearance process for the Project as required by the MoEnv. More specifically, Mr. Masri presented in details the anticipated negative and positive environmental and social impacts during the various Project phases and the methodology that will be adopted throughout the EIA study – this included mainly the methodology for baseline assessment of the various environmental and social receptors as well as the methodology for assessing the various impacts.

There was time for questions and answers following this presentation as well as a facilitated discussion, moderated by Mr. Masri.

Attendees raised and discussed a number of issues and concerns, which are summarized below. Selected photos from the session are shown in Figure 1 below.



Figure 1: Selected Photos from the Scoping Session

SYNTHESIS OF COMMENTS

The 'EIA Team' documented all records of the scoping session to include transcripts, minutes of meetings, list of participants and attendees, comments and so on. In addition, throughout the scoping session a form was distributed to stakeholders to allow them to document any comments or concerns they might have in writing.

The following table presents the main issues raised by the stakeholders throughout the scoping session. The table also highlights how those comments will be incorporated throughout the EIA study. The detailed minutes of meeting and the filled stakeholder forms are presented in Annex I.

Table 1: Main Issues Raised by Stakeholders during the Scoping Session

No.	Parameter	Comment	Response
1.	Air Quality	A stakeholder stated that additional air quality monitoring points should be considered at areas located at a distance from the project site in order to improve the accuracy of the modelling results and pollutant concentrations in such areas (given that all air quality monitoring points are currently located within the Project site and adjacent nearby areas only). In addition, several stakeholders suggested that such data could be available from the Ministry of Environment's continuous air quality monitoring program in the area.	The consultants will coordinate with the Ministry of Environment with the intention of obtaining recorded data of the continuous air quality monitoring being undertaken in the local area. Upon review of such data, and subject to its suitability, the results will be included to the ESIA baseline and used to outline existing background concentrations for the cumulative assessment of the air emissions in the air dispersion model.
2.		A stakeholder stated that there must be a continuous air quality monitoring program during the operation phase of the project to measure stack emissions and which should be coordinated with the Environmental Monitoring Department at the Ministry of Environment.	Continuous Emissions Monitoring Systems (CEMS) will be included on each stack for monitoring during operation. The requirement for this will further be detailed in the ESIA and outline Environmental & Social Management and Monitoring Plan (ESMMP); which will be developed as part of the ESIA. The outline ESMMP will include the monitoring measures to be identified to ensure emissions are within allowable limits.
3.	Noise	A comment was raised on the noise baseline monitoring duration stating that 1 hour of monitoring during daytime and 1 hour of monitoring during night-time is not considered sufficient.	Given that the Project site is not located within or close to any significant sources of variable noise disturbances (such as airports, railways, or variable industrial processes), the actual noise levels within the area is relatively stable. During monitoring the average noise level (Leq(A)) stabilises quickly (e.g. within a minute) and therefore a short term monitoring period can provide representative baseline noise conditions in the project area.
4.	Soil and Groundwater	Some stakeholders inquired about the water requirements of the Project and how will it be supplied and also required that the potential impacts on	The ESIA will include projections of all water requirements in relation to the project, whilst outlining the sources of supply. Water will be supplied via a new pipeline to be constructed by the Water Authority of Jordan. The developer has already

		water resources in the area be studied as part of the ESIA.	signed a water supply agreement with the Water Authority of Jordan, who have guaranteed the supply of 2,450m ³ of water per week. In addition, a back up water supply of 3 deep groundwater wells will be drilled within the site area to a depth of approximately 450m. The ESIA will study and assess the impacts of water supply to the Project, including any expected impacts on water resources and associated infrastructure.
5.		Several comments were raised requiring that the ESIA identify all the waste streams that will be generated from the project (including hazardous waste) and identify the appropriate handling and disposal measures to be implemented.	The ESIA will include an assessment of waste and hazardous waste streams expected to be generated during construction and operation. The outline ESMMP will include a requirement to develop a waste management plan to manage solid waste and hazardous fractions. Wastewater assessment will be included in a separate chapter of the ESIA. The assessment of solid waste will outline the expected type, quantity, and management. This will include appropriate mitigation measures for storage onsite and expected management off-site. Such measures will take into account all the requirements from the Ministry of Environment as stipulated within the various regulations and instruction on management of waste streams.
6.	Community Health, Safety and Security	A stakeholder suggested that the ESIA should identify appropriate measures to prevent urbanisation in areas close to the thermal power plant. This could include for example the acquisition of land areas adjacent to the power plant.	Impacts on community health, safety and security will be discussed and assessed as part of the ESIA, with inclusion of appropriate mitigation measures and monitoring requirements. Specific impacts upon local urbanisation will also be discussed in the ESIA.
7.	Worker Conditions and Occupational Health and Safety	A stakeholder inquired how employees of the existing Hussein TPS will be managed/retained etc. It was suggested that existing employees be included to the ESIA.	The employees of the old HTPS will not be dismissed but will retain their jobs either at the new power plant or other projects of CEGCO. This will be outlined in the ESIA.
8.	Other	A stakeholder indicated that the ESIA should include the associated facilities of the Project such as the gas pipeline	As per the lender requirements an assessment of associated facilities will be included to the ESIA. NEPCO is the responsible entity for developing the detailed design and construction of the gas pipeline connection with the thermal power plant. Water Authority of Jordan

			is responsible for the water pipeline. The ESIA will outline the process to be undertaken by NEPCO and WAJ to ensure compliance of associated facilities with national and lender requirements.
9.		The ESIA should include an Environmental Emergency Response Plan to detail procedures for dealing and handling of any environmental emergency which might occur at the Project site	The requirement for a site specific Emergency Preparedness and Response Plan will be included in Volume 3 of the ESIA (Outline ESMMP) for development by the EPC Contactor during construction and the O&M Company during operation.

**APPENDIX I – SCOPING SESSION INVITEES, ATTENDEES, AGENDA
AND MINUTES OF MEETING**

LIST OF INVITEES

No.	Key Stakeholders
National Governmental Agencies	
1	Ministry of Environment (MoEnv)
2	Ministry of Water and Irrigation (MWI)
3	Ministry of Agriculture (MoA)
4	Ministry of Labour (MoL)
5	Ministry of Tourism and Antiquities (MoTA)
6	Ministry of Industry and Trade (MoIT)
7	Jordan Institute for Standards and Metrology (JISM)
8	Department of Lands and Survey (DLS)
9	Energy and Minerals Regulatory Commission (EMRC)
10	Public Security Directorate (PSD)
11	Civil Defense Directorate (CDD)
12	Traffic Department
13	Royal Department for Environment Protection (Rangers)
14	Jordan Atomic Energy Commission (JAEC)
15	Jordan Industrial Estates Company (JIEC)
16	Jordan Engineers Association (JEA)
17	Greater Amman Municipality (GAM)
Local Governmental Agencies	
18	Al Zarqa Governorate
19	Al Zarqa Municipality
20	Al Hashimeyeh Municipality
21	Zarqa Environmental Directorate
Research and Academic Institutions	
22	Hashemite University
Non-Governmental Organizations	
23	Jordanian Hashemite Fund for Human Development (JOHUD)
24	Environmental Societies Association – the society represents all environmental NGO's in Jordan – RSCN, JES, NEWS, etc. An invitation is issued by the MoEnv to the Association who in turn invites all environmental NGO's to the scoping session.
Local Community Representatives	
25	This mainly includes members of the Municipal Council which are elected as representatives of the local community (and includes both males and females). This includes the following: Ms. Fatima Jammal; Ms. Buthayna Al-Hindawi; Ms. Jamilah Al-Mashaqbeh; Mr. Khaled Zyoud; and Mr. Abdelraheem Al-Omoush.
Private Sector	
26	Jordan Petroleum Refinery Co.
27	Samra Wastewater Treatment Plant Co

LIST OF ATTENDEES

No.	Entity	Name	Position
National Governmental Agencies			
1	Ministry of Environment	Ali Almashni	Head of Environmental Monitoring Department
2		Noura Alshraa	Chemical Researcher
3		Hussein AlSharabati	Agricultural Engineer
4		Ahlam AlDumour	Legal Expert
5		Emad Al-Darawi	EIA Engineer
6		Aseel Jaloudi	Intern
7	Ministry of Water and Irrigation	Saleh AlOran	Head of Environment and Climate Department
8		Wafa’a Shehadeh	Head of Energy Efficiency Department
9		Ayman Jaber	Head of Service Department
10	Ministry of Agriculture	Lama Abu Hassan	Agricultural Engineer
11	Ministry of Energy and Natural Resources	Ali Khawaldeh	Engineer
12		Sama’an Makhamreh	Head of Electricity Generation Department
13	Greater Amman Municipality	Manal Mohamad	Agricultural Engineer
14		Rasha Abu Hamour	Environmental Engineer
15	Traffic Department	Hana Nsour	Planning Engineer
16	Energy and Minerals Regulatory Commission	Ayman Quraan	Engineer
17		Khaled Moumani	Geological Expert
18	Royal Department for Environment Protection (Rangers)	Ra’afat Walid	Officer
19	Civil Defense Directorate	Mohammed Basheer	Department Head
20	Department of Lands and Survey	Ghaleb Mahmoud	General Director Advisor
21	Ministry of Municipal Affairs	Asmaa Ghzawi	Head of Environmental Department
Local Governmental Agencies			
22	Al Zarqa Governorate	Ghazi Shbeilat	Assistant to the Mayor of Zarqa Governorate
23	Zarqa Environmental Directorate	Inam Joude	Head of Directorate
Research and Academic Institutions			
24	Hashemite University	Ali Alnaqa	Hydrology Professor
Non-Governmental Organizations			
25	RSCN	Rasha Haymour	Conservation Planner
26	National Environment and Wildlife Society	Naser AlJuneidi	N/A
Private Sector			
27	Jordan Petroleum Refinery Co.	Khaled Alqasem	Process Engineer
28		Khaled Noubani	Safety Engineer
Other			
29	CEGCO	Maher Tubaishat	Director
30		Faisal Hamed	Head of Environment and Safety Department
31	5 Capitals	Ken Wade	Director
32	ECO Consult	Ibrahim Masri	Consultant
33		Lamees Hayary	Analyst

AGENDA

Hussein Thermal Power Station Repowering Project Environmental Impact Assessment

Scoping Session Agenda 24 February 2016 – Le Meridian Hotel, Amman

10:00 – 10:15	Registration
10:15 – 10:20	Welcoming Speech <i>Ministry of Environment</i>
10:20 – 11:00	Project Concept and Components <i>Central Electricity Generating Company (CEGCO)</i>
11:00 – 11:30	Discussion on Project Concept and Components <i>Facilitated by Central Electricity Generating Company (CEGCO)</i>
11:30 – 12:00	Coffee Break
12:00 – 12:45	EIA and Potential Environmental Impacts of the Project <i>ECO Consult</i>
12:45 – 13:30	Discussion on EIA and Potential Environmental Impacts <i>Facilitated by ECO Consult</i>
13:30 – 14:30	Lunch Break

مشروع إعادة تأهيل محطة الحسين الحرارية لتوليد الكهرباء دراسة تقييم الأثر البيئي

برنامج الحلقة التشاورية
24 شباط 2016 - فندق المريديان عمان

تسجيل المشاركين	10:15 - 10:00
كلمة ترحيبية وزارة البيئة	10:20 - 10:15
شرح مفهوم ومكونات المشروع شركة توليد الكهرباء المركزية (CEGCO)	11:00 - 10:20
نقاشات وأسئلة المشاركين حول مفهوم ومكونات المشروع ادارة الجلسة من قبل شركة توليد الكهرباء المركزية (CEGCO)	11:30 - 11:00
استراحة قهوة	12:00 - 11:30
عرض دراسة تقييم الأثر البيئي والتأثيرات المحتملة للمشروع ECO Consult	12:45 - 12:00
نقاشات وأسئلة المشاركين حول دراسة تقييم الأثر البيئي ادارة الجلسة من قبل ECO Consult	13:30 - 12:45
استراحة غداء	14:30 - 13:30

DETAILED MINUTES OF MEETING OF THE SCOPING SESSION

1. Welcoming Speech – Mr. Imad Daraawi, EIA Engineer, Ministry of Environment

Mr. Daraawi started by welcoming the attendees to the scoping session, after which he briefly explained the purpose of the scoping session and stressed on its importance as it aims to take into account the concerns and comments of stakeholders throughout the EIA study.

2. Project Concept and Components – Mr. Maher Tubeishat, CEGCO Director

Mr. Tubeishat started by briefly discussing the history of the Hussein Thermal Power Plant, and then he presented in details the Project to include the following: (i) Project's agreements and contractual structure, (ii) Project technology, (iii) Project location and layout, (iv) Project components, (v) Project schedule and duration, and (vi) anticipated job opportunities during the Project's various phases and other social responsibility programs to be implemented.

After the presentation there was time for questions regarding the project. The main questions are summarized in the table below.

A. Project Description

1	<p>Mr. Saleh Oran – Ministry of Water and Irrigation Why weren't other alternatives considered for generating electricity instead of a thermal power plant such as renewable energy?</p> <p>Mr. Maher Tubeishat – CEGCO An important decisive factor in relation to this is the land area available for generating electricity at a capacity of 485MW. Renewable energy such as solar PV or wind in general requires large land areas, especially if we take into account the production capacity required. For example, a solar PV project requires around 18-25 Dunums for the generation of 1MW. The land area available at the project site is definitely not sufficient for the development of 485MW of electricity through renewable energy sources. In addition, the Ministry of Energy and Mineral Resources has defined optimal areas in Jordan for the development of solar and wind energy projects, and the project site is not located within such areas.</p> <p>Mr. Ibrahim Masri – ECO Consult I would also like to add that the Master Strategy of Energy Sector prepared by the Ministry of Energy discusses the need to diversify energy resources and increase the share of renewable energy to 7% in 2015 and 10% in 2020. The Master Strategy of Energy Sector understands the importance of inclusion of renewable energy within the energy mix but also understands its limitation. Not all the electricity needs of Jordan can be met by renewable energy sources and therefore there has to be a combination of electricity generation sources which also includes thermal power plants which is considered crucial for meeting base load demands in Jordan. Renewable energy sources such as solar and wind are not available all the time throughout the day as opposed to thermal power plants which can consistently generate electrical power needed to meet base load demands.</p>
2	<p>Mr. Emad Al-Darawi – Ministry of Environment It is understood that the old thermal power plant will be decommissioned. How will you handle the decommissioned parts and will you be benefit from such decommissioned materials for the new thermal power station?</p> <p>Mr. Maher Tubeishat – CEGCO Due to the old age of the thermal power plant, the decommissioned parts cannot and will not be used for the new project. Decommissioned parts will be sold as scrap through a tendering process to be issued at a later stage.</p>
3	<p>Mr. Khaled Moumani - Energy and Minerals Regulatory Commission What is the duration of the operation phase of the Project?</p> <p>Mr. Maher Tubeishat – CEGCO As discussed throughout the presentation, based on the PPA signed between NEPCO and the developer the project will be operational for 25 years.</p>
4	<p>Mr. Khaled Noubani – Jordan Petroleum Refinery Co. Within the design of the power plant, did you consider the utilization of air preheaters?</p>

Mr. Maher Tubeishat – CEGCO

The combined cycle technology incorporates air preheating. This technology has been chosen as it ensures the lowest heat rate and minimal combustion. This has been studied based on a heat mass balance diagram.

3. Environmental and Social Impact Assessment - Mr. Ibrahim Masri, Consultant at ECO Consult

Mr. Masri reiterated the objectives of the scoping session and discussed briefly the Project details (location, components and phases) and then moved on to discuss the environmental clearance process for the Project as required by the MoEnv. More specifically, Mr. Masri presented in details the anticipated negative and positive environmental and social impacts during the various Project phases and the methodology that will be adopted throughout the EIA study – this included mainly the methodology for baseline assessment of the various environmental and social receptors as well as the methodology for assessing the various impacts.

There was time for questions and answers following this presentation as well as a facilitated discussion moderated by Mr. Masri. The main issues raised during the session are summarized below according to the environmental/social attribute they relate to.

A. Air Quality

1	<p>Mr. Khaled Noubani – Jordan Petroleum Refinery Co.</p> <p>With regards to the selection of the 6 air quality monitoring points, were certain standards, regulations or guidelines followed in the selection process?</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>There are no specific guidelines, standards or regulations that detail the number of monitoring points that should be selected for a baseline study or where they should be selected. Monitoring points are selected based on the detailed understanding of the site and which is usually determined on a case by case basis. Many factors should be taken into account when selecting the number of monitoring points and their location to include location of nearby receptors (such as community settlements such as Al Hashimeyeh in the case of the project), nearby polluting sources (such as the refinery in the case of the project), topography of the site, meteorological conditions in the area such as wind direction, expected impacts from the project, etc. All such factors were taken into account for the selection of the 6 monitoring points as part of the air quality monitoring program.</p>
2	<p>Mr. Ali Naqah – Hashemite University</p> <p>I believe that the 6 monitoring points selected for baseline measurements will be insufficient for the statistical analysis that will be undertaken as part of the air emission dispersion model that will determine the emissions concentration and dispersion in the area. This is especially true in other areas located at a distance from the power plant where no baseline monitoring points have been selected. How will the model be able to determine concentrations in such areas where there are no baseline measurements? This will lead to lower accuracy and estimations of pollutants. For improved accuracy, additional monitoring points must be considered at a distance from the project site.</p> <p>Ms. Inam Joudeh – Zarqa Environmental Directorate</p> <p>The Ministry of Environment along with the Royal Scientific Society (RSS) have set a continuous air quality monitoring program at several locations in the area which takes into account emissions from the old HTPS, the refinery and As-Samra WWTP. The results of such a monitoring program could be taken into account as part of the model to improve the accuracy of the modeling results.</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>As stated earlier, the selection of the monitoring points has been based on several factors and focused on those areas where the greatest impacts on air quality are expected. At further distances from the project site (5-10km) the impact is expected to decrease significantly but nevertheless the modeling program will assess the impact in such areas based on estimations on baseline conditions. However, your comment will be taken into account and we will coordinate with the MoEnv to obtain the results of the continuous air quality monitoring program undertaken in the area to improve the accuracy of the modelling results.</p>

3	<p>Mr. Emad Al-Darawi – Ministry of Environment</p> <p>There must be a continuous air quality monitoring program during the operation phase of the project to measure stack emissions. It is recommended that this program be coordinated with the Environmental Monitoring Department at the Ministry of Environment.</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>As part of the EIA an Environmental Management Plan (EMP) is developed which identifies the mitigation and monitoring requirements that must be implemented during the construction and operation phase. Such an air quality monitoring program will be considered and taken into account, but this will be determined at a later stage during the EIA study and will depend on the results of the impact assessment.</p>
---	--

B. Noise

1	<p>Mr. Emad Al-Darawi – Ministry of Environment</p> <p>You stated in the presentation that there will be 6 monitoring points for noise within the Project area and its surroundings which will measure noise levels during day and night. What will be the monitoring duration at each location?</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>The monitoring will be undertaken for 1 hour during daytime and 1 hour during night-time at each monitoring point. Based on previous experiences, such duration is considered to be sufficient and representative of baseline conditions given that there are no significant sources of noise disturbances in the area which could significantly affect baseline measurements.</p> <p>Mr. Emad Al-Darawi – Ministry of Environment</p> <p>I believe noise monitoring should be conducted for a longer duration so that the results provide a more accurate representation of noise levels in the area. 1 hour of monitoring during daytime and 1 hour during night-time is not considered sufficient.</p> <p>Mr. Ken Wade – 5Capitals</p> <p>This issue has been studied and from our previous experiences in undertaking noise baseline measurements, 1 hour of monitoring during daytime and 1 hour of monitoring during night-time is considered sufficient to reflect noise levels within the area, especially that project site is not located close to airports or a busy highway or any other disturbing sources of noise. Taking that into account the actual noise levels would usually stabilize quickly, after the first ten minutes of monitoring.</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>In addition, within the scoping report that will be submitted to the Ministry of Environment a detailed justification will be provided on why such a monitoring duration has been decided. As you know such a scoping report will be submitted to the Ministry of Environment for review, and should the Ministry still conclude that such duration is not representative of the actual conditions and require a longer monitoring period then this will be taken into account.</p>
---	--

C. Soil and Groundwater

1	<p>Mr. Khaled Noubani – Jordan Petroleum Refinery Co.</p> <p>It is known that the Zarqa area has scarce water resources while on the other hand the Project is expected to require significant amounts of water. How will water be supplied for the project? And what are the expected impacts from such water requirements on the water supply in the area?</p> <p>Mr. Maher Tubeishat – CEGCO</p> <p>There are two options for water supply to the project. This will include a dedicated pipeline network from the Water Authority of Jordan (WAJ) whom the developer has already signed a water supply agreement with which it will provide 2,450m³/week (350m³/day) – while the project requirements are estimated at this stage at 100m³/day (this will be confirmed at a later stage) AND/OR the second alternative will include 3 deep groundwater wells within the</p>
---	--

	<p>site. It is important to note that within the existing HTPS are currently 9 water wells but those will not be utilized given that the water quality is not suitable as the Total Dissolved Solid (TDS) is too high.</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>I would also like to bring to your attention that the EIA will also study the potential impacts from the water requirements of the project on the local water resources in the area. The results of this study will be included within the EIA that will be submitted to the Ministry of Environment.</p> <p>Mr. Ali Almashani - Ministry of Environment</p> <p>Which is the better alternative, for water to be supplied through a pipeline from WAJ or through the 3 new deep water wells?</p> <p>Mr. Maher Tubeishat – CEGCO</p> <p>This has been thoroughly studied with WAJ, and it was found that the supply through a pipeline from WAJ is the best alternative, and hence an agreement has been signed. The 3 new water wells will be utilized in cases of emergency and during situations where WAJ cannot supply the required amount of water. In addition, the study concluded that the existing old wells within the HTPS cannot be used given that the water quality is not suitable as the Total Dissolved Solid (TDS) is too high and that is why 3 new water wells will be utilized for abstraction, which run deeper than the existing ones and have a lower TDS value.</p> <p>Mr. Khaled Moumani – Hashemite University</p> <p>The old wells lie within the Amman-Wadi Sir basin that is 50 – 60 meters deep with a TDS value of more than 3,000 mg/l. The newer well will run deeper and reach the A4 layer with a TDS value between 1000 – 1400 mg/l.</p> <p>Mr. Khaled Noubani – Jordan Petroleum Refinery Co.</p> <p>Will a Reverse Osmosis Unit be required if the water will be extracted from the deep wells?</p> <p>Mr. Maher Tubeishat – CEGCO</p> <p>Since salinity levels in these new well are much lower especially when compared to the existing wells, a Reverse Osmosis will not be required.</p>
2	<p>Mr. Hussein Sharbati – Ministry of Environment</p> <p>The EIA must identify all waste streams that will be generated from the project and their estimated quantities. In addition, the EIA must also explain whether the evaporation ponds will be lined or not. Finally, the EIA must also ensure that the storage tanks for the fuels are bunded taking into account 110% of their storage capacity.</p> <p>Ms. Noura Alsharei – Ministry of Environment</p> <p>The EIA must detail how hazardous waste will be managed and disposed in a safe way with appropriate coordination with the Ministry of Environment.</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>All those comments will be taken into account. The EIA will develop a detailed waste management plan which will identify the types of wastes expected, nature, quantities and the appropriate measures for their storage onsite and their final disposal. The plan will take into account all the requirements from the Ministry of Environment as stipulated within the various regulations and instruction on management of waste streams.</p>

D. Community Health, Safety and Security

1	<p>Mr. Ghaleb Ahmad – Department of Land and Survey</p> <p>Will the Developer adopt any compensation measures to the local community for any environmental pollution incidents, such as air pollution?</p> <p>Mr. Ibrahim Masri – ECO Consult</p> <p>The EIA will identify and study all potential impacts from the Project on the local community and assign the appropriate mitigation and monitoring measures to be implemented throughout the project's construction and operation phase to ensure that such impacts are eliminated or reduced to acceptable levels. Nevertheless, taking the above into account, in the highly unlikely event that the Developer is responsible on his own for any unacceptable environmental pollution, then the developer will be committed to compensation towards the local communities which in any case is required as part of the laws and regulations of Jordan.</p> <p>Mr. Faisal Hamed – CEGCO</p>
---	--

	It should be noted that in comparison to the old thermal power plant the air quality will to some extent be improved given that emissions will be severely reduced as the new power plant will run on natural gas as opposed to the old plant which ran on heavy fuel oil. Moreover, the company will follow an integrated and strict environmental, health and safety management system to ensure compliance with all environmental requirements.
2	Mr. Khaled Moumani - Energy and Minerals Regulatory Commission (EMRC) Since the project will be operational for 25 years, the concept of urbanization of Al-Hashimeyeh and Al-Zarqa should be taken into account and appropriate measures should be set to prevent urbanization in areas close to the thermal power plant. This could include for example the acquisition of land areas adjacent to the power plant to prevent any new community settlements close to the Project.

E. Worker Conditions and Occupational Health and Safety

1	Mr. Sama'an Makhamreh – Ministry of Energy What will happen to the old employees of the HTPS? Will they be dismissed? This issue must be investigated as part of the EIA. Mr. Maher Tubeishat – CEGCO The employees of the old HTPS will not be dismissed but will retain their jobs either at the new power plant or other projects of CEGCO. There has been a clause defined with the Ministry of Energy that addresses this issue and states that arbitrary dismissal is forbidden. A work package will be offered to the employees, whom have the right to either accept or refuse the offered package. This will all be coordinated with the Ministry at a later stage. For example, at this stage 12 of the employees at the old HTPS have been transferred to work in the Aqaba Thermal Power Plant. In addition, the new power plant is expected to provide 100 new job opportunities.
----------	---

F. Other

1	Mr. Emad Al-Darawi – Ministry of Environment Will the EIA study cover the associated facilities of the project such as the pipeline route from the main gas pipeline to the project site? Mr. Maher Tubeishat – CEGCO The main pipeline with which this project will connect is located 900 -1000 meters east of the station and will be included in the EIA study. Mr. Ghaleb Ahmad – Department of Land and Survey With regards to the pipeline, will any land acquisition occur? Mr. Ibrahim Masri – ECO Consult At this point, the final detailed design of the pipeline has not been developed. At a later stage, when the design is finalized, the exact uses of these lands and their ownership (private or public) will be determined and should any acquisition be required it is expected that it will be undertaken in accordance with the laws and regulations of Jordan – mainly the Land Acquisition Law No. (12) of the year 1987 which sets in details the land acquisition process in relation to advertisements, compensation, grievances, etc. Anyways, as stated earlier this issue will be investigated as part of the EIA study as well. Mr. Maher Tubeishat – CEGCO It is important to note that the design and construction of the pipeline is the responsibility of NEPCO. Similarly, any land acquisition and compensation requirements will be undertaken by NEPCO and the relevant governmental entities such as the Ministry of Energy and the Department of Lands and Survey.
2	Mr. Hussein Sharbati – Ministry of Environment The EIA must include an Environmental Emergency Response Plan which details procedures for dealing and handling of any environmental emergency which might occur at the Project site.



الرقم ١٢٨٩/٧/٤
التاريخ
الموافق ٢٠١٦/١٢/٢٧

السادة

الموضوع : الحلقة التشاركية الخاصة بدراسة تقييم الأثر البيئي لمشروع توسعة محطة الحسين الحرارية
الحالية في محافظة الزرقاء

تحية طيبة وبعد ،،

أرجو التكرم بالإيعاز لأحد مندوبيكم بحضور الحلقة التشاركية الخاصة بالمشروع المقترح أعلاه والتي ستعقد في تمام الساعة العاشرة من صباح يوم الاربعاء الموافق 2016/2/24 في فندق الميرديان/عمان.

وتفضلوا بقبول فائق الاحترام ،،،

الدكتور طاهر راضي الشخشير

وزير البيئة

المهندس أحمد القطارنة

الأمين العام

2. موقع المشروع

يقع المشروع في محافظة الزرقاء شمال الأردن، على بعد حوالي 25 كم من العاصمة عمان. ويقع بالتحديد ضمن المنطقة الصناعية التي تبعد مسافة 4 كم إلى الشمال الشرقي من مدينة الزرقاء (التي تعتبر مركز المحافظة)، وإلى الشمال من الموقع تقع مدينة الهاشمية. كما تقع شركة مصفاة البترول الأردنية غرب الموقع. وسيتم إنشاء المشروع بالكامل في الموقع الحالي لمحطة الحسين الحرارية كما هو مبين في الشكل 1 أدناه.



الشكل 1: موقع المشروع

3. مكدونات المشروع

فيما يلي وصف لمكونات المشروع الرئيسية:

- 3 توربينات مولدة للطاقة الكهربائية توليد توليد الكهرباء مباشرة عن طريق حرق الغاز الطبيعي؛
- 3 مولدات بخار تقوم باسترداد الحرارة الناتجة من التوربينات المولدة للكهرباء في تحويل المياه إلى بخار؛
- توربين بخاري واحد، يتم من خلاله استخدام البخار الناتج من مولدات البخار لتوليد طاقة كهربائية إضافية في دورة التشغيل المركبة؛
- مكثفات تبريد بالهواء لغايات تبريد البخار الناتج من التوربين البخاري؛
- خزانات لوقود الديزل؛ ويعتبر الغاز الطبيعي هو الوقود الأساسي المستخدم لتوليد الطاقة، بينما يستخدم الديزل كوقود احتياطي في الحالات الطارئة؛
- محطة استقبال الغاز التي تقوم بنقل الغاز الطبيعي من خط الغاز الرئيسي (الذي يقع خارج موقع المشروع إلى شرق) إلى المحطة؛

دراسة تقييم الأثر البيئي

مشروع محطة الحسين الحرارية



- المشروع: مشروع محطة الحسين الحرارية
- المطور: شركة ACWA Power
- المالك: شركة محطة الزرقاء لتوليد الطاقة الكهربائية بالهيدرو
- المقاول للهندسة والتوريد والإنشاء: SEPCO III
- التشغيل والصيانة: شركة توليد الكهرباء المركزية CEGCO
- المستشار البيئي: شركة ECO Consult و 5 Capitals

1. المقدمة

تقدمت شركة ACWA Power باقتراح لإنشاء محطة حرارية جديدة تعمل على الغاز الطبيعي بقدرة 485 ميغا واط في موقع محطة الحسين الحرارية في محافظة الزرقاء. وسيتم تزويد شركة الكهرباء الوطنية بالطاقة المولدة من المحطة الجديدة بموجب اتفاقية شراء الطاقة لمدة 25 عام.

تأتي أهمية هذا المشروع نتيجة إغلاق محطة الحسين الحرارية الحالية في كانون الأول من عام 2015، بالإضافة إلى التزايد المستمر في الطلب على الطاقة الكهربائية في الأردن. وسيقوم المشروع المقترح بتوفير مصدر نظيف نسبياً للطاقة بكفاءة تشغيلية عالية مقارنة بمحطة الحسين الحرارية التي تم إغلاقها.

- توفير مصدر نظيف للطاقة مقارنة بالمحطة الحرارية السابقة التي كانت تستخدم الوقود الثقيل، والتي كانت تعمل بقدرة إنتاجية منخفضة مقارنة بالمشروع المقترح.
 - تخفيض كبير في انبعاثات غازات الدفيئة وانبعاثات التلوث مقارنة بالمحطة السابقة.
 - توفير فرص عمل للمجتمع المحلي مما سيؤدي إلى تحسين الوضع الاقتصادي للمجتمع المحلي.
- من المتوقع أن تكون هنالك آثار سلبية للمشروع، ولكن من المهم الإشارة إلى أن هذه الآثار السلبية ستكون أقل بكثير مما كانت عليه في المحطة السابقة ، وسيتم وضع إجراءات احترازية لرصد وتخفيف هذه الآثار.
- وقد يملأ ملخص الآثار المتوقعة الناجمة عن المشروع في مراحله المختلفة:

ملخص الآثار المتوقعة الناجمة عن المشروع خلال مرحلة التخطيط والإنشاء	
المجال	الآثار المحتملة للمشروع
التربة والمياه الجوفية	مخاطر طفيفة لتلوث التربة والمياه الجوفية بسبب الأنشطة الإنشائية والتي قد تشمل الإجراءات غير السليمة للتخفيف وترتيب الموقع، مثل الطرح العشوائي للمخلفات والمياه العادمة.
التنوع الحيوي (النباتي والحيواني)	مخاطر طفيفة نتيجة الأنشطة التحضيرية وتنظيف الموقع، حيث يُحتمل لهذه الأنشطة أن تخل بالموائل الطبيعية المتواجدة في منطقة المشروع.
المواقع الأثرية	من غير المحتمل حدوث أي تأثير بهذا الخصوص، غير أن الأعمال الإنشائية قد تشيبت في إحداهن أضراس لبقايا مواقع أثرية إن وجدت في منطقة المشروع.
نوعية الهواء/ الضجيج	تتضمن الأنشطة الإنشائية عمليات الحفر وتنظيف الموقع بالإضافة لحركة المركبات والآليات ونقل المعدات، والتي من المحتمل أن ينتج عنها زيادة في مستويات الضجيج والملوثات ، والتي بدورها قد تؤثر على نوعية الهواء المحيط.
	من المتوقع حصول زيادة في مستويات الضجيج في البيئة المحيطة بالمشروع بسبب النشاطات الإنشائية، والتي من المحتمل أن تشمل على استخدام الآليات والمعدات، إلا أن هذه النشاطات ستقتصر على الفترة البعيدة فقط.
النقل والمواصلات	من المتوقع حصول زيادة في عدد المركبات التي تنتظر على طريق الخدمات المجاور لمدخل المحطة، إلا أنه لا يتوقع إغلاق الطرق أو تحويل السير.
الصحة والسلامة المهنية	هناك بعض المخاطر التي قد تؤثر على صحة وسلامة العمال في الموقع خلال مرحلة الإنشاء.

ملخص الآثار المتوقعة الناجمة عن المشروع خلال المرحلة التشغيلية	
المجال	الآثار المحتملة للمشروع
نوعية الهواء/ الضجيج	سيُنتج عن العمليات التشغيلية للمحطة الحرارية باستخدام الغاز الطبيعي انبعاثات للغازات الملوثة (كغازي أكسيد النيتروجين وأكسيد الكربون) بالإضافة لغازات الدفيئة في البيئة المحيطة. إلا أن هذه الانبعاثات أقل بكثير مقارنة بالمحطة السابقة.
	من المحتمل الزيادة في مستويات الضجيج في البيئة المحيطة بسبب النشاطات التشغيلية للمحطة.
التربة والمياه الجوفية	يحتاج المشروع خلال التشغيل إلى مياه والتي سيتم تزويدها من خلال استخدام المياه الجوفية من بئر في منطقة المشروع بشكل رئيسي، وقد يؤثر ذلك على إحتياجات المنطقة من المياه مثل المحتجعات المحلية.
	قد ينتج عن المشروع تلوث التربة والمياه الجوفية خلال نشاطات التشغيل المختلفة والتي قد

- بئر عميق للمياه ومحطة ضخ داخل حدود موقع المشروع لتلبية احتياجاته من المياه، حيث سيتم ضخ المياه من البئر عند الحاجة؛
- مرافق تابعة وتشمل مكاتب إدارية وغرفة تحكم مركزية، وبركة تخزين للمياه، إلخ..

4. عرض عام لنشاطات المشروع

يُبين هذا الجزء النشاطات المحتملة والمتوقع حصولها خلال مراحل تنفيذ المشروع، والتي تشتمل على ثلاث مراحل منفصلة هي: (1) مرحلة التخطيط والإنشاء، (2) مرحلة التشغيل، و (3) مرحلة التفكيك

مرحلة التخطيط والإنشاء

من المتوقع أن تبدأ الأنشطة المتعلقة بمرحلة التخطيط والإنشاء بعد الحصول على كافة الموافقات اللازمة، والتي يتوقع الحصول عليها في الربع الثاني من عام 2016، ومن المتوقع أن تستمر المرحلة الإنشائية لمدة سنتين قبل بدء فترة التشغيل التجاري للمشروع المتوقعة في شهر حزيران من عام 2018. وفيما يلي قائمة بالأنشطة النموذجية لمرحلة التخطيط والإنشاء لهذا النوع من المشاريع:

- التخطيط والتصميم التفصيلي للمشروع ومكوناته؛
- تنفيذ أعمال تجهيز الموقع والتي تشتمل على: الحفريات وتنظيف الموقع وازالة الطعم وغيرها؛
- تركيب الأساسات والأعمال المدنية للمنشآت والمعدات؛
- تركيب الأجهزة والمعدات.

مرحلة التشغيل

من المتوقع أن يتم التشغيل على مرحلتين، يجري في المرحلة الأولى تشغيل الدورة البسيطة (التي تشمل تشغيل توربينات الغاز لوحدها)، ويلتزمها تشغيل الدورة المركبة في المرحلة الثانية (والتي تشمل تشغيل توربينات توليد الطاقة الكهربائية، ومولدات الجار، والتوربين البخاري). من المتوقع أن يبدأ تشغيل الدورة البسيطة في 1 كانون الأول من عام 2017 ، وتشغيل الدورة المركبة في 1 حزيران من عام 2018.

يتوقع استمرار مرحلة التشغيل لمدة 25 عام حسب اتفاقية شراء الطاقة. وستعتمد مرحلة التشغيل على الغاز الطبيعي مما يضمن كفاءة انتاجية أعلى وانبعاثات غازية أقل مقارنة بالمحطة السابقة.

مرحلة التفكيك

يجري في هذه المرحلة التخلص من مكونات المشروع بعد انتهاء المرحلة التشغيلية، أي بعد مرور 25 عام، ولا تتوفر معلومات عن الأنشطة المتوقعة في هذه المرحلة.

5. التأثيرات البيئية المتوقعة للمشروع

سيؤدي تنفيذ هذا المشروع إلى حصول جملة من التأثيرات الإيجابية والسلبية على البيئة المحيطة، والتي سيتم مناقشتها في الحقة التشاورية.

من المهم تسليط الضوء على الآثار الإيجابية المتوقعة على الخصائص البيئية الناتجة عن إنشاء وتشغيل المشروع، وفيما يلي ملخص لأبرز هذه الآثار:

- توفير مصدر موثوق لتوليد الطاقة الكهربائية، والتي سوف تساعد على تلبية الزيادة في الطلب على الطاقة الكهربائية في الأردن.

المجال	الآثار المحتملة للمشروع
الصحة والسلامة المهنية	تشمل الإجراءات غير السليمة لتنظيف وترتيب الموقع، مثل الطرح العشوائي للمخلفات والمياه العادمة والغزافات وغيرها. سوف يكون هناك بعض المخاطر على صحة العمال وسلامتهم خلال مرحلة تشغيل المشروع.

6. معلومات الاتصال

لمزيد من الاستفسارات أو التعليقات، يمكن الاتصال بـ:

ابراهيم المصري – مدير المشروع ، أو مكتب ECO Consult
بريد الكتروني: Ibrahim.mastri@ecoconsult.io
هاتف: +962 6 569 9769
فاكس: +962 6 569 7264

Environmental Impact Assessment

Hussein Thermal Power Station Project



- **Project:** Hussein Thermal Power Station Project
- **Developer:** ACWA Power
- **Project Company (Owner):** Al Zarqa Electric Power Generation PSC
- **EPC Contractor:** SEPCO III
- **O&M Company:** Central Electricity Generating Company (CEGCO)
- **Environmental Consultant:** 5 Capitals and ECO Consult

1. INTRODUCTION

ACWA Power is to proposing to develop a new 485MW natural gas fired power plant within the existing landholding of the Hussein Thermal Power Station (Hussein TPS) located in Zarqa Governorate. The output from the power plant will be supplied to the National Electricity Power Company of Jordan (NEPCO) under a 25-year Power Purchase Agreement (PPA).

The requirement for the Project is due to the closure of the original Hussein TPS in December 2015 and the continued growth of electrical demand in Jordan. The proposed project will provide a cleaner energy source at a much improved operational efficiency compared to the original Hussein TPS plant.

2. PROJECT LOCATION

The Project site is located within Zarqa Governorate in the north of Jordan, around 25km northeast of the capital city of Amman. More specifically, the

Project site is located within the Industrial Area located around 4km northeast of Zarqa City (the capital city of the Governorate) while to the north is located Al-Hashmiyeh city. To the west is also the existing Jordan Petroleum Refinery. The new proposed Project site is located within the existing boundaries of the Hussein TPS.



Figure 1: Project Location

3. PROJECT COMPONENTS

The following present the key components of the Project and which include the following:

- 3 Gas Turbine Generators which generate electricity directly from the combustion of fuel;
- 3 Heat Recovery Steam Generators (HRSG) which uses exhaust heat generated from gas turbines to convert water to steam;
- 1 Steam Turbine Generator that uses steam generated by the HRSG's to generate additional electricity under combined cycle operation;
- Air Cooled Condensers for dry cooling of steam turbine steam;
- Fuel Storage Tanks; Natural gas is the main fuel used, while Diesel fuel is a backup fuel used in emergency situations only;
- Gas Receiving Station to transfer incoming natural gas for the pipeline;

- Deepwater well and pumping station within the site boundary for process water will only be used to top up process water as required; and
- Ancillary facilities including administration building, central control room, evaporation ponds, etc.

4. OVERVIEW OF PROJECT ACTIVITIES

This section presents the likely activities to take place during the Project development and which will include: (i) planning and construction, (ii) operation and (iii) decommissioning each of which is summarized below.

Planning and Construction Phase

Typical activities during the planning and construction phase for the Project are summarized below. Construction activities for the project are expected to commence once all necessary project approvals are obtained and which is expected in the 2nd Quarter of 2016. Construction duration is anticipated to last for approximately 2 years.

- Detailed and final planning and design for the project and its components;
- Site preparation activities which include excavations, clearing and levelling;
- Installation of foundation and civil works for structures and equipment;
- Installation of equipment.

Operation Phase

Operation is expected to commence in two separate phases for simple cycle operation (Gas Turbines operation alone) and combined cycle operation (Gas Turbines and HRSG & Steam Turbines in combination). Simple cycle operation is expected to commence on 1st December 2017, while combined cycle operation is due for 1st June 2018.

The operational phase will continue for 25 years in accordance with the PPA.

The operational phase will predominantly generate power in combined cycle operation fuelled by natural gas. This will ensure high efficiency power generation, with low air emissions.

Decommissioning Phase

Decommissioning of the proposed repowering project will be as a minimum after 25 years of operations. Information regarding decommissioning activities is not available at this stage.

5. ANTICIPATED ENVIRONMENTAL IMPACTS FROM THE PROJECT

Implementation of the Project will give rise to several potential positive and negative impacts on certain environmental attributes all of which will be discussed throughout the project scoping session.

It is important to highlight the positive environmental impacts that are anticipated from the development of the project. These impacts are summarised below:

- Provision of a reliable source of electrical generation which will help to meet the increasing electricity demands in Jordan;
- The project will generate a much cleaner form of energy compared with the previous Hussein TPS which operated on Heavy Fuel Oil with a low efficiency;
- A substantial reduction in GHG and pollution emissions compared to the previous Hussein TPS;
- The project is expected to generate local employment, particularly during the construction and operation phase and subsequently enhance socio-economic conditions of local communities.

Several negative impacts are anticipated from the Project, however it should be noted that these will be vastly reduced compared to the previous Hussein TPS plant and will be subject to mitigation measures and monitoring. Such impacts are summarised in the tables below for each phase of the Project development.

Summary of Anticipated Impacts during the Planning and Construction Phase

Attribute	Likely Project Impact
Soil, Geology and Groundwater	Minor risk of soil and groundwater contamination during the various construction activities from improper housekeeping activities, spillage of hazardous material, waste and wastewater, etc.
Biodiversity (Flora/Fauna)	Minor impacts to ecology due to the largely cleared nature of the enclosed project site. Various construction activities could potentially disturb existing habitats within the site.
Archaeology	Considered unlikely, however various earthworks have the potential to disturb/damage sub-surface archaeological

E-mail: Ibrahim.masri@ecoconsult.io
 Phone: +962 6 569 9769
 Fax: +962 6 569 7264

	remains if present within the site.
Air Quality/Noise	Various construction activities could result in an increased level of dust from excavations and unpaved vehicle movements. Vehicles and construction plant may also lead to gaseous pollutant emissions. Various construction activities will likely result in noise emissions to the environment. Any noisy construction works will however be limited to daylight periods.
Traffic and Transportation	Potential for waiting vehicles on the service road adjacent to the entrance of the existing Hussein TPS. No road closures or diversions are expected.
Occupational Health and Safety	Generic occupational health and safety risks from working on construction sites.

Summary of Anticipated Impacts during the Operation Phase

Attribute	Likely Project Impact
Air Quality and Noise	Operation of the thermal power plant on natural gas will result in air pollutant emissions (e.g. NO ₂ and CO) as well as greenhouse gas emissions to the surrounding environment. Impacts are significantly reduced compared to the original Hussein TPS. Operation of the thermal power plant will likely result in noise emissions to the surrounding environment.
Soil, Geology and Groundwater	Depending on water availability and supply, water requirements for the Project could affect local water resources and uses of local communities. Risk of soil and groundwater contamination during the various operation activities from improper housekeeping activities, spillage of hazardous material, waste and wastewater, storage tanks, etc.
Occupational Health and Safety	Generic occupational health and safety risks during operation.

6. CONTACT INFORMATION

For further questions and comments please contact:

Ibrahim Masri – Project Manager, or ECO Consult office

Appendix G

Diffusion Tube Laboratory Results (2016)

LABORATORY ANALYSIS REPORT

DETERMINATION OF ACID GASES IN DIFFUSION TUBES BY ION CHROMATOGRAPHY

REPORT NUMBER X5449R

BOOKING IN REFERENCE No X5449

DESPATCH NOTE No SOR27562

CUSTOMER 5 Capitals Environmental & Management Consulting
PO Box 119899
Sheikh Zayed Road, Dubai
UAE

DATE SAMPLES RECEIVED 26/02/2016

GRADKO LAB REF GIN 18301-18312
JOB REFERENCE Hussein TPS

Tube Identification	Date On	Date Off	Exposure (hrs)	NITROGEN DIOXIDE			
				$\mu\text{g NO}_2$ Total	μgNO_2 - Blank	NO_2 $\mu\text{g/m}^3$ *	NO_2 ppb*
669880 A-1(A)	27/01/16	23/02/16	649.50	0.81	0.81	16.70	8.69
669881 A-1(B)	27/01/16	23/02/16	649.50	0.78	0.77	16.06	8.35
669883 A-2(A)	27/01/16	23/02/16	648.75	0.76	0.76	15.70	8.17
669882 A-2(B)	27/01/16	23/02/16	648.75	0.73	0.73	15.16	7.89
669884 A-3(A)	27/01/16	23/02/16	648.75	1.18	1.18	24.53	12.76
669885 A-3(B)	27/01/16	23/02/16	648.75	1.17	1.17	24.22	12.59
669886 A-4(A)	27/01/16	23/02/16	649.00	0.79	0.79	16.42	8.54
669887 A-4(B)	27/01/16	23/02/16	649.00	0.88	0.87	18.15	9.44
669888 A-5(A)	27/01/16	23/02/16	648.25	0.88	0.88	18.34	9.53
669889 A-5(B)	27/01/16	23/02/16	648.25	0.80	0.80	16.53	8.59
669892 A-6(A)	27/01/16	23/02/16	647.75	0.75	0.75	15.60	8.11
669893 A-6(B)	27/01/16	23/02/16	647.75	0.78	0.78	16.19	8.42

Lab Blank

0.002

(RESULTS ARE BLANK CORRECTED)

OVERALL M.U. $\pm 14.9\%$

REPORTING LIMIT $0.05\mu\text{g NO}_2^-$

Analysed on Dionex ICS1100 ICU10

ANALYST NAME B. Gregory

DATE OF ANALYSIS 10/03/2016

DATE OF REPORT 11/03/2016

ANALYSIS HAS BEEN CARRIED OUT IN ACCORDANCE WITH IN-HOUSE METHOD GLM3


The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

Form LQF32b Issue 6 – February 2015

Report Number X5449R

Page 1 of 2

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

LABORATORY ANALYSIS REPORT

DETERMINATION OF ACID GASES IN DIFFUSION TUBES BY ION CHROMATOGRAPHY

Tube Identification	Date On	Date Off	Exposure (hrs)	SULPHUR DIOXIDE			
				$\mu\text{g S}$ Total	μgS - Blank	SO_2 $\mu\text{g/m}^3$ *	SO_2 ppb*
669880 A-1(A)	27/01/16	23/02/16	649.50	0.39	0.39	21.96	8.23
669881 A-1(B)	27/01/16	23/02/16	649.50	0.37	0.36	20.49	7.69
669883 A-2(A)	27/01/16	23/02/16	648.75	0.26	0.26	14.57	5.46
669882 A-2(B)	27/01/16	23/02/16	648.75	0.32	0.32	17.85	6.69
669884 A-3(A)	27/01/16	23/02/16	648.75	0.74	0.74	41.65	15.62
669885 A-3(B)	27/01/16	23/02/16	648.75	0.68	0.68	38.13	14.30
669886 A-4(A)	27/01/16	23/02/16	649.00	0.18	0.17	9.63	3.61
669887 A-4(B)	27/01/16	23/02/16	649.00	0.23	0.23	12.91	4.84
669888 A-5(A)	27/01/16	23/02/16	648.25	0.32	0.31	17.60	6.60
669889 A-5(B)	27/01/16	23/02/16	648.25	0.19	0.19	10.60	3.97
669892 A-6(A)	27/01/16	23/02/16	647.75	0.34	0.33	18.69	7.01
669893 A-6(B)	27/01/16	23/02/16	647.75	0.36	0.35	19.93	7.47

Lab Blank

0.004

(RESULTS ARE BLANK CORRECTED)

OVERALL M.U.	$\pm 14.9\%$	REPORTING LIMIT	0.03 $\mu\text{g S}$
Analysed on Dionex ICS1100 ICU10		ANALYST NAME	B. Gregory
DATE OF ANALYSIS	10/03/2016	DATE OF REPORT	11/03/2016

ANALYSIS HAS BEEN CARRIED OUT IN ACCORDANCE WITH IN-HOUSE METHOD GLM3


The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

Form LQF32b Issue 6 – February 2015

Report Number X5449R

Page 2 of 2

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

LABORATORY ANALYSIS REPORT

DETERMINATION OF OZONE IN DIFFUSION TUBES BY ION CHROMATOGRAPHY

REPORT NUMBER K01316R
BOOKING IN REFERENCE No K01316
DESPATCH NOTE No 27562
CUSTOMER 5 Capitals Environmental & Management Consulting Attn: Max Burrow
Sheikha Sana Bldg, Svite 203
Sheikh Zayed Road,
Dubai
United Arab Emirates
DATE SAMPLES RECEIVED 26/02/2016
JOB NUMBER Hussein TPS

Location	Sample Number	Date Exposed	Date Finished	Exposure Hours	µg on Tube Total	µg - Blank	O ₃ µg/m ³ *	O ₃ ppb*
A-1 (A)	669894	27/01/2016	23/02/2016	649.50	0.56	0.55	48.89	24.45
A-1 (B)	669895	27/01/2016	23/02/2016	649.50	0.77	0.76	67.47	33.74
A-2 (A)	669896	27/01/2016	23/02/2016	648.75	0.64	0.62	55.48	27.74
A-2 (B)	669897	27/01/2016	23/02/2016	648.75	0.63	0.62	55.11	27.55
A-3 (A)	669898	27/01/2016	23/02/2016	648.75	0.62	0.61	54.05	27.02
A-3 (B)	669899	27/01/2016	23/02/2016	648.75	0.52	0.50	44.95	22.47
A-4 (A)	669900	27/01/2016	23/02/2016	649.00	0.90	0.89	79.29	39.64
A-4 (B)	669901	27/01/2016	23/02/2016	649.00	0.78	0.77	68.23	34.11
A-5 (A)	669902	27/01/2016	23/02/2016	648.25	0.70	0.69	61.57	30.79
A-5 (B)	669903	27/01/2016	23/02/2016	648.25	0.71	0.70	62.47	31.24
A-6 (A)	669906	27/01/2016	23/02/2016	647.75	0.68	0.66	59.17	29.58
A-6 (B)	669907	27/01/2016	23/02/2016	647.75	0.60	0.59	52.56	26.28
Laboratory Blank					0.01			

Comment: Results are blank subtracted

Overall M.U. ±10.0%

Analysed on Dionex ICS3000 ICU5

Reporting Limit 0.096µg O₃

Analyst Name Katya Paldamova

Date of Analysis 09/03/2016

Date of Report 10/03/2016

Analysis has been carried out in accordance with in-house method GLM 2


The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

Form LQF32b Issue 6 – February 2015

Report Number K01316R

Page 1 of 1

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

LABORATORY ANALYSIS REPORT

REPORT NUMBER K01348R
CUSTOMER 5 Capitals Environmental & Management Consulting
P.O.Box 119899
Sheikh Zayed Rd
Dubai, UAE
GRADKO LAB REFERENCE 03K0231-0238
DATE SAMPLES RECEIVED 26.02.2016
DESPATCH REF.NUMBER 27562
JOB NUMBER Hussein TPS
BOOKING IN REF. X5450

**QUANTITATIVE ANALYSIS FOR BTEX ON CG1TD DIFFUSION TUBES BY GCMS
IDENTIFICATION AND ESTIMATION (SEMI-QUANTITATIVE ANALYSIS) FOR TOP 5 VOC
ON CG1TD DIFFUSION TUBES BY GC/MS**

Analysis has been carried out in accordance with in-house method GLM 13

Index to UKAS Accreditation Status

U	Analysis is UKAS accredited under our Fixed Scope
F	Analysis is UKAS accredited under our Flexible Scope
N	Analysis is not UKAS accredited

Tube Number GRA 10939
Tube Location A-1 (A)
Exposure Time (mins) 38970
Accreditation

BTEX	Status	ng on tube	ppb in air*	µgm ⁻³ *
Benzene	U	26.09	0.36	1.13
Toluene	U	93.53	1.16	4.27
Ethylbenzene	U	23.08	0.31	1.29
m/p-Xylene	U	74.25	0.98	4.16
o-Xylene	U	28.88	0.38	1.62

TOP 5 VOC	Status	ng on tube	ppb in air*	µgm ⁻³ *
Butane, 2-methyl-	N	61.53	0.79	2.27
Pentane	F	51.45	0.66	1.90
Pentane, 2-methyl-	N	48.28	0.62	2.13
Hexane	F	36.67	0.47	1.62
Heptane	F	24.60	0.32	1.26

Tube Number GRA 11183
Tube Location A-1 (B)
Exposure Time (mins) 38970
Accreditation

BTEX	Status	ng on tube	ppb in air*	µgm ⁻³ *
Benzene	U	29.58	0.41	1.28
Toluene	U	107.23	1.33	4.89
Ethylbenzene	U	24.99	0.33	1.40
m/p-Xylene	U	79.46	1.05	4.46
o-Xylene	U	30.59	0.40	1.72


The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

Form LQF32b Issue 6 – February 2015

Report Number K01348R

Page 1 of 4

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

LABORATORY ANALYSIS REPORT

TOP 5 VOC

		ng on tube	ppb in air*	µgm ⁻³ *
Butane, 2-methyl-	N	59.43	0.76	2.20
Pentane, 2-methyl-	N	54.00	0.69	2.38
Pentane	F	51.20	0.66	1.89
Hexane	F	41.42	0.53	1.83
Heptane	F	26.89	0.34	1.38

Tube Number

GRA 11011

Tube Location

A-4 (B)

Exposure Time (mins)

38940

Accreditation

BTEX

	Status	ng on tube	ppb in air*	µgm ⁻³ *
Benzene	U	31.41	0.44	1.36
Toluene	U	109.36	1.36	4.99
Ethylbenzene	U	19.05	0.25	1.07
m/p-Xylene	U	54.54	0.72	3.06
o-Xylene	U	20.97	0.28	1.18

TOP 5 VOC

		ng on tube	ppb in air*	µgm ⁻³ *
Butane, 2-methyl-	N	75.52	0.97	2.79
Pentane	F	65.11	0.84	2.41
Pentane, 2-methyl-	N	60.63	0.78	2.68
Hexane	F	36.03	0.46	1.59
Pentane, 3-methyl-	N	22.47	0.29	0.99

Tube Number

GRA 11153

Tube Location

A-2 (B)

Exposure Time (mins)

38880

Accreditation

BTEX

	Status	ng on tube	ppb in air*	µgm ⁻³ *
Benzene	U	34.51	0.48	1.50
Toluene	U	98.76	1.23	4.52
Ethylbenzene	U	24.55	0.33	1.38
m/p-Xylene	U	73.22	0.97	4.12
o-Xylene	U	27.98	0.37	1.57

TOP 5 VOC

		ng on tube	ppb in air*	µgm ⁻³ *
Butane, 2-methyl-	N	66.32	0.85	2.46
Pentane	F	61.96	0.80	2.29
Pentane, 2-methyl-	N	53.37	0.69	2.36
Hexane	F	38.03	0.49	1.68
Pentane, 3-methyl-	N	25.25	0.32	1.12


The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

Form LQF32b Issue 6 – February 2015

Report Number K01348R

Page 2 of 4

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

LABORATORY ANALYSIS REPORT

Tube Number GRA 11683
Tube Location A-3 (A)
Exposure Time (mins) 38940
Accreditation

BTEX	Status	ng on tube	ppb in air*	µgm⁻³*
Benzene	U	60.55	0.84	2.62
Toluene	U	204.82	2.75	10.13
Ethylbenzene	U	50.21	0.62	2.62
m/p-Xylene	U	142.70	1.75	7.43
o-Xylene	U	56.70	0.70	2.95
TOP 5 VOC		ng on tube	ppb in air*	µgm⁻³*
Pentane	F	204.57	2.63	7.56
Butane, 2-methyl-	N	198.18	2.54	7.33
Pentane, 2-methyl-	N	163.94	2.11	7.24
Hexane	F	145.83	1.87	6.44
Heptane	F	99.15	1.27	5.09

Tube Number GRA 11128
Tube Location A-3 (B)
Exposure Time (mins) 38940
Accreditation


BTEX	Status	ng on tube	ppb in air*	µgm⁻³*
Benzene	U	60.25	0.84	2.61
Toluene	U	199.61	2.48	9.11
Ethylbenzene	U	48.22	0.64	2.71
m/p-Xylene	U	139.80	1.85	7.85
o-Xylene	U	55.09	0.73	3.09
TOP 5 VOC		ng on tube	ppb in air*	µgm⁻³*
Pentane	F	202.24	2.60	7.48
Butane, 2-methyl-	N	198.60	2.55	7.34
Pentane, 2-methyl-	N	171.30	2.20	7.57
Hexane	F	142.66	1.83	6.30
Heptane	F	92.99	1.19	4.78

Tube Number GRA 10225
Tube Location A-4 (A)
Exposure Time (mins) 38940
Accreditation

BTEX	Status	ng on tube	ppb in air*	µgm⁻³*
Benzene	U	37.40	0.52	1.62
Toluene	U	124.77	1.55	5.70
Ethylbenzene	U	21.24	0.28	1.19
m/p-Xylene	U	61.44	0.81	3.45
o-Xylene	U	23.19	0.31	1.30

The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

LABORATORY ANALYSIS REPORT

TOP 5 VOC

		ng on tube	ppb in air*	µgm ⁻³ *
Butane, 2-methyl-	N	91.50	1.17	3.38
Pentane	F	77.51	1.00	2.87
Pentane, 2-methyl-	N	64.70	0.83	2.86
Hexane	F	46.40	0.60	2.05
Pentane, 3-methyl-	N	25.64	0.33	1.13

Tube Number

GRA 11061

Tube Location

A-2 (A)

Exposure Time (mins)

38940

Accreditation

BTEX

	Status	ng on tube	ppb in air*	µgm ⁻³ *
Benzene	U	36.58	0.51	1.58
Toluene	U	105.56	1.31	4.82
Ethylbenzene	U	26.30	0.35	1.48
m/p-Xylene	U	79.95	1.06	4.49
o-Xylene	U	30.58	0.40	1.72

TOP 5 VOC

		ng on tube	ppb in air*	µgm ⁻³ *
Butane, 2-methyl-	N	81.25	1.04	3.00
Pentane	F	70.47	0.90	2.61
Pentane, 2-methyl-	N	61.03	0.78	2.70
Heptane	F	24.44	0.31	1.26
Pentane, 3-methyl-	N	23.26	0.30	1.03

UPTAKE RATES

Benzene 1.85ng.ppm⁻¹.min⁻¹

Toluene 2.07ng.ppm⁻¹.min⁻¹

Ethylbenzene 1.94ng.ppm⁻¹.min⁻¹

Xylenes 1.94ng.ppm⁻¹.min⁻¹

All other compounds: 2.00 ng.ppm⁻¹.min⁻¹.

Identification and estimation results for ng on tube are calculated using toluene standards.

Overall MU 13.7% for quantitative analysis of BTEX compounds.

Date of Analysis 01.03.2016

Analysts Name

G. Aikman

Date of Report

10.03.2016


The Diffusion Tubes have been tested within the scope of Gradko International Ltd. Laboratory Quality Procedures calculations and assessments involving the exposure procedures and periods provided by the client are not within the scope of our UKAS accreditation. Those results obtained using exposure data shall be indicated by an asterisk. Any queries concerning the data in this report should be directed to the Laboratory Manager Gradko International Ltd. This report is not to be reproduced, except in full, without the written permission of Gradko International Ltd.

Form LQF32b Issue 6 – February 2015

Report Number K01348R

Page 4 of 4

REPORT OFFICIALLY CHECKED

Gradko International Ltd
This signature confirms the authenticity of these results
Signed: 
L. Gates, Laboratory Manager

Appendix H

Continuous Air Quality Monitoring Results (2016)


Data Collection Methods

The methods in bellow are used for data collection:

Parameter(s)	Method
NO, NO2, NOx	Direct-reading - Chemiluminescence method
CO	Direct-reading- electrochemical cell
PM10 and PM2.5	Continuous direct mass method using a tapered element oscillating microbalance analyzer.
SO2	Direct-reading -electrochemical cell.
Wind Speed, Wind Direction, Ambient Temperature, and Relative Humidity	Meteorological Monitoring Guidance + our thermal Environment Monitor (EQUEST Brand) and wind sensor (Vaisala Brand)

- **All equipment's used for monitoring equipped with data logging meter stores all of reading up to 250 logs.**
- **Data was download from the devices and placed in the Excel- tables**
- **The geographical location of measuring site is specified by ECO Consult.**

Occupational and Environmental Health Specialist



"Muhamed Fuad" Khalefeh Banny Awwad

Results of Ambient Air Quality Monitoring

At

Al-Husain Thermal Power Station – Zarqa

During 22– 29 March 2016

For

Eco-Consult

Prepared by

Occupational and Environmental Health Specialist

Muhammed Fuad" Khalefeh Banny Awwad

1st April 2016

Ambient Air Quality Data Report

Date : 22.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (Cloudy, Wind direction: West North, Wind speed = 16 km/hr.
Humidity: 46% and Temperature: 19°C)

Table 1.1

Average Air Quality Levels (in µg/m³) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration (µg/m ³)
			Average	Min	Max	
1	PM ₁₀	µg/m ³ /24 Hrs.	39.2	20.2	59.9	120
2	PM _{2.5}	µg/m ³ /24 Hrs.	23.0	17.6	29.4	65
3	SO ₂	µg/m ³ /24 Hrs.	1.42	0.3	4.20	20*
4	NO	µg/m ³ /24 Hrs.	15.0	8.8	27.0	
5	NO ₂	µg/m ³ /24 Hrs.	7.0	3.6	13.0	200*
6	NO _x	µg/m ³ /24 Hrs.	17.5	10.6	26.0	
7	CO	µg/m ³ /8 Hrs.	251.7	190.0	330.0	15000*

* WHO Ambient Air Quality Standard

الأكاديمية الوطنية للبيئة
National Academy for Environment

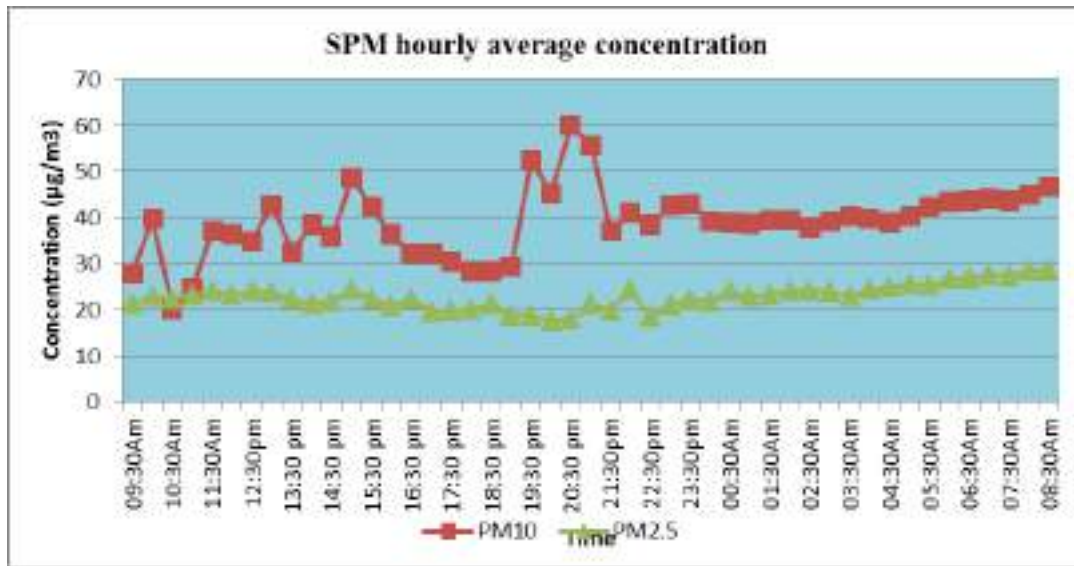


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 22.3.2016

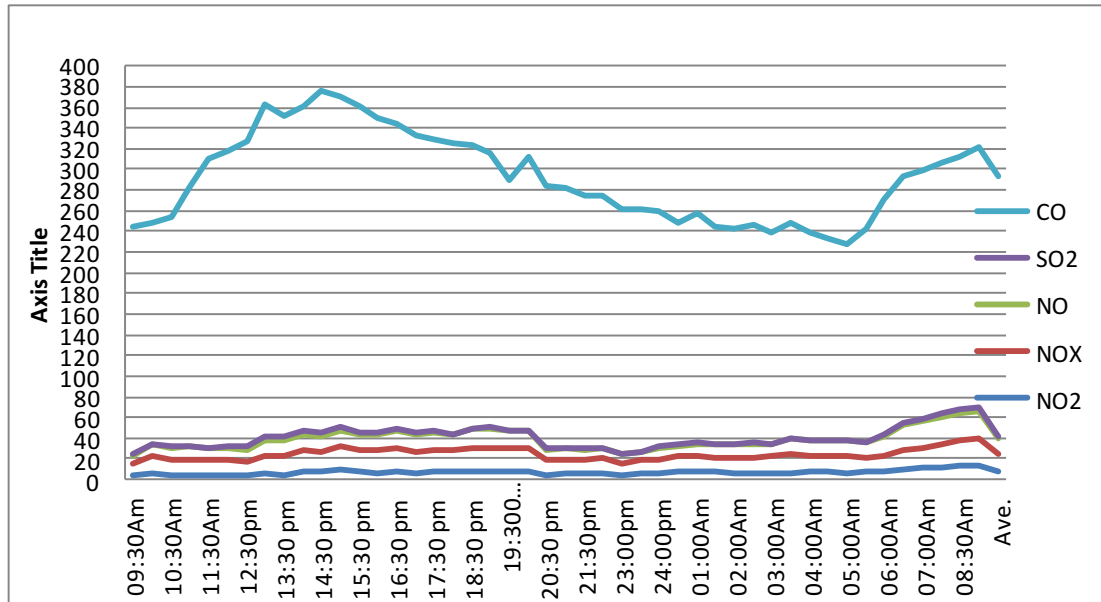


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 22.3.2016

هاتف: +962-6-5350650 فاكس +962-6-5330434 خلوي +962-79-5758689 +962-777-296305
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Quality Data Report

Date : 23.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (partially Cloudy, Wind direction: South East, Wind speed = 21 km/hr. Humidity: 15% and Temperature: 26°C)

Table 1.1

Average Air Quality Levels (in $\mu\text{g}/\text{m}^3$) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration ($\mu\text{g}/\text{m}^3$)
			Average	Min	Max	
1	PM ₁₀	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	42.6	30.3	55.6	120
2	PM _{2.5}	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	24.8	18.3	34.2	65
3	SO ₂	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	1.54	0.4	4.6	20*
4	NO	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	15.7	9.7	28.5	
5	NO ₂	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	7.7	4.6	13.9	200*
6	NO _x	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	17.5	8.2	27.0	
7	CO	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	256.9	192.0	330.0	15000*

* WHO Ambient Air Quality Standard

الأكاديمية الوطنية للبيئة

National Academy for Environment

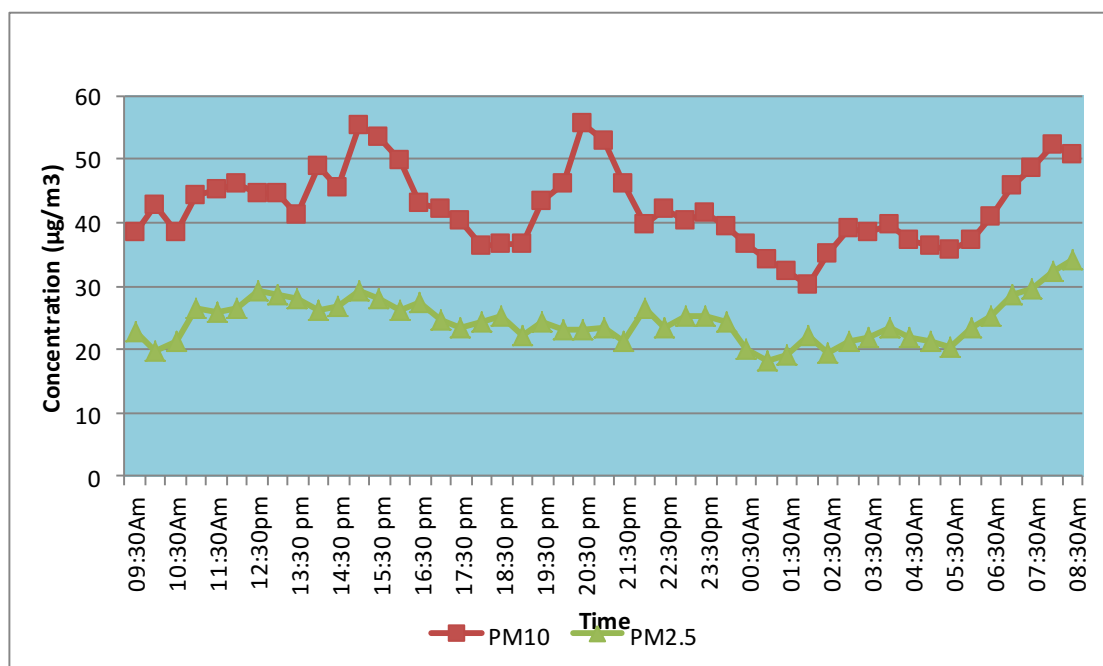


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 23.3.2016

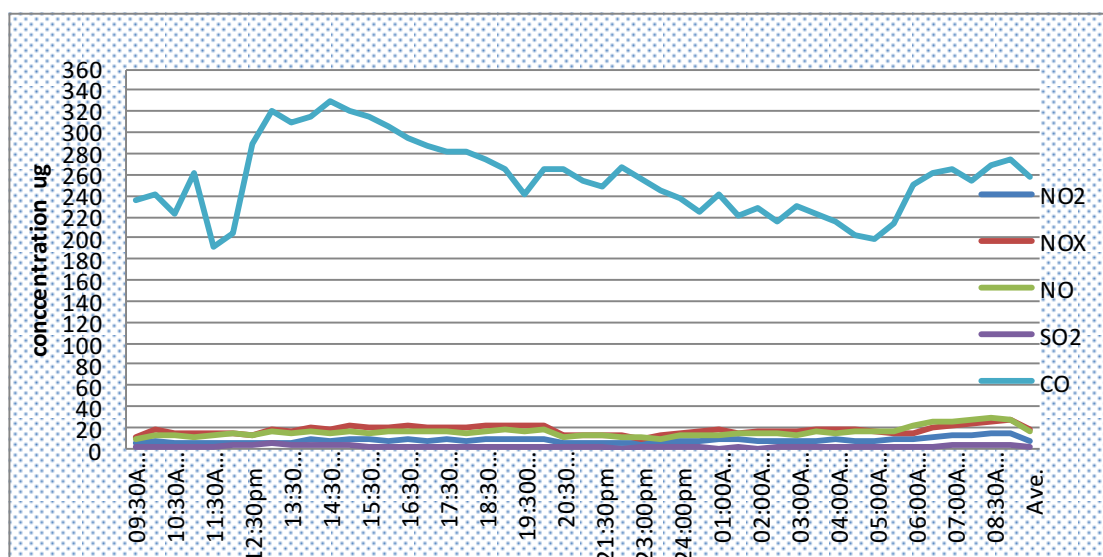


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 23.3.2016

هاتف: +962-6-5350650 فاكس +962-6-5330434 خلوي +962-79-5758689 +962-777-296305
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Quality Data Report

Date : 24.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (partially Cloudy, Wind direction: South East, Wind speed = 18 km/hr. Humidity: 34% and Temperature: 22°C)

Table 1.1

Average Air Quality Levels (in µg/m³) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration (µg/m ³)
			Average	Min	Max	
1	PM ₁₀	µg/m ³ /24 Hrs.	43.0	32.2	57.5	120
2	PM _{2.5}	µg/m ³ /24 Hrs.	29.1	20.2	39.5	65
3	SO ₂	µg/m ³ /24 Hrs.	1.53	0.40	3.60	20*
4	NO	µg/m ³ /24 Hrs.	15.4	10.2	25.4	
5	NO ₂	µg/m ³ /24 Hrs.	8.1	4.6	13.2	200*
6	NO _x	µg/m ³ /24 Hrs.	19.5	13.8	28.2	
7	CO	µg/m ³ /24 Hrs.	268.2	195.5	345.0	15000*

* WHO Ambient Air Quality Standard

الأكاديمية الوطنية للبيئة

National Academy for Environment

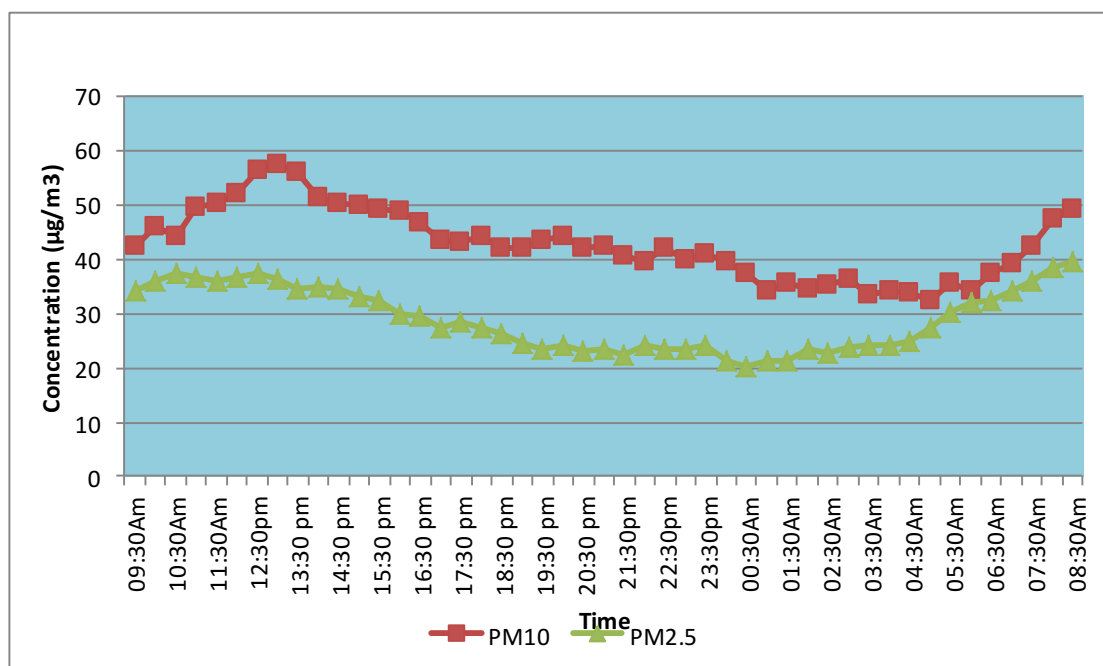


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 24.3.2016

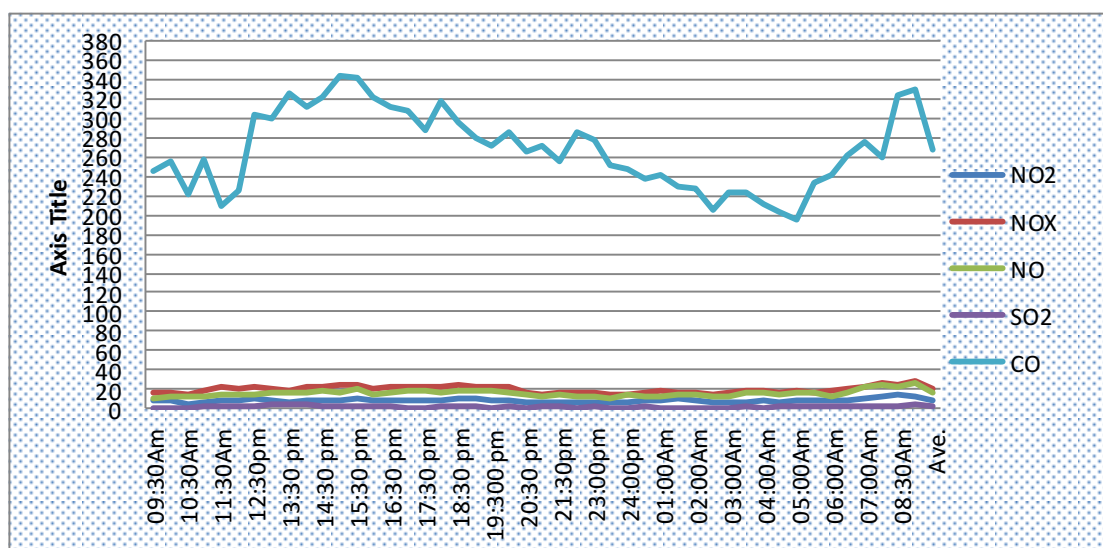


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 24.3.2016

هاتف: +962-777-296305 +962-79-5758689 خلوي +962-6-5330434 فاكس +962-6-5350650
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Quality Data Report

Date : 25.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (partially Cloudy, Wind direction: East, Wind speed = 26 km/hr. Humidity: 43% and Temperature: 25°C)

اجواء خماسينية

Table 1.1

Average Air Quality Levels (in $\mu\text{g}/\text{m}^3$) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration ($\mu\text{g}/\text{m}^3$)
			Average	Min	Max	
1	PM ₁₀	$\mu\text{g}/\text{m}^3/24$ Hrs.	53.9	31.0	72.3	120
2	PM _{2.5}	$\mu\text{g}/\text{m}^3/24$ Hrs.	36.1	24.6	47.2	65
3	SO ₂	$\mu\text{g}/\text{m}^3/24$ Hrs.	1.86	0.50	3.90	20*
4	NO	$\mu\text{g}/\text{m}^3/24$ Hrs.	16.10	11.20	22.30	
5	NO ₂	$\mu\text{g}/\text{m}^3/24$ Hrs.	9.10	5.90	14.0	200*
6	NO _x	$\mu\text{g}/\text{m}^3/24$ Hrs.	21.70	15.50	30.20	
7	CO	$\mu\text{g}/\text{m}^3/8$ Hrs.	276.8	188.9	366.9	15000*

* WHO Ambient Air Quality Standard

الأكاديمية الوطنية للبيئة

National Academy for Environment

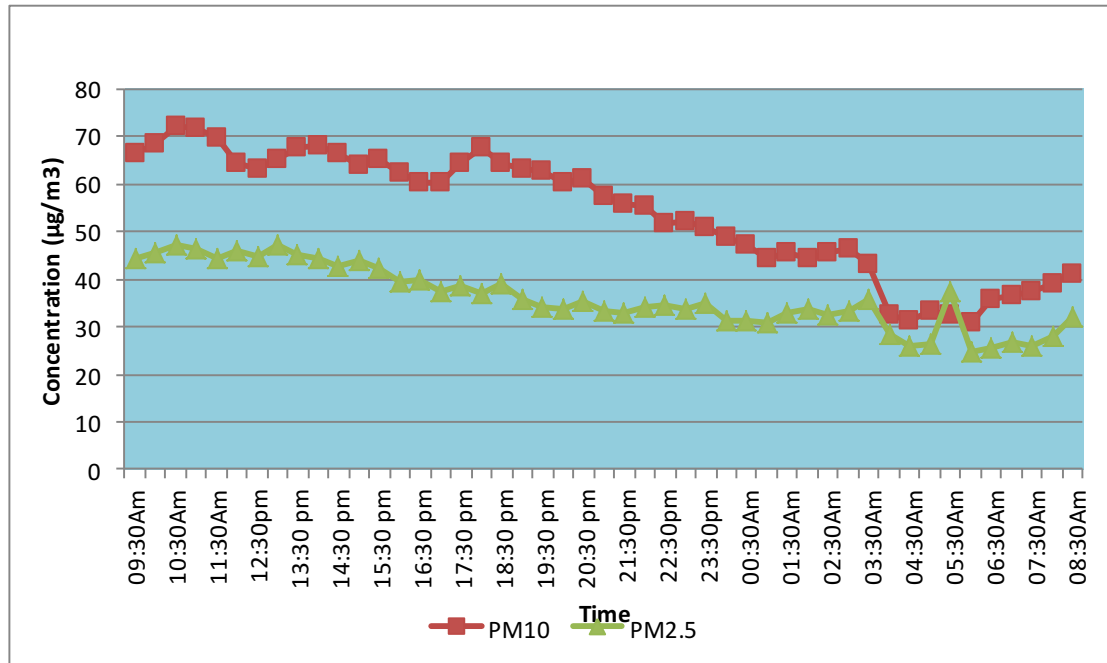


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 25.3.2016

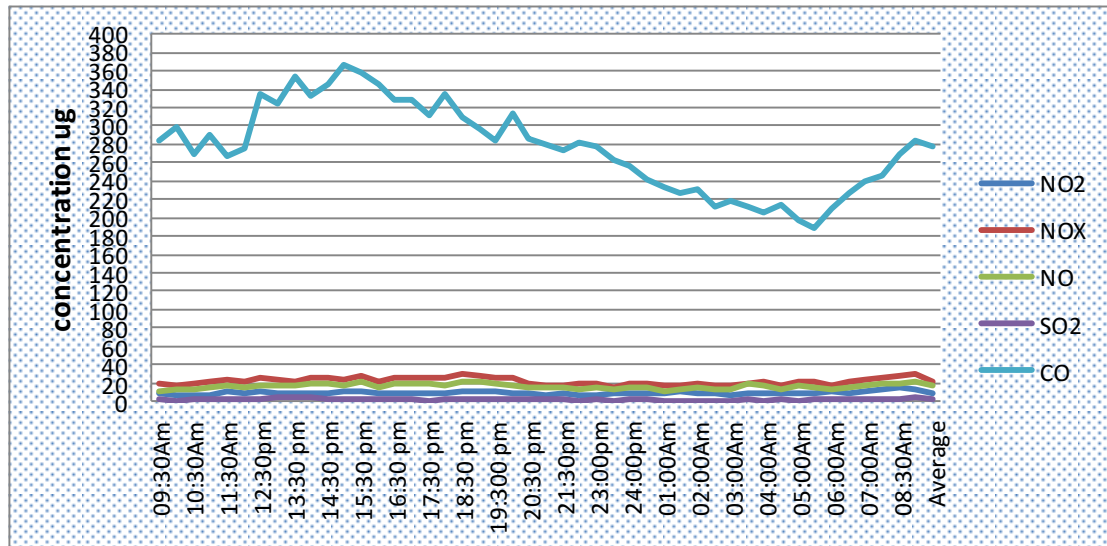


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 25.3.2016

هاتف: +962-777-296305 +962-79-5758689 خلوي +962-6-5330434 فاكس +962-6-5350650
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Quality Data

Date : 26.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (Cloudy with scattered rain, Wind direction: West, Wind speed = 18 km/hr. Humidity: 60% and Temperature: 21°C)

Table 1.1

Average Air Quality Levels (in µg/m³) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration (µg/m ³)
			Average	Min	Max	
1	PM ₁₀	µg/m ³ /24 Hrs.	37.70	28.70	48.50	120
2	PM _{2.5}	µg/m ³ /24 Hrs.	27.50	21.00	36.30	65
3	SO ₂	µg/m ³ /24 Hrs.	1.54	0.60	2.80	20*
4	NO	µg/m ³ /24 Hrs.	11.8	10.4	15.3	
5	NO ₂	µg/m ³ /24 Hrs.	8.00	6.60	11.20	200*
6	NO _x	µg/m ³ /24 Hrs.	17.70	15.30	21.60	
7	CO	µg/m ³ /24 Hrs.	248.40	178.90	315.30	15000*

*** WHO Ambient Air Quality Standard**

الأكاديمية الوطنية للبيئة

National Academy for Environment

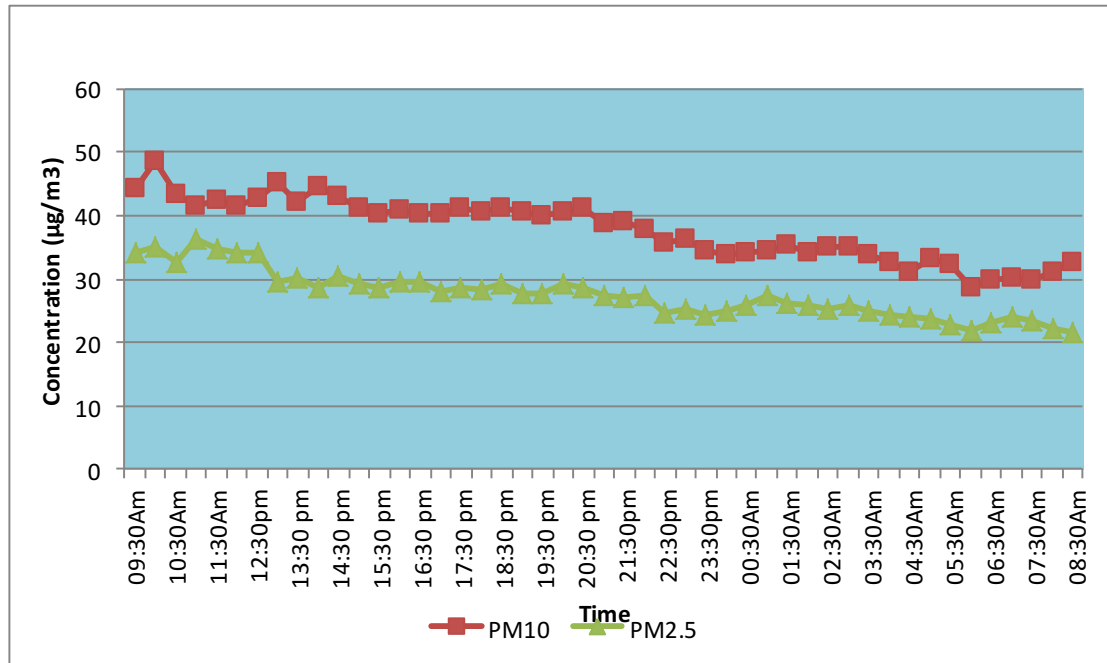


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 26.3.2016

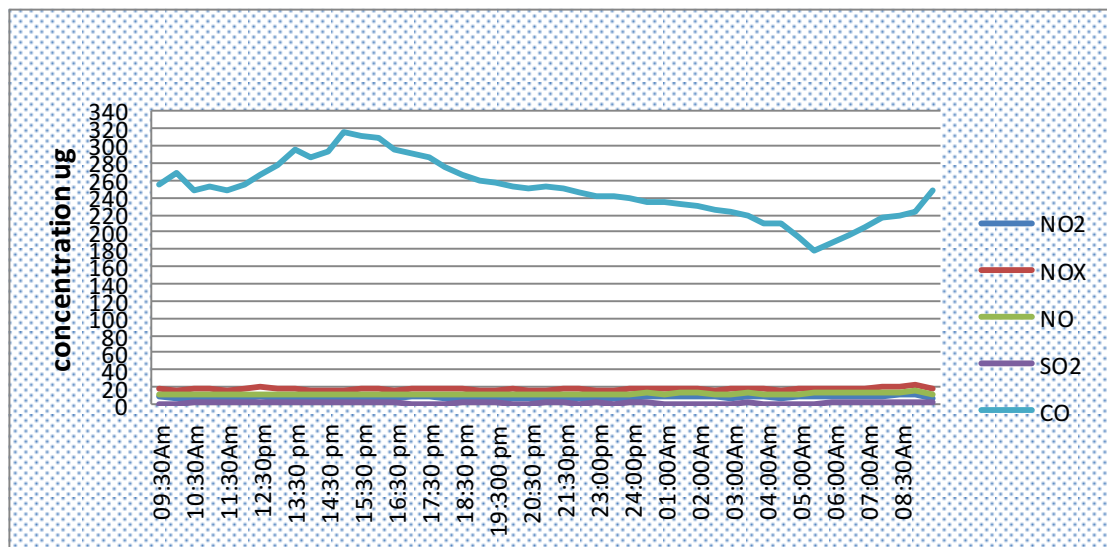


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 26.3.2016

هاتف: +962-777-296305 +962-79-5758689 خلوي +962-6-5330434 فاكس +962-6-5350650
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Quality Data Report

Date : 27.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (Cloudy with scattered rain, Wind direction: West, Wind speed = 18 km/hr. Humidity: 60% and Temperature: 21°C)

Table 1.1
Average Air Quality Levels (in µg/m³) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration (µg/m ³)
			Average	Min	Max	
1	PM ₁₀	µg/m ³ /24 Hrs.	34.3	25.0	43.3	120
2	PM _{2.5}	µg/m ³ /24 Hrs.	22.4	16.5	31.2	65
3	SO ₂	µg/m ³ /24 Hrs.	1.36	0.6	2.40	20*
4	NO	µg/m ³ /24 Hrs.	8.10	6.40	10.60	
5	NO ₂	µg/m ³ /24 Hrs.	7.40	5.80	8.90	200*
6	NO _x	µg/m ³ /24 Hrs.	15.50	13.50	18.20	
7	CO	µg/m ³ /24 Hrs.	222.6	188.6	263.5	15000*

* WHO Ambient Air Quality Standard

الأكاديمية الوطنية للبيئة
National Academy for Environment

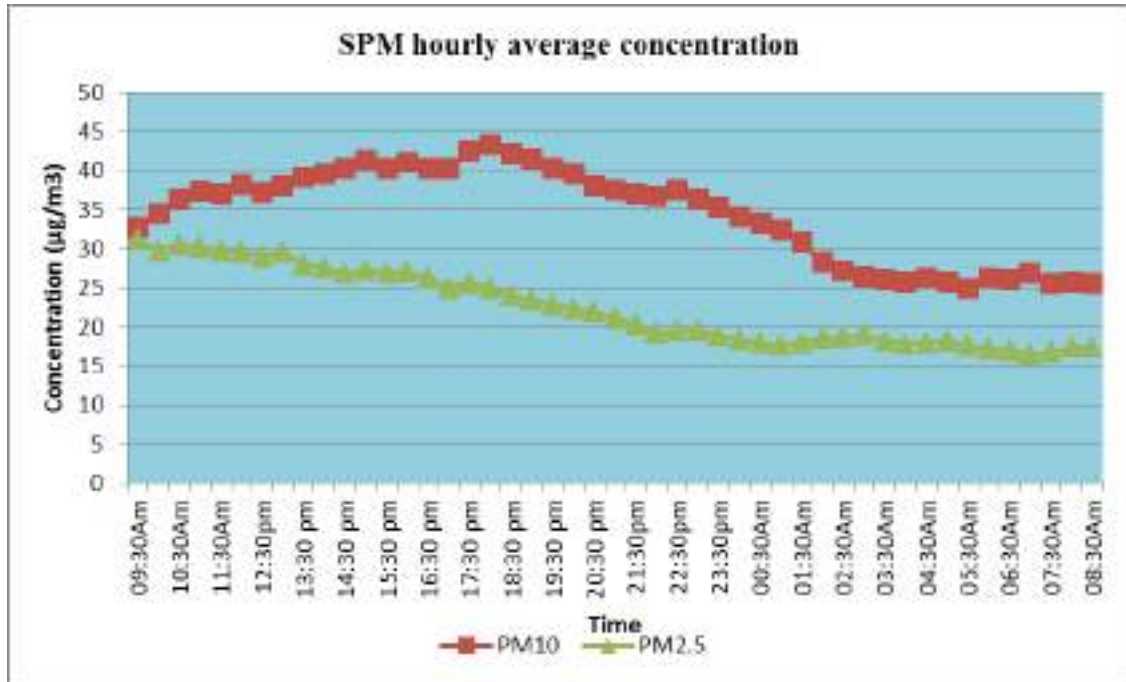


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 27.3.2016

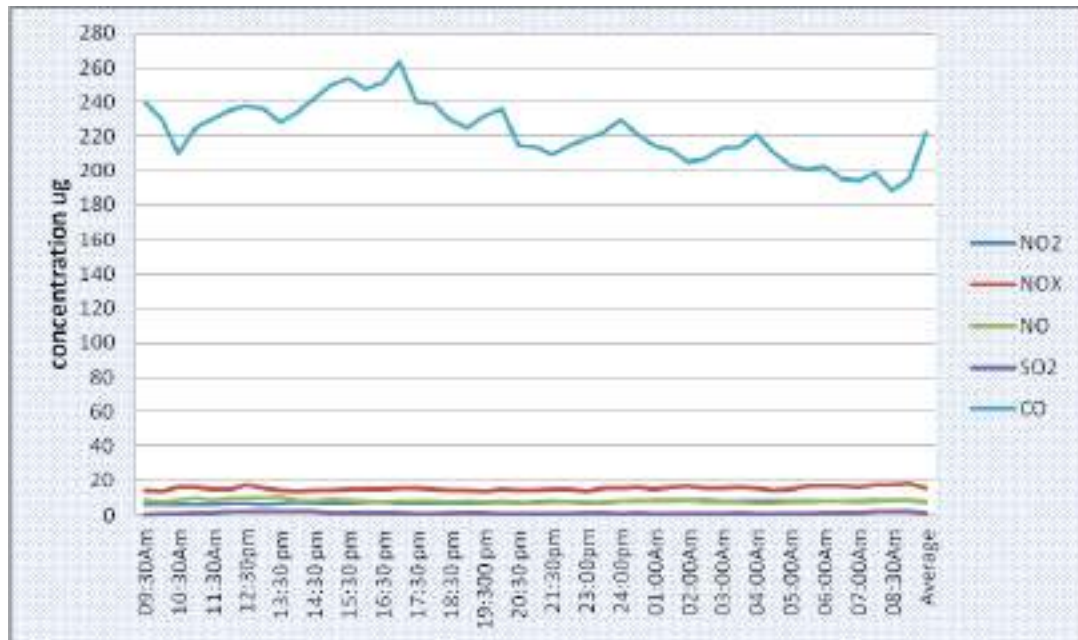


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 27.3.2016

هاتف: +962-6-5350650 فاكس +962-6-5330434 خلوي +962-79-5758689 +962-777-296305
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Quality Data

Date : 28.03.2016

Geographical Position: 32.11923 N and 036.12859 E

Duration (24 Hours)

Weather Condition: (Rainy, Wind direction: West, Wind speed = 18 km/hr.
Humidity: 87% and Temperature: 14°C)

Table 1.1
Average Air Quality Levels (in $\mu\text{g}/\text{m}^3$) with respect to 24-hourly average Standard

S.N	Parameters	Unit	Concentrations (Readings)			Maximum Allowable Concentration ($\mu\text{g}/\text{m}^3$)
			Average	Min	Max	
1	PM ₁₀	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	31.5	26.8	33.8	120
2	PM _{2.5}	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	18.3	16.0	21.3	65
3	SO ₂	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	1.01	0.20	1.80	20*
4	NO	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	6.70	0.00	7.60	
5	NO ₂	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	5.80	5.2	6.70	200*
6	NO _x	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	13.40	11.30	14.60	
7	CO	$\mu\text{g}/\text{m}^3/24 \text{ Hrs.}$	208.60	187.90	238.80	15000*

* WHO Ambient Air Quality Standard

الأكاديمية الوطنية للبيئة
National Academy for Environment

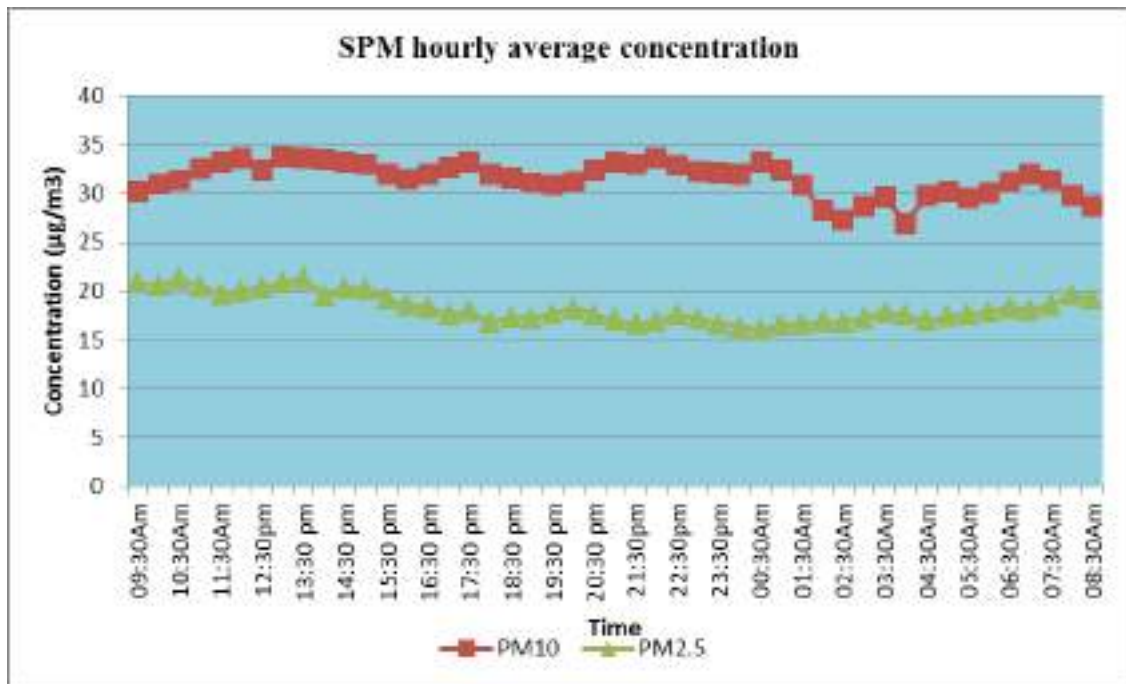


Figure1: PM₁₀ and PM_{2.5} concentrations (24- hour average) 28.3.2016

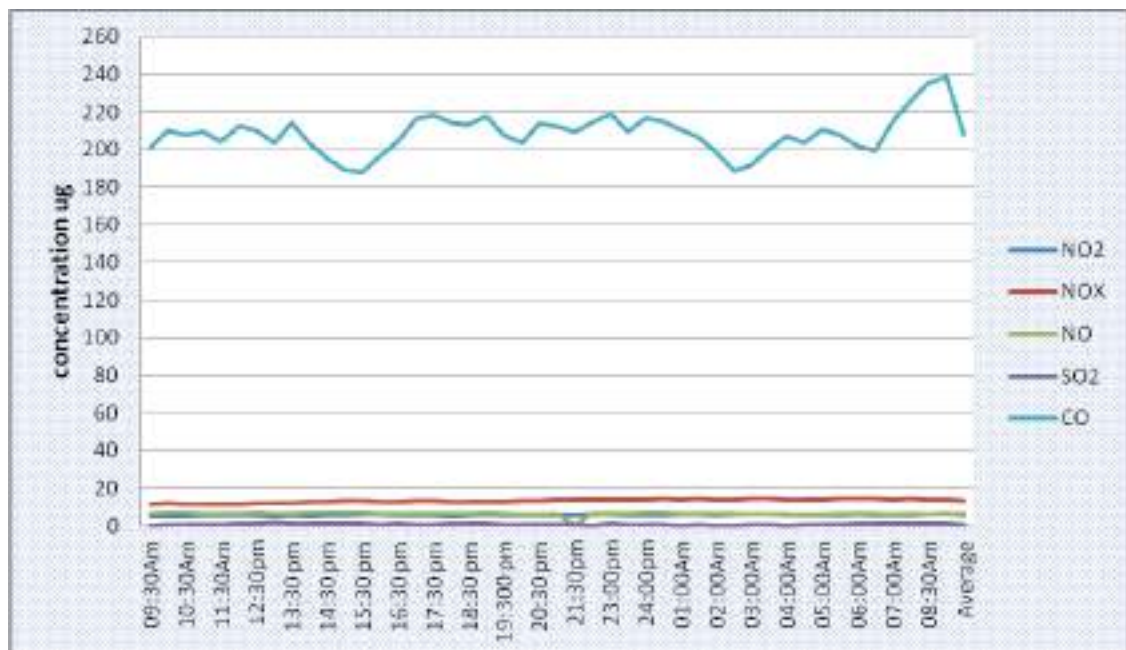


Figure 2: CO, SO₂, NO, NO₂, NO_x, Concentrations (24-hour average) 28.3.2016

هاتف: +962-777-296305 +962-79-5758689 خلوي +962-6-5330434 فاكس +962-6-5350650
بريد الكتروني: abja958@orange.jo ص.ب. 2358 الجبيلة 11941 عمان- الاردن

Ambient Air Analysis

- The concentration of PM₁₀ and PM_{2.5} at monitoring site was found below the Maximum Allowable Concentration limits.
- The concentration of CO, SO₂, and NO₂ at monitoring site was found below the Maximum Allowable Concentration limits.

Note: All measurements were performed at 1.5 meter above ground level.

No Exceedences noted during monitoring period for all measurements.



Appendix I

Predictive Emissions Dispersion Modelling Report

**ACWA Power Zarqa CCGT Project,
Zarqa, Jordan**

Air Quality Impact Assessment





ACWA Power Zarqa CCGT Project, Zarqa, Jordan

Air Quality Impact Assessment

Revision	Date	Notes	Author	Checked	Approved
1	11/04/16	E1766	SD	ND	Dr N Davey

**Entran Limited
12 Greenway Farm
Bath Road
Wick
Bristol
BS30 5RL**

**T: 0117 937 4077
www.entranltd.co.uk**



CONTENTS

PAGE

1	Introduction	2
2	Legislation, Policy and Assessment Criteria	4
3	Assessment Methodology	10
4	Baseline Conditions	17
5	Predicted Impact (Normal Gas-fired Operation)	20
6	Predicted Impact (Light Diesel Oil)	26
7	Mitigation Measures	38
8	Summary and Conclusions	39
APPENDIX A - AIR QUALITY TERMINOLOGY		40
APPENDIX B - STACK EMISSION PARAMETERS		41

1 INTRODUCTION

1.1 Entran Ltd has been commissioned to undertake an assessment of the predicted local air quality impacts arising from the operation of the proposed ACWA Power Zarqa CCGT Project in Zarqa, Jordan.

1.2 The project location is presented in Figure 1; the Site boundary is shown in yellow and the Project area in purple). The Site is located in an industrial area, approximately 25 km northeast of Amman and 4km northeast of the centre of Zarqa. The nearest sensitive residential receptor (Hashmiyeh) is approximately 250m north of the Site.

Figure 1: Location of the Project



1.3 The proposed power block will comprise three gas turbines, three heat recovery steam generators (HRSG) and one steam turbine. The typical operational regime of the plant will be combined cycle, whereby the gas turbines operate in parallel with the HRSGs and steam turbine. Emissions to air would be via a 60 m main stack (4.8 m in diameter).

1.4 In simple cycle mode, emissions from the gas turbines would vent directly to air via a 45 m (5.4 m diameter) bypass stack.

1.1 The primary fuel for the project will be natural gas, with light distillate oil (LDO) as a back-up fuel.



1.2 The impact on air quality of the new turbines in both combined and simple cycle mode, using both natural gas and LDO has been assessed.

1.3 A detailed air quality dispersion modelling assessment has been undertaken to determine impacts associated with the proposed. Dispersion modelling has been carried out using the United States (US) Environmental Protection Agency (EPA) AERMOD dispersion model and three years of meteorological data from Amman Airport (2013 to 2015). This is the most recent data available for the area that is suitable for dispersion modelling.

1.4 The key pollutants considered in this assessment are: oxides of nitrogen (NO_x as NO₂), particles (as PM₁₀), sulphur dioxide (SO₂) and carbon monoxide (CO). Predicted ground-level concentrations are compared with relevant air quality standards and guidelines.

1.5 A background monitoring study has been undertaken around the proposed project to establish current air quality conditions to determine potential cumulative impacts at receptor locations.

1.6 A glossary of common air quality terminology is provided in **Appendix A**.

2 LEGISLATION, POLICY AND ASSESSMENT CRITERIA

The Hashemite Kingdom of Jordan Ministry of Environment

2.1 Emissions of NO_x and SO₂ from the project will be compliant with the Jordanian emission standards¹, as detailed in Table 2.1.

Table 2.1: Jordanian Maximum Permissible Emission Rates

Pollutant	Averaging Period	Guideline Value (mg/m ³)
Nitrogen Dioxide	1-hour	1,500
Sulphur Dioxide	1-hour	6,500

2.2 Ambient air quality standards for Jordan are specified in JS 1140/2006. The standards for NO₂, CO, SO₂ and PM₁₀ are presented in Table 2.2.

Table 2.2: Jordanian Air Quality Standards for Ambient Air Quality

Pollutant	Averaging Period	ppm	µg/m ³
Carbon Monoxide	8-hour	9	9,920 (a)
	1-hour	26	28,708 (a)
Nitrogen Dioxide	1-hour	-	400
	24-hour	0.08	145 (a)
	Annual	0.05	91 (a)
Sulphur Dioxide	1-hour	-	786
	24-hour	0.14	353
	Annual	-	114
Particulate Matter (as PM ₁₀)	24-hour	-	120
	Annual	-	70
(a) Conversion from ppm to µg/m ³ assumes an ambient temperature of 36°C and atmospheric pressure of 101.3 kPa			

International Finance Corporation World Bank Group

2.3 The IFC Guidelines² recommend the use of national legislated standards, or in their absence, the current World Health Organisation (WHO) Air Quality Guidelines.



2.4 A summary of the IFC guideline values for NO₂, SO₂ and PM₁₀ is provided in Table 2.3. In addition to the guideline values the IFC also specifies interim targets for SO₂ and PM₁₀ in recognition of the need for a staged approach to achieving the guideline value.

Table 2.3: IFC Guideline Values

Pollutant	Averaging Period	Guideline Value (µg/m ³)
Nitrogen Dioxide	1-year	40
	1-hour	200
Sulphur Dioxide	24-hour	125 (Interim target 1)
		50 (Interim target 2)
		20
	10-minute	500
Particulate Matter (as PM ₁₀)	1-year	70 (Interim target 1)
		50 (Interim target 2)
		30 (Interim target 3)
		20
	24-hour	150 (Interim target 1)
		100 (Interim target 2)
		75 (Interim target 3)
		50

The Equator Principles

2.5 The Equator Principles provides a set of standards for financial investors to assess the social and environmental risk of a project. In air quality terms, a proposed facility satisfies the Equator Principles if compliance with the IFC air quality guideline values is demonstrated.

Degraded Airsheds

2.6 The term 'Airshed' refers to the local area around a facility or complex of facilities that is directly affected by emissions from the facility or complex. There are a number of factors that can potentially affect the size of a relevant airshed, including plant characteristics, stack height, meteorological conditions and topography.

¹ JS 1189/2006

² International Finance Corporation World Bank Group, General EHS Guidelines: Environmental. Air Emissions and Ambient Air Quality, April 2007.



2.7 For new power plants in degraded airsheds, the IFC³ states that new facilities should minimise incremental impacts by achieving the emission values set out in Table 2.4. The IFC also state that where these emission values result in excessive ambient impacts relative to local regulatory standards, the project should explore and implement site-specific off-sets that result in no net increase in the total emissions of those pollutants. Off-set provisions should be implemented before the power plant comes fully on stream.

2.8 Suitable offset measures could include reductions in emissions of particulate matter, sulphur dioxide or nitrogen dioxide, as necessary through:

(a) *the installation of new or more effective controls at other units within the same power plant or at other power plants in the same airshed,*

(a) the installation of new or more effective controls at other large sources, such as district heating plants or industrial plants, in the same airshed, or

(b) investments in gas distribution or district heating systems designed to substitute for the use of coal for residential heating and other small boilers.

2.9 In addition, the IFC guidance states that:

emissions from a single project should not contribute more than 25% of the applicable ambient air quality standards to allow additional, future sustainable development in the same airshed.

³ International Finance Corporation World Bank Group (December 2008), Environmental, Health and Safety Guidelines for Thermal Power Plants.



Table 2.4: World Bank Emission Guidelines for Combustion Turbines (mg/Nm³)

Note:							
<ul style="list-style-type: none">- Guidelines are applicable for new facilities- EA may justify more stringent or less stringent limits due to ambient environment, technical and economic considerations provided there is compliance with applicable ambient air quality standards and incremental impacts are minimised.- For projects to rehabilitate existing facilities, case-by-case emission requirements should be established by the EA considering (i) the existing emission levels and impacts on the environment and community health, and (ii) cost and technical feasibility of bringing the existing emission levels to meet these new facilities limits.- EA should demonstrate that emissions do not contribute a significant portion to the attainment of relevant ambient air quality guidelines or standards, and more stringent limits may be required.							
Combustion Technology/ Fuel	Particulate Matter (PM)		Sulphur dioxide (SO₂)		Nitrogen oxides (NOx)		Dry Gas, Excess O₂ Content (%)
	NDA	DA	NDA	DA	NDA	DA	
Boiler	NDA	DA	NDA	DA	NDA	DA	
Natural Gas (all turbine types of Unit >50MWth)	N/A	N/A	N/A	N/A	51	51	15%
Other Fuels (Unit > 50MWth)	50	30	Use of 1% or less S fuel	Use of 0.5% or less S fuel	152 (a)	152 (a)	15%

General Notes:

- MWth = Megawatt thermal input on HHV basis; N/A/ = Not applicable; NDA = Non-degraded airshed; DA = Degraded airshed (poor air quality); Airshed should be considered as being degraded if nationally legislated air quality standards are exceeded or, in their absence, if WHO Air Quality Guidelines are exceeded significantly; S = sulphur content (expressed as percent by mass); Nm³ is at one atmosphere pressure, 0 degrees Celsius, MWth category is to apply to the entire facility consisting of multiple units that are reasonably considered to be emitted from a common stack. Guideline limits to apply to facilities operating more than 500 hrs per year. Emission levels should be evaluated on a one hour average basis and be achieved 95% of annual operating hours.
- If supplemental firing is used in a combined cycle gas turbine mode, the relevant guideline limits for combustion turbines should be achieved including emissions from those supplemental firing units (e.g., duct burners).
- (a) Technological differences (for example the use of Aero-derivatives) may require different emissions values which should be evaluated on a cases-by-case basis through the EA process but which should not exceed 200 mg/Nm³.

Comparison of the Guideline limits with standards of selected countries / region (as of August 2008):

- Natural Gas-fired Combustion Turbine – NOx
 - o Guideline limits: 51 (25 ppm)
 - o EU: 50 (24 ppm), 75 (37 ppm) (if combined cycle efficiency > 55%), 50*η / 35 (where η = simple cycle efficiency)
 - o US: 25 ppm (> 50 MMBtu/h (≈ 14.6 MWth) and ≤ 850 MMBtu/h (≈ 249MWth)), 15 ppm (> 850 MMBtu/h (≈ 249 MWth))
 - o (Note: further reduced NOx ppm in the range of 2 to 9 ppm is typically required through air permit)
- Liquid Fuel-fired Combustion Turbine – NOx
 - o Guideline limits: 152 (74 ppm) – Heavy Duty Frame Turbines & LFO/HFO, 300 (146 ppm) – Aero-derivatives & HFO, 200 (97 ppm) – Aero-derivatives & LFO
 - o EU: 120 (58 ppm), US: 74 ppm (> 50 MMBtu/h (≈ 14.6 MWth) and ≤ 850 MMBtu/h (≈ 249MWth)), 42 ppm (> 850 MMBtu/h (≈ 249 MWth))
- Liquid Fuel-fired Combustion Turbine – SOx
 - o Guideline limits: Use of 1% or less S fuel
 - o EU: S content of light fuel oil used in gas turbines below 0.1% / US: S content of about 0.05% (continental area) and 0.4% (non-continental area)

Source: EU (LCP Directive 2001/80/EC, October 23 2001), EU (Liquid Fuel Quality Directive 1999/32/EC, 2005/33/EC), US (NSPS for Stationary Combustion Turbines, Final Rule – July 6, 2006)



European Standards

2.10 The project is seeking funding from the European Bank for Reconstruction and Development (EBRD) and will therefore require compliance with European environmental standards. On this basis it is proposed that emissions from the Project will be compliant with the Industrial Emissions Directive⁴ standards, which are extremely stringent compared with those specified by JS 1189/2006. The NO_x and CO emission limit values for new gas turbines using both natural gas and light/ middle distillates are 50 mg/Nm³ and 100 mg/Nm³ respectively (referenced to 15% O₂), however the emission limits are not applicable to operations occurring for less than 500 hours per year (e.g. back-up operation).

2.11 European Directive 2008/50/EC of the European Parliament and of the Council of 21st May 2008, sets legally-binding limit values for the protection of public health and sensitive habitats. The EU limit values for NO₂, SO₂, CO and PM₁₀ are presented in Table 2.5.

Table 2.5: EU Limit Values

Pollutant	Averaging Period	AQS (µg/m ³)	Comments
Nitrogen Dioxide (NO ₂)	annual	40	-
	1-hour	200	Not to be exceeded more than 18 times per annum, equivalent to the 99.8 th percentile of 1-hour means
Sulphur Dioxide (SO ₂)	24-hour	125	Not to be exceeded more than 3 times per annum, equivalent to the 99.2 nd percentile of 24-hour means
	1-hour	350	Not to be exceeded more than 24 times per annum, equivalent to the 99.7 th percentile of 1-hour means
Carbon Monoxide (CO)	8-hour	10,000	-
Particulate Matter (as PM ₁₀)	annual	40	-
	24-hour	50	UK AQO, not to be exceeded more than 35 times per annum, equivalent to the 90.4 th percentile of 24-hour means

Assessment Ambient Air Quality Standards

2.12 For the purposes of this assessment, the air quality standards (AQS) that have been applied are provided in Table 2.6. The standards referenced in the table below relate to the most

⁴ The Industrial Emissions Directive, 2010/75/EU



stringent standards when considering the Jordanian, IFC and EU standards/guideline for each parameter, per averaging period.

Table 2.6: Air Quality Standards Adopted for the Air Quality Assessment

Pollutant	Averaging Period	Air Quality Standard ($\mu\text{g}/\text{m}^3$)
Nitrogen Dioxide	Annual	40
	24-hour	145
	1-hour	200
Sulphur Dioxide	Annual	114
	24-hour	125
	1-hour	350
	10 minute	500
Particulate Matter (as PM_{10})	Annual	40
	24-hour	50
Carbon Monoxide	8-hour	9,920
	1-hour	28,708



3 ASSESSMENT METHODOLOGY

Dispersion Modelling Parameters

3.1 The potential impact of the project on local air quality has been assessed using Breeze AERMOD7, a new generation dispersion model that incorporates the latest understanding of the atmospheric boundary layer.

3.2 The primary emission sources at the site are as follows:

- In combined cycle mode - three main stacks associated with the HRSG; or
- In simple cycle mode - three bypass stacks.

3.3 For normal project operations, the key pollutants arising from natural gas combustion and emitted via the HRSG/ bypass stacks will be nitrogen dioxide (NO_x as NO₂) and CO.

3.4 In the event of a natural gas supply failure or routine maintenance, it is proposed that ultra-low-sulphur diesel oil is used as a back-up fuel, which will result in emissions of sulphur dioxide (SO₂) and particulate matter (PM₁₀) in addition to NO_x and CO.

3.5 The source emission parameters used in the dispersion modelling are presented in **Appendix B**. These data have been provided by the equipment manufacturer in line with the proposed fuel specifications. All stacks will include flue gas sampling ports and regular monitoring will be undertaken using Continuous Emissions Monitoring Systems.

3.6 Dispersion modelling has been carried out for the following operational scenarios:

- Scenario 1 (normal operation) – operation of all three gas turbines using natural gas and in combined cycle mode with emissions via the 60 m tall main stacks.
- Scenario 2 (natural gas and simple cycle mode) – operation of all three gas turbines using natural gas and in the simple cycle mode with emissions via the 45 m tall bypass stacks.
- Scenario 3 (LDO and combined cycle) – operation of all three gas turbines using low sulphur LDO and in combined cycle mode with emissions via the 60 m tall main stacks.
- Scenario 4 (LDO and simple cycle mode) – operation of all three gas turbines using low sulphur LDO and in the simple cycle mode with emissions via the 45 m tall bypass



stacks.

3.7 A summary of the scenarios assessed is presented in Table 3.1.

Table 3.1 – Summary of Scenarios Assessed for the Air Quality Assessment

Scenario	Fuel	Pollutants	Operational Mode	Emissions Via
Scenario 1	Natural gas	NO _x , CO	Combined	Main stacks
Scenario 2	Natural gas	NO _x , CO	Simple	Bypass stacks
Scenario 3	LDO	NO _x , CO, SO ₂ , PM ₁₀	Combined	Main stacks
Scenario 4	LDO	NO _x , CO, SO ₂ , PM ₁₀	Simple	Bypass stacks

3.8 For each scenario, the assessment represents worst-case conditions as it is assumed that the all three gas turbines operate continuously.

Nitric Oxide to NO₂ Conversion

3.9 Oxides of nitrogen (NO_x) emitted to atmosphere as a result of combustion will consist largely (around 90%) of nitric oxide (NO), a relatively innocuous substance. Once released into the atmosphere, NO is oxidised to NO₂. The proportion of NO converted to NO₂ depends on a number of factors including wind speed, distance from the source, solar irradiation and the availability of oxidants, such as ozone (O₃). At locations close to the source where highest concentrations are predicted, the rate of oxidation will be relatively small.

3.10 Typical NO:NO₂ conversion ratios of 70% for long term predictions and 35% for short term predictions have been assumed for comparison with the air quality standards for NO₂.

Local Meteorological Data

3.11 The modelling has been carried out using three years (2013-2015) of hourly sequential meteorological data in order to take account of inter-annual variability and reduce the effect of any atypical conditions. A meteorological station in Amman has been used for the assessment, which is the most representative data currently available for the area. This is located approximately 25 km to the northeast of the project site.

3.12 Wind roses for each of the three years are presented in Figures 3.1 to 3.3 below. These generally show that the prevailing wind direction is from the west; therefore sensitive receptors to

the east of the project are likely to be worst-affected by emissions from the site.

Figure 3.1: Wind Rose for Amman 2013

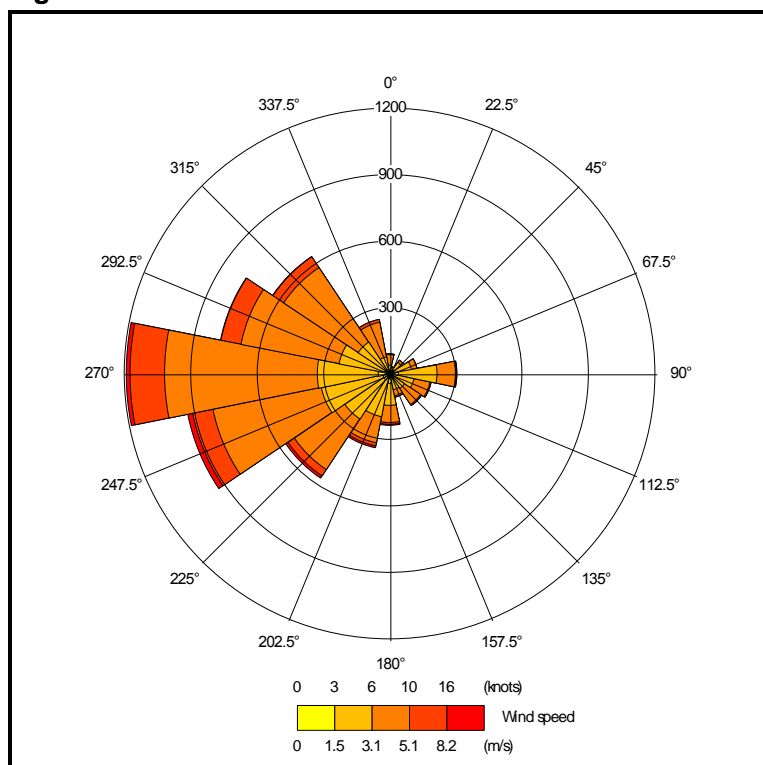


Figure 3.2: Wind Rose for Amman 2014


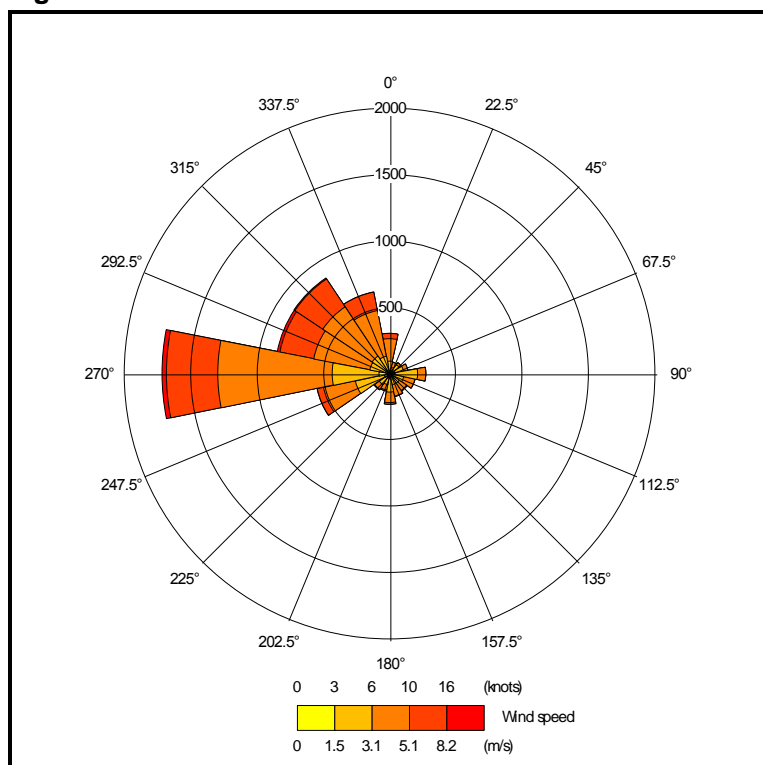


Figure 3.3: Wind Rose for Amman 2015

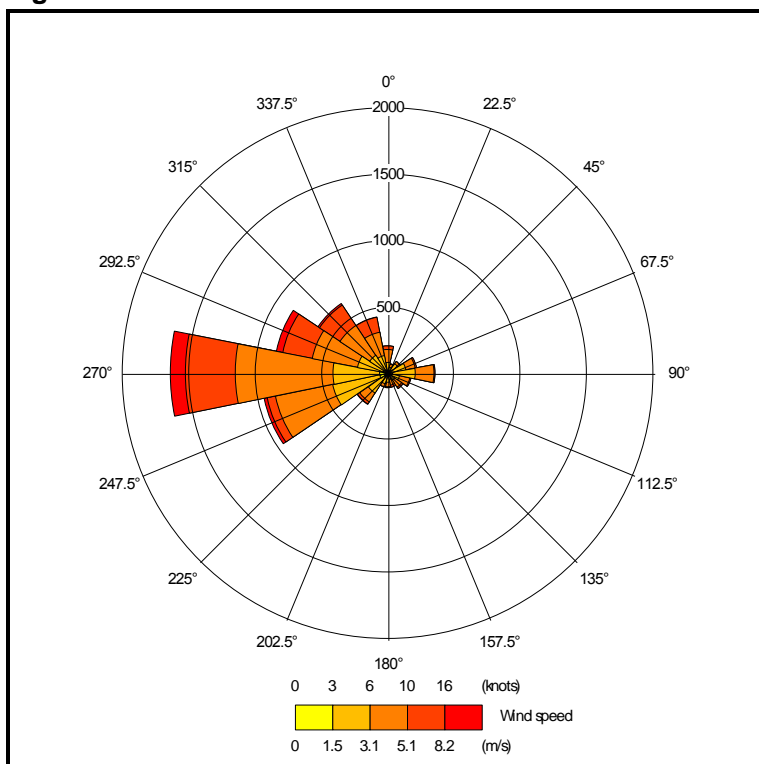

Buildings

3.13 The presence of buildings close to emission sources can significantly affect the dispersion of pollutants by leading to a phenomenon called building downwash. This occurs when a building distorts the wind flow, creating zones of increased turbulence. Increased turbulence causes the plume to come to ground earlier than otherwise would be the case and results in higher ground level concentrations closer to the stack.

3.14 Downwash effects are only significant where building heights are greater than 30 to 40% of the emission release height. The downwash structures also need to be sufficiently close for their influence to be significant.

3.15 The project will include a number of buildings (e.g. HRSGs, electric building, ACC) that have the potential to affect the wind field and these have been included in the dispersion model as downwash structures, along with the old HTPS building.

Terrain

3.16 The area in the immediate vicinity of the site is relatively flat, however there is hilly terrain to the west beyond Zarqa. Topographical data has therefore been included in the model to account



for any terrain related effects.

Sensitive Receptors

3.17 Specific receptors have been identified where people are likely to be regularly exposed for prolonged periods of time (e.g. residential areas). The location of the discrete sensitive receptors is presented in Table 3.2 and Figure 3.4.

Table 3.2: Location of Sensitive Receptors

ID	Receptor	Type	Location Relative to Proposed Power Block Area
1	NEPCO Training Centre	Commercial	0.2km south
2	Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	Residential	0.25km north
3	Zarqa Cemetery	Cultural	0.5km south-southeast
4	CEGCO Engineers Accommodation	Residential	0.65km southwest
5	Agricultural Land	Agriculture	1km southeast
6	Petrochemical Refinery	Industrial	1.5km west
7	Steelworks	Industrial	1.7m southeast
8	Education Centre	Educational	1.75km southwest
9	Residential Cluster (Hashmiyeh)	Residential	1.7km northwest
10	Sports Stadium	Recreational	2.5km southwest
11	North Zarqa (Residential)	Residential	4.1km southwest
12	Wastewater Treatment Facility	Industrial	5km northeast

Figure 3.4: Sensitive Receptor Locations



3.18 Pollutant concentrations have been predicted at both discrete receptor locations and over a 8km by 6 km Cartesian grid of 100m resolution.

Significance Criteria

3.19 There are no local planning policies that provide limits for acceptable impacts from proposed facilities in Jordan. The UK Environment Agency has developed criteria for assessing the significance of an impact compared with relevant air quality standards and background air quality. A process contribution (PC) is considered significant if:

- The long-term PC > 1% of the long-term air quality standard
- The short-term PC > 10% of the short-term air quality standard



3.20 At 1% of the long-term air quality standard, the impact of a development is unlikely to be significant compared with background air quality. Both the short-and long term criteria are also designed to ensure that there is a substantial safety margin to protect public health and the environment.

3.21 If the above criteria are not met, the PC should be considered in combination with relevant ambient background pollutant concentrations. The air quality standards are likely to be met if:

- The long-term PC + background concentration < 70% of the air quality standard
- The short-term PC < 20% (air quality standard – short-term background concentration), where the short-term background concentration is assumed to be twice the long-term background concentration

4 BASELINE CONDITIONS

Diffusion Tube Monitoring

4.1 Ambient concentrations of SO_2 and NO_2 were measured by passive diffusion tube at six locations (A-1 to A-6) in support of this Project. The location of the tubes is presented in Figure 4.1.

4.2 Two tubes were exposed at each location for a period of 27 days (27th January 2016 to 23rd February 2016). The measured data are considered to provide an indication of long-term background concentrations at the site.

Figure 4.1: Diffusion Tube Locations



4.3 The measured 27-day mean SO_2 and NO_2 concentrations are presented in Table 4.1.



Table 4.1: 27-Day Mean Concentrations of NO₂ and SO₂ Measured by Diffusion Tube (µg/m³)

ID	NO ₂		SO ₂	
	Tube A	Tube B	Tube A	Tube B
A-1	16.7	16.1	22.0	20.5
A-2	15.7	15.2	14.6	17.9
A-3	24.5	24.2	41.7	38.1
A-4	16.4	18.2	9.6	12.9
A-5	18.3	16.5	17.6	10.6
A-6	15.6	16.2	18.7	19.9
Airshed Average	17.8		20.3	
Long-Term Air Quality Standard	40		114	

4.4 The data indicate that existing long term NO₂ and SO₂ concentrations in the area are likely to be within the relevant air quality standards. The highest concentrations were measured by tube A-3, which is located on the western site boundary adjacent to the highway, and is likely to be strongly affected by both traffic and emissions from the petrochemical refinery to the east.

Automatic Monitoring

4.5 Continuous monitoring of NO₂, PM₁₀, CO and SO₂ has been undertaken at the Project site (32.11923 N, 036.12859 E) to provide an indication of existing short-term concentrations in the area. The monitoring was carried out between the 22nd and 29th March 2016 and reported as the average concentration measured over each 24-hour period for NO₂, PM₁₀ and SO₂. For CO, the data is reported as the 8-hour mean.

4.6 A summary of the 24-hour mean concentrations measured over the five day period is presented in Table 4.2.



Table 4.2: Concentrations of NO₂, SO₂, PM₁₀ and CO Measured by Continuous Monitor at the Project Site (µg/m³)

Day	24-Hour Mean			8-Hour Mean
	NO ₂	SO ₂	PM ₁₀	CO
1	7.0	1.4	39.2	252
2	7.7	1.5	42.6	257
3	8.1	1.5	43.0	268
4	9.1	1.9	53.9	277
5	8.0	1.5	37.7	248
Air Quality Standard	145	125	50	9920

4.7 The monitoring data indicate that existing 24-hour mean NO₂, SO₂ and CO concentrations are well within the relevant air quality standards. The measured NO₂ and SO₂ concentrations are somewhat lower than the 27-day mean concentrations measured diffusion tube, possibly indicating that conditions over the five day monitoring period were atypical.

4.8 The 24-hour mean PM₁₀ concentration exceeded the EU limit value on one day. The air quality standard permits 35 exceedences of the limit value per year, however a considerably longer monitoring period would be required to determine whether a significant number of exceedences are likely to occur. It should be noted that the 24-hour mean PM₁₀ concentrations are well within the Jordanian air quality standard of 70 µg/m³.

Summary of Baseline Monitoring Data

4.9 A review of the local monitoring data indicates that existing NO₂, SO₂ and CO concentrations in the immediate vicinity of the project are likely to be well within the relevant air quality standards. The airshed is therefore not considered to be degraded with respect to these pollutants.

4.10 The data indicate that there is the potential for short-term exceedences of the EU limit value for PM₁₀, however this would not be considered unusual in areas characterised by a dry, windy climate.



5 PREDICTED IMPACT (NORMAL GAS-FIRED OPERATION)

Introduction

5.1 Concentrations of NO₂, PM₁₀, SO₂ and CO due to emissions from the proposed project are presented as the maximum predicted over the three years of meteorological data. The concentrations are compared with the relevant air quality standards to determine the significance of the impact.

Scenario 1 (Natural Gas, Combined Cycle)

Nitrogen Dioxide (NO₂)

5.2 The maximum predicted NO₂ concentration at identified sensitive receptor locations is presented in Table 5.1 for Scenario 1 (natural gas, combined cycle). This represents the normal operational scenario.

Table 5.1: Maximum Predicted NO₂ Concentrations – Natural Gas, Combined Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean	1-Hour Mean
NEPCO Training Centre	0.26	0.83	4.3
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	0.27	0.71	3.8
Zarqa Cemetery	0.65	1.6	6.0
CEGCO Engineers Accommodation	0.32	1.0	5.6
Agricultural Land	0.41	1.0	3.5
Petrochemical Refinery	0.17	0.70	3.0
Steelworks	0.37	0.87	4.6
Education Centre	0.10	0.35	2.1
Residential Cluster (Hashmiyeh)	0.14	0.77	3.2
Sports Stadium	0.051	0.19	2.2
North Zarqa (Residential)	0.041	0.15	1.8
Wastewater Treatment Facility	0.13	0.39	1.9
Maximum PC	0.65	1.6	6.0
Air Quality Standard	40	145	200
PC as a %age of AQS	1.6%	1.1%	3.0%

5.3 The maximum predicted annual mean NO₂ concentrations are considered to be potentially significant since they exceed 1% of the IFC and EU guideline/ limit value of 40 µg/m³. However, the local monitoring data indicates that existing NO₂ concentrations in the area are well within the standard and therefore the risk of an exceedence during normal, gas-fired, combined cycle operation at the project is considered to be *negligible*.

5.4 The predicted short-term NO₂ impacts are less than 10% of the relevant air quality standards and are therefore considered to be of *negligible* significance.

5.5 The predicted NO₂ concentrations are also presented as contour plots in Figures 5.1, 5.2 and 5.3 for the year in which maximum impacts occur (2014).

5.6 Maximum annual mean impacts occur to the east of the project, which is primarily occupied by industrial and commercial sites, where there will be no relevant long-term exposure.

5.7 The influence of the local topography is evident in the short-term concentrations with maximum impacts occurring over the higher ground, approximately 1km north-northeast of the proposed power blocks.

Figure 5.1: Predicted Annual Mean NO₂ Concentrations (µg/m³) – Natural Gas, Combined Cycle

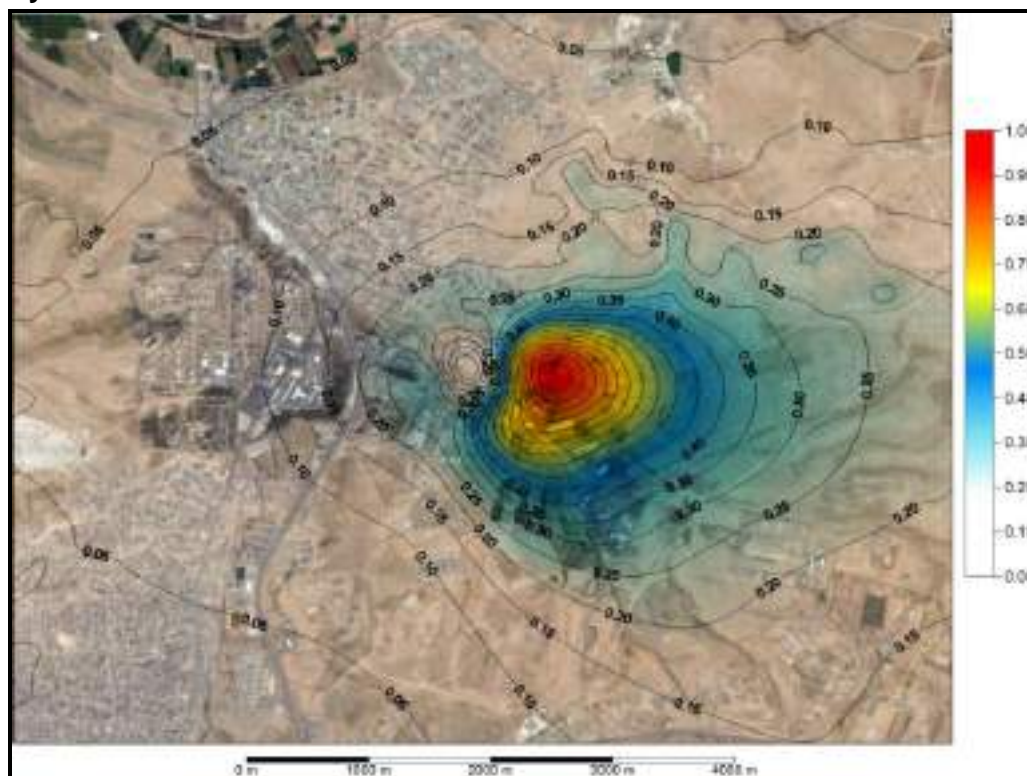


Figure 5.2: Predicted Maximum 24-Hour Mean NO₂ Concentrations (µg/m³) – Natural Gas, Combined Cycle


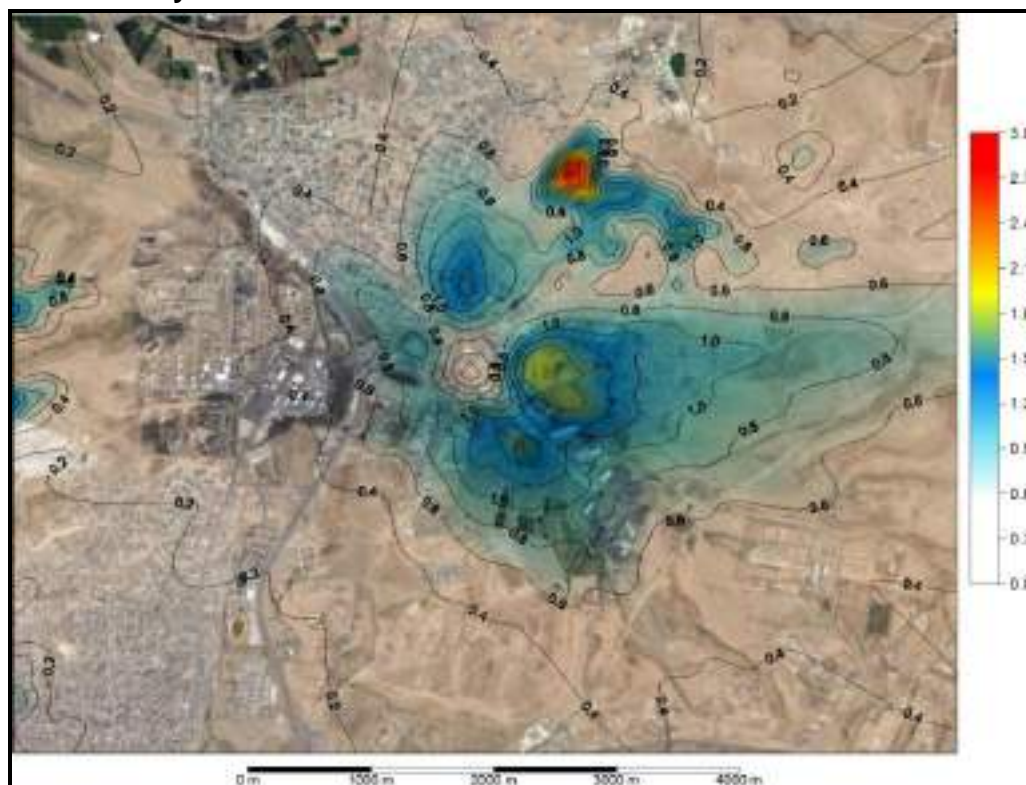


Figure 5.3: Predicted Maximum 1-Hour Mean NO₂ Concentrations (µg/m³) – Natural Gas, Combined Cycle



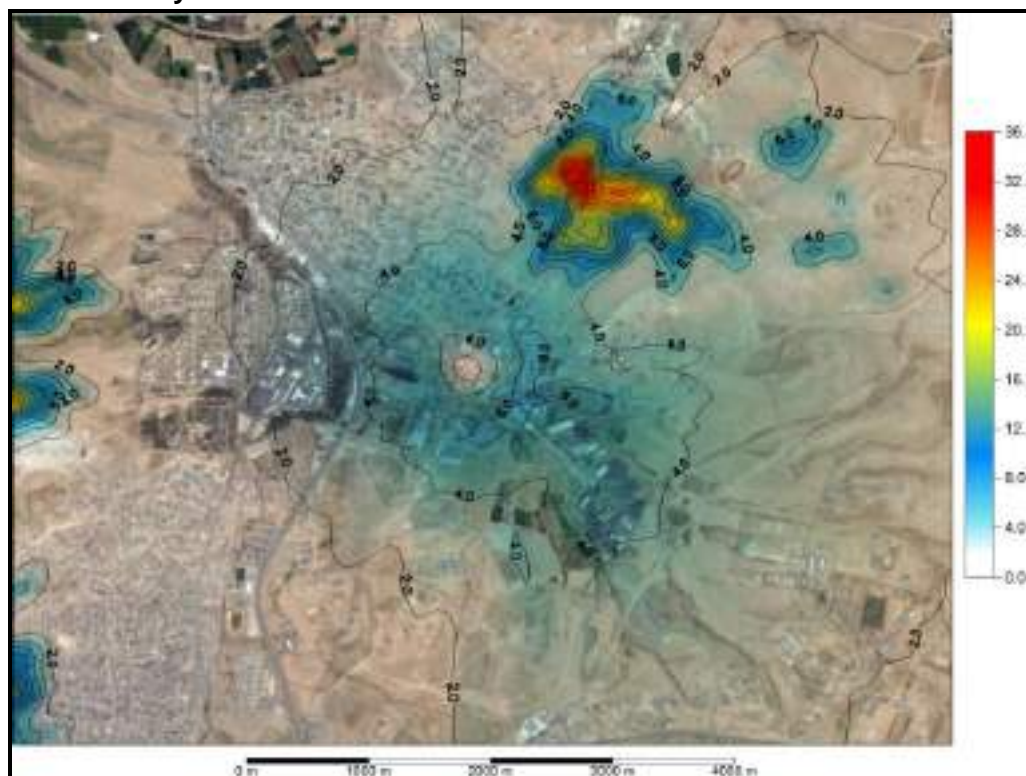

Carbon Monoxide (CO)

5.8 Predicted maximum ground-level mean CO concentrations as 8-hour and 1-hour means are presented in Table 5.2.

Table 5.2: Maximum Predicted CO Concentrations – Natural Gas, Combined Cycle ($\mu\text{g}/\text{m}^3$)

Receptor	8-Hour Mean	1-Hour Mean
NEPCO Training Centre	5.8	11.7
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	4.0	10.4
Zarqa Cemetery	7.2	16.3
CEGCO Engineers Accommodation	6.9	15.2
Agricultural Land	5.6	9.5
Petrochemical Refinery	3.6	8.1
Steelworks	5.1	12.7
Education Centre	2.4	5.7
Residential Cluster (Hashmiyeh)	5.2	8.7
Sports Stadium	1.3	5.9
North Zarqa (Residential)	1.1	4.9
Wastewater Treatment Facility	1.7	5.1
Maximum PC	7.2	16.3
Air Quality Standard	9,920	28,708
PC as a %age of AQS	0.073%	0.057%

5.9 The impact of the proposed project under normal operation is less than 10% of the relevant air quality standard at all receptor locations and is therefore considered to be of *negligible* significance.

Scenario 2 (Natural Gas, Simple Cycle)

Nitrogen Dioxide (NO_2)

5.10 The maximum predicted NO_2 concentration at identified sensitive receptor locations is presented in Table 5.3 for Scenario 2 (natural gas, simple cycle).



Table 5.3: Maximum Predicted NO₂ Concentrations – Natural Gas, Simple Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean	1-Hour Mean
NEPCO Training Centre	0.087	0.27	1.2
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	0.11	0.28	1.3
Zarqa Cemetery	0.22	0.55	2.3
CEGCO Engineers Accommodation	0.081	0.31	1.9
Agricultural Land	0.16	0.45	1.8
Petrochemical Refinery	0.054	0.26	1.4
Steelworks	0.15	0.40	1.4
Education Centre	0.034	0.13	1.0
Residential Cluster (Hashmiyeh)	0.045	0.32	1.4
Sports Stadium	0.021	0.073	0.75
North Zarqa (Residential)	0.020	0.062	0.57
Wastewater Treatment Facility	0.060	0.16	0.85
Maximum PC	0.22	0.55	2.3
Air Quality Standard	40	145	200
PC as a %age of AQS	0.54%	0.38%	1.1%

5.11 The maximum predicted NO₂ concentrations due to gas-fired simple-cycle operation at the project are less than 1% and 10% of the relevant AQSs, therefore the significance of the impact is considered to be *negligible*.

Carbon Monoxide (CO)

5.12 Predicted maximum ground-level mean CO concentrations as 8-hour and 1-hour means are presented in Table 5.4.



Table 5.4: Maximum Predicted CO Concentrations – Natural Gas, Simple Cycle ($\mu\text{g}/\text{m}^3$)

Receptor	8-Hour Mean	1-Hour Mean
NEPCO Training Centre	1.9	3.4
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	1.7	3.6
Zarqa Cemetery	2.9	6.3
CEGCO Engineers Accommodation	2.1	5.1
Agricultural Land	2.7	4.9
Petrochemical Refinery	1.6	3.7
Steelworks	2.7	3.8
Education Centre	1.1	2.8
Residential Cluster (Hashmiyeh)	2.2	3.9
Sports Stadium	0.51	2.1
North Zarqa (Residential)	0.41	1.6
Wastewater Treatment Facility	0.60	2.3
Maximum PC	2.9	6.3
Air Quality Standard	9,920	28,708
PC as a %age of AQS	0.029%	0.039%

5.13 The impact of the proposed project is less than 10% of the AQS at all receptor locations and is therefore considered to be of *negligible* significance.



6 PREDICTED IMPACT (LIGHT DIESEL OIL)

Scenario 3 (LDO, Combined Cycle)

Nitrogen Dioxide (NO₂)

6.1 The maximum predicted NO₂ concentration at identified sensitive receptor locations is presented in Table 6.1 for Scenario 3 (LDO, combined cycle).

Table 6.1: Maximum Predicted NO₂ Concentrations – LDO, Combined Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean	1-Hour Mean
NEPCO Training Centre	1.1	3.4	17.9
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	1.1	2.8	15.6
Zarqa Cemetery	2.8	6.9	26.3
CEGCO Engineers Accommodation	1.3	4.2	24.6
Agricultural Land	1.84	4.7	16.2
Petrochemical Refinery	0.73	3.2	14.1
Steelworks	1.6	3.8	20.9
Education Centre	0.43	1.6	8.9
Residential Cluster (Hashmiyeh)	0.61	3.5	15.1
Sports Stadium	0.24	0.87	7.1
North Zarqa (Residential)	0.19	0.66	8.1
Wastewater Treatment Facility	0.60	1.9	8.8
Maximum PC	2.8	6.9	26.3
Air Quality Standard	40	145	200
PC as a %age of AQS	6.9%	4.8%	13.2%

6.2 The maximum predicted annual mean and 1-hour mean NO₂ concentrations are considered to be potentially significant since they exceed 1% and 10% of the air quality standards respectively. However, since existing NO₂ concentrations in the area are relatively low, the risk of an exceedence of any of the air quality standards for NO₂ during back-up, LDO-fired, combined cycle operation at the project is considered to be *negligible*.

6.3 The predicted NO₂ concentrations are also presented as contour plots in Figures 6.1, 6.2

and 6.3 for the year in which maximum impacts occur (2014).

Figure 6.1: Predicted Annual Mean NO₂ Concentrations (µg/m³) – LDO, Combined Cycle

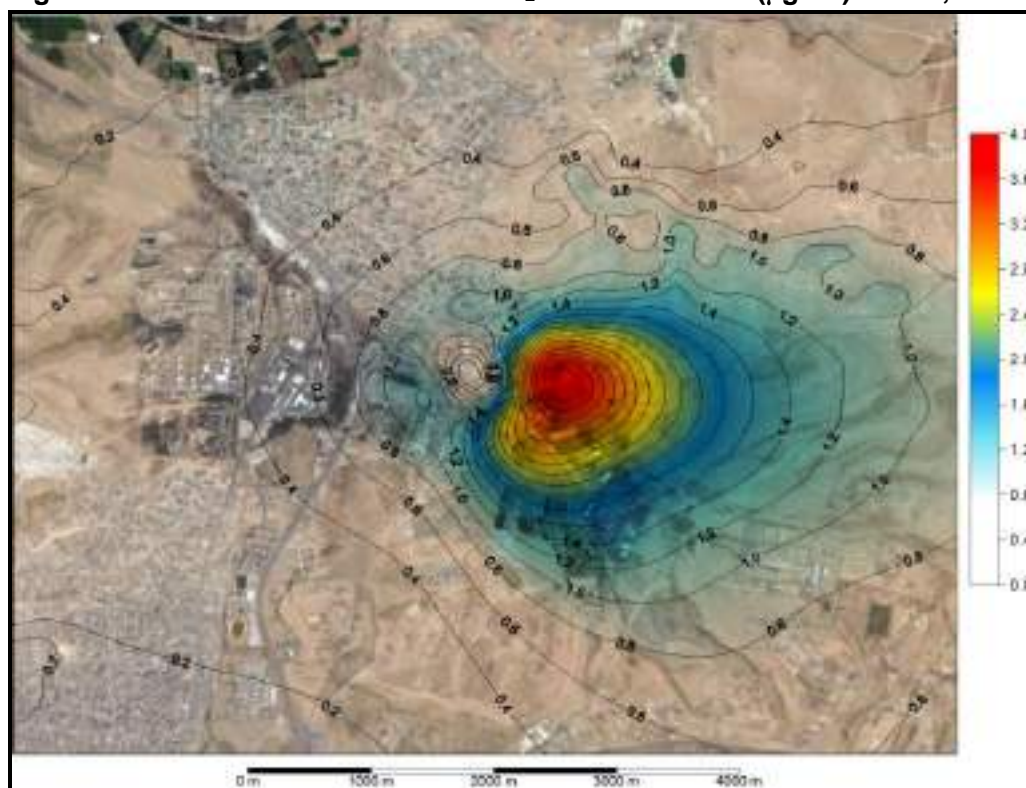


Figure 6.2: Predicted Maximum 24-Hour Mean NO₂ Concentrations (µg/m³) – LDO, Combined Cycle


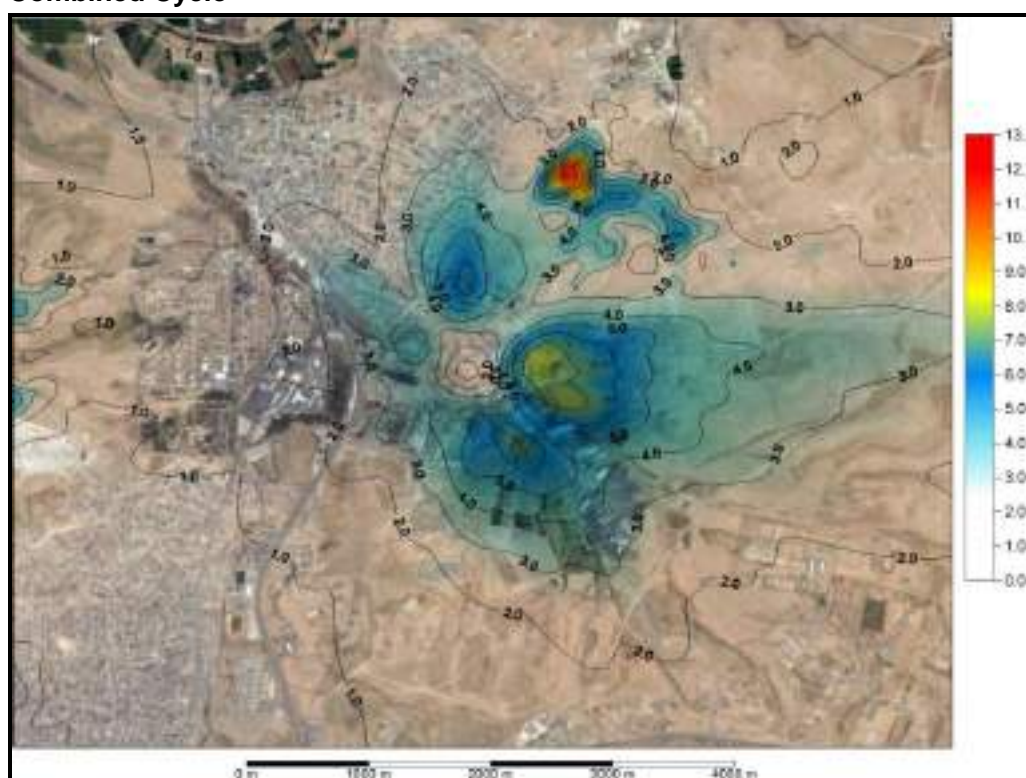


Figure 6.3: Predicted Maximum 1-Hour Mean NO₂ Concentrations (µg/m³) – LDO, Combined Cycle

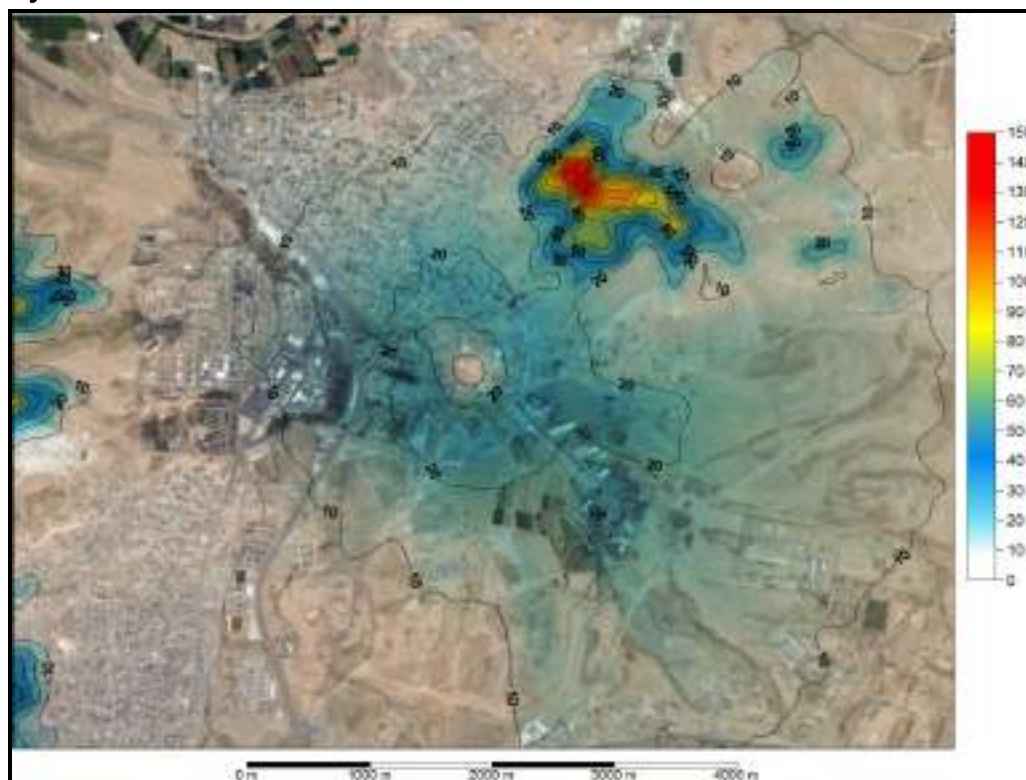

Carbon Monoxide (CO)

6.4 Predicted maximum ground-level mean CO concentrations as 8-hour and 1-hour means are presented in Table 6.2.



Table 6.2: Maximum Predicted CO Concentrations – LDO, Combined Cycle ($\mu\text{g}/\text{m}^3$)

Receptor	8-Hour Mean	1-Hour Mean
NEPCO Training Centre	3.7	7.5
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	2.6	6.6
Zarqa Cemetery	4.9	11.1
CEGCO Engineers Accommodation	4.5	10.4
Agricultural Land	4.0	6.8
Petrochemical Refinery	2.6	5.9
Steelworks	3.7	8.8
Education Centre	1.7	3.7
Residential Cluster (Hashmiyeh)	3.7	6.3
Sports Stadium	0.90	3.0
North Zarqa (Residential)	0.73	3.4
Wastewater Treatment Facility	1.2	3.7
Maximum PC	4.9	11.1
Air Quality Standard	9,920	28,708
PC as a %age of AQS	0.049%	0.039%

6.5 The impact of the proposed project under back-up, combined cycle operation is less than 10% of the relevant AQS at all receptor locations and is therefore considered to be of *negligible* significance.

Sulphur Dioxide (SO_2)

6.6 Predicted maximum ground-level mean SO_2 concentrations are presented in Table 6.3.

**Table 6.3: Maximum Predicted SO₂ Concentrations – LDO, Combined Cycle (µg/m³)**

Receptor	Annual Mean	24-Hour Mean	1-Hour Mean	10-Minute Mean (a)
NEPCO Training Centre	6.6	41.8	219	293
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	6.8	34.0	191	256
Zarqa Cemetery	16.9	84.9	322	431
CEGCO Engineers Accommodation	8.2	51.4	301	404
Agricultural Land	11.2	57.9	198	266
Petrochemical Refinery	4.5	38.8	173	231
Steelworks	10.0	46.9	256	342
Education Centre	2.6	19.8	109	146
Residential Cluster (Hashmiyeh)	3.7	43.0	184	247
Sports Stadium	1.4	10.7	86.3	116
North Zarqa (Residential)	1.2	8.1	98.6	132
Wastewater Treatment Facility	3.7	23.3	108	145
Maximum PC	16.9	84.9	322	431
Air Quality Standard	114	125	350	500
PC as a %age of AQS	14.8%	67.9%	92.0%	86.3%
(a) 10-minute mean estimated by multiplying the 1-hour mean by 1.34 as recommended by UK Environment Agency Guidance.				

6.7 The impact of SO₂ emissions from the proposed project under back-up, combined cycle operation is potentially significant over all averaging periods. However, the predicted process concentrations are within the relevant air quality standards at all receptor locations.

6.8 The 24-hour and 1-hour mean EU limit values for SO₂ permit 3 and 7 exceedences per annum respectively (see Table 2.5). The 99.2nd percentile of 24-hour means at the Zarqa Cemetery (where maximum receptor impacts are predicted) is 61.4 µg/m³, 49.1% of the limit value. The 99.7th percentile of 1-hour means at Zarqa Cemetery is 253 µg/m³, 72% of the limit value.

6.9 Based on the limited existing SO₂ monitoring data for the local area, it is considered unlikely that the air quality standards will be exceeded at any of the identified receptor locations.

6.10 The predicted SO₂ concentrations are also presented as contour plots in Figures 6.4, 6.5, 6.6 and 6.7 for the year in which maximum impacts occur (2014).

Figure 6.4: Predicted Annual Mean SO₂ Concentrations (µg/m³) – LDO, Combined Cycle

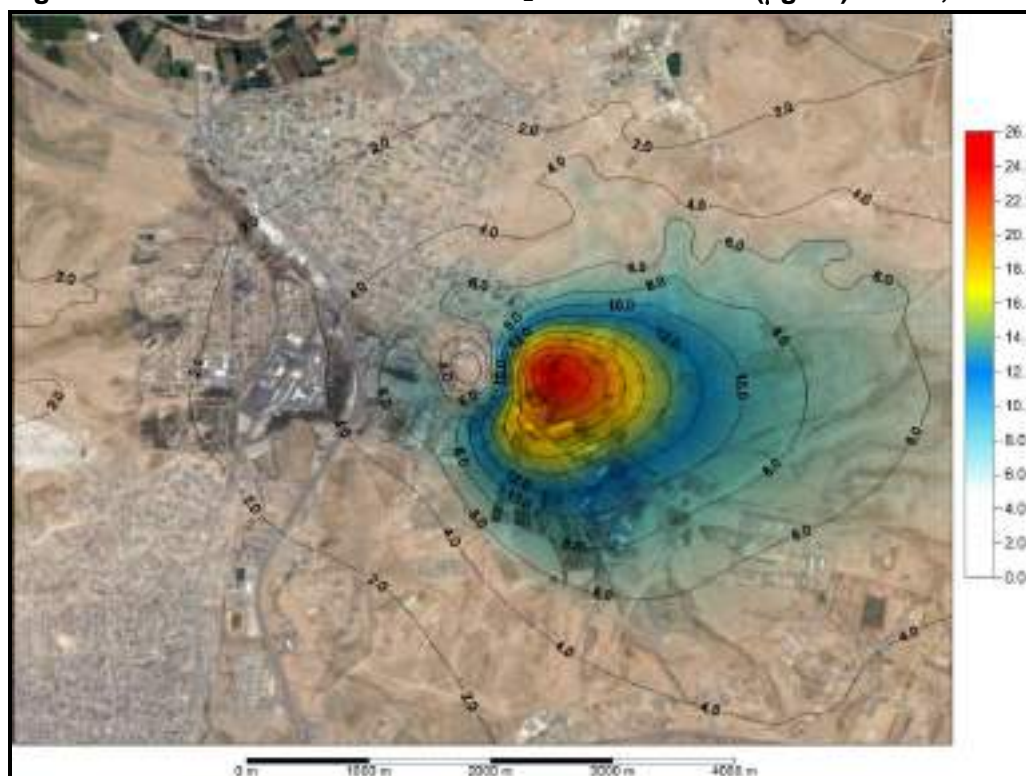


Figure 6.5: Predicted Maximum 24-Hour Mean SO₂ Concentrations (µg/m³) – LDO, Combined Cycle

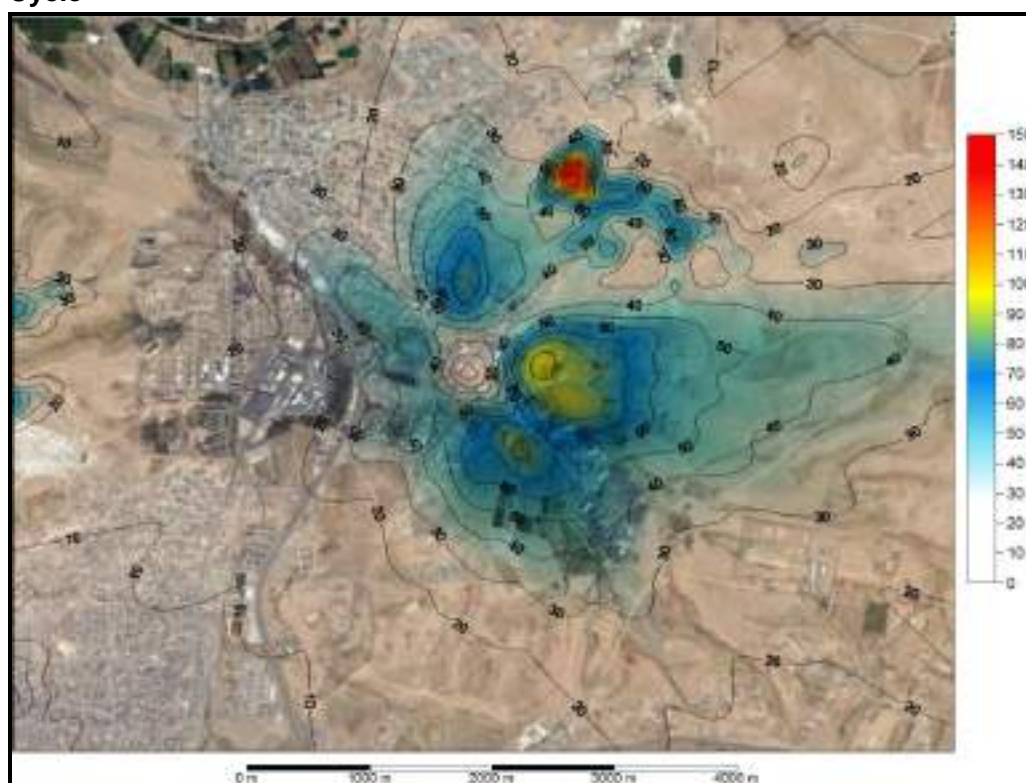


Figure 6.6: Predicted Maximum 1-Hour Mean SO₂ Concentrations (µg/m³) – LDO, Combined Cycle


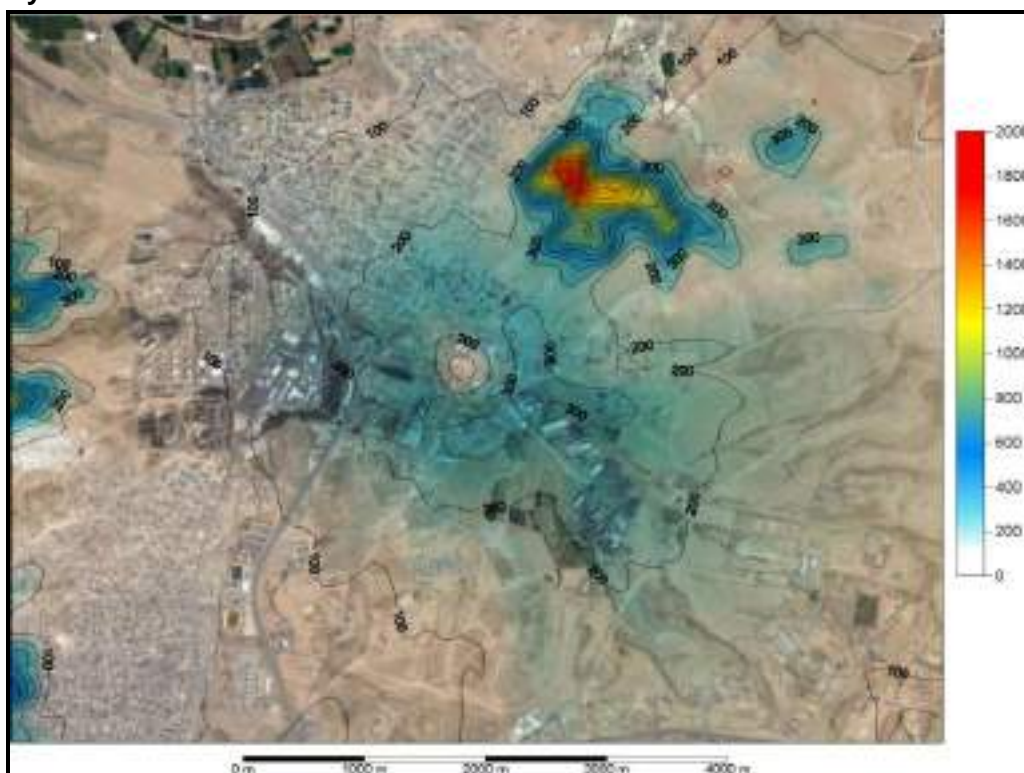


Figure 6.7: Predicted Maximum 10-Minute Mean SO₂ Concentrations (µg/m³) – LDO, Combined Cycle



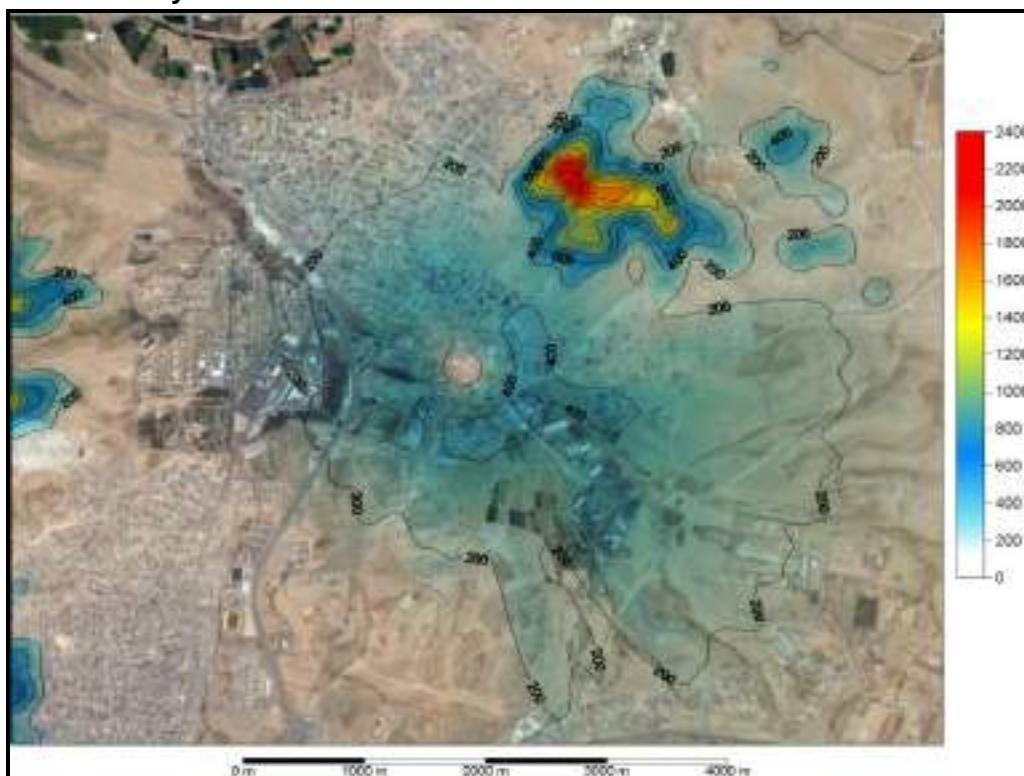

Particulate Matter (PM₁₀)

6.11 Predicted maximum annual and 24-hour mean ground-level mean PM₁₀ concentrations are presented in Table 6.4.

Table 6.4: Maximum Predicted PM₁₀ Concentrations – LDO, Combined Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean
NEPCO Training Centre	0.061	0.38
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	0.063	0.31
Zarqa Cemetery	0.16	0.78
CEGCO Engineers Accommodation	0.076	0.47
Agricultural Land	0.10	0.53
Petrochemical Refinery	0.041	0.36
Steelworks	0.092	0.43
Education Centre	0.024	0.18
Residential Cluster (Hashmiyeh)	0.034	0.39
Sports Stadium	0.013	0.10
North Zarqa (Residential)	0.011	0.074
Wastewater Treatment Facility	0.034	0.21
Maximum PC	0.16	0.78
Air Quality Standard	40	50
PC as a %age of AQS	0.39%	1.6%

6.12 The maximum predicted PM₁₀ concentrations due to LDO-fired, combined-cycle operation at the project are less than 1% and 10% of the relevant AQSs, therefore the significance of the impact is considered to be *negligible*.

Scenario 4 (LDO, Simple Cycle)

Nitrogen Dioxide (NO₂)

6.13 The maximum predicted NO₂ concentration at identified sensitive receptor locations is presented in Table 6.5 for Scenario 4 (LDO, simple cycle).



Table 6.5: Maximum Predicted NO₂ Concentrations – LDO, Simple Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean	1-Hour Mean
NEPCO Training Centre	0.45	1.4	6.4
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	0.56	1.4	6.9
Zarqa Cemetery	1.1	2.9	11.9
CEGCO Engineers Accommodation	0.42	1.6	9.7
Agricultural Land	0.82	2.4	9.4
Petrochemical Refinery	0.28	1.3	7.1
Steelworks	0.77	2.1	7.2
Education Centre	0.18	0.67	5.4
Residential Cluster (Hashmiyeh)	0.23	1.7	7.4
Sports Stadium	0.11	0.4	3.9
North Zarqa (Residential)	0.10	0.32	2.9
Wastewater Treatment Facility	0.31	0.82	4.4
Maximum PC	1.1	2.9	11.9
Air Quality Standard	40	145	200
PC as a %age of AQS	2.8%	2.0%	5.9%

6.14 The maximum predicted annual mean NO₂ concentration is over 1% of the AQS and therefore potentially significant. However, since the local monitoring data indicates that existing long-term concentrations are well within the standard, the risk of an exceedence is considered to be *negligible*.

6.15 The predicted short-term NO₂ concentrations are less than 10% of the relevant AQSs and are therefore of *negligible* significance.

Carbon Monoxide (CO)

6.16 Predicted maximum ground-level mean CO concentrations as the 8-hour mean are presented in Table 6.6.



Table 6.6: Maximum Predicted CO Concentrations – LDO, Simple Cycle ($\mu\text{g}/\text{m}^3$)

Receptor	8-Hour Mean	1-Hour Mean
NEPCO Training Centre	1.5	2.7
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	1.3	2.9
Zarqa Cemetery	2.3	5.0
CEGCO Engineers Accommodation	1.7	4.1
Agricultural Land	2.2	4.0
Petrochemical Refinery	1.3	3.0
Steelworks	2.1	3.0
Education Centre	0.85	2.3
Residential Cluster (Hashmiyeh)	1.8	3.1
Sports Stadium	0.41	1.7
North Zarqa (Residential)	0.33	1.2
Wastewater Treatment Facility	0.48	1.8
Maximum PC	2.3	5.0
Air Quality Standard	9,920	28,708
PC as a %age of AQS	0.024%	0.017%

6.17 The impact of the proposed project under back-up, simple cycle operation is less than 10% of the relevant AQS at all receptor locations and is therefore considered to be of *negligible* significance.

Sulphur Dioxide (SO_2)

6.18 Predicted maximum 24-hour mean ground-level mean SO_2 concentrations are presented in Table 6.7.



Table 6.7: Maximum Predicted SO₂ Concentrations – LDO, Simple Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean	1-Hour Mean	10-Minute Mean (a)
NEPCO Training Centre	2.8	17.1	78.0	105
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	3.4	17.7	83.9	112
Zarqa Cemetery	6.8	35.0	145	195
CEGCO Engineers Accommodation	2.6	19.5	119	160
Agricultural Land	5.0	28.8	115	155
Petrochemical Refinery	1.7	16.5	86.2	116
Steelworks	4.7	25.5	88.4	118
Education Centre	1.1	8.2	65.8	88.2
Residential Cluster (Hashmiyeh)	1.4	20.3	90.4	121
Sports Stadium	0.68	4.6	48.1	64.4
North Zarqa (Residential)	0.63	3.9	35.9	48.1
Wastewater Treatment Facility	1.9	10.0	53.7	72.0
Maximum PC	6.8	35.0	145	195
Air Quality Standard	114	125	350	500
PC as a %age of AQS	6.0%	28.0%	41.5%	38.9%
(a) 10-minute mean estimated by multiplying the 1-hour mean by 1.34 as recommended by UK Environment Agency Guidance.				

6.19 The impact of SO₂ emissions from the proposed project under back-up, simple cycle operation is potentially significant over all averaging periods. However, the predicted process concentrations are within the relevant air quality standards at all receptor locations. However, based on the limited existing SO₂ monitoring data for the local area, it is considered unlikely that the air quality standards will be exceeded at any of the identified receptor locations.

Particulate Matter (PM₁₀)

6.20 Predicted maximum annual and 24-hour mean ground-level mean PM₁₀ concentrations are presented in Table 6.8.



Table 6.8: Maximum Predicted PM₁₀ Concentrations – LDO, Simple Cycle (µg/m³)

Receptor	Annual Mean	24-Hour Mean
NEPCO Training Centre	0.025	0.16
Nearest Residential Receptor to the Proposed Site (Hashmiyeh)	0.031	0.16
Zarqa Cemetery	0.063	0.32
CEGCO Engineers Accommodation	0.024	0.18
Agricultural Land	0.046	0.26
Petrochemical Refinery	0.016	0.15
Steelworks	0.043	0.23
Education Centre	0.010	0.075
Residential Cluster (Hashmiyeh)	0.013	0.19
Sports Stadium	0.006	0.043
North Zarqa (Residential)	0.006	0.036
Wastewater Treatment Facility	0.018	0.092
Maximum PC	0.063	0.32
Air Quality Standard	40	50
PC as a %age of AQS	0.16%	0.64%

6.21 The maximum predicted PM₁₀ concentrations due to LDO-fired, simple-cycle operation at the project are less than 1% and 10% of the relevant AQSs, therefore the significance of the impact is considered to be *negligible*.



7 MITIGATION MEASURES

7.1 All mitigation measures detailed in the ESIA mitigation section for Air Quality shall be employed at the project.

7.2 The proposed facility will employ best available technology (BAT) in order to minimise emissions. Regular maintenance of plant at the proposed facility will also be carried out in order to optimise performance.



8 SUMMARY AND CONCLUSIONS

8.1 An assessment has been carried out to determine the potential air quality impacts associated with the proposed ACWA Power Zarqa CCGT Project.

8.2 The key pollutants considered in the assessment were NO_x (as NO₂), CO, particles (as PM₁₀), and SO₂. A background monitoring study has been undertaken around the proposed site to establish current air quality conditions. The data indicate that existing NO₂, SO₂ and PM₁₀ concentrations are within the relevant air quality standards and the airshed is not considered to be degraded.

8.3 Detailed dispersion modelling of potential emissions from the proposed facility has been carried out using AERMOD for combined and simple cycle operation for both the primary fuel (natural gas) and back-up fuel (light diesel oil). The assessment has considered the impact of the project for all operational modes at sensitive receptor locations.

8.4 For normal operation utilising natural gas as a fuel and in combined cycle mode, the model predicts that ground-level pollutant concentrations of NO₂ and CO at sensitive receptors will be well within the relevant air quality standards and the risk of an exceedence is considered to be negligible. For natural-gas fired, single cycle operation, the predicted impacts are also of negligible significance.

8.5 Operation of the project using low sulphur light diesel oil would only occur during failure of the natural gas supply or routine maintenance activities. For both combined cycle and simple cycle operation using light diesel oil, the predicted NO₂, CO and PM₁₀ concentrations at receptor locations are well within the relevant air quality standards and the risk of an exceedence is considered to be negligible. However, maximum predicted concentrations of SO₂ are potentially significant, particularly in terms of short-term impacts. The local monitoring data indicates that existing SO₂ concentrations are relatively low and therefore an exceedence of the relevant air quality standards at sensitive receptor locations is considered unlikely. However, the use of light diesel oil for prolonged periods should be avoided in order to minimise the impact of emissions on short-term SO₂ concentrations.



APPENDIX A - AIR QUALITY TERMINOLOGY

Term	Definition
Accuracy	A measure of how well a set of data fits the true value.
Air quality objective	Policy target generally expressed as a maximum ambient concentration to be achieved, either without exception or with a permitted number of exceedences within a specific timescale (see also air quality standard).
Air quality standard	The concentrations of pollutants in the atmosphere which can broadly be taken to achieve a certain level of environmental quality. The standards are based on the assessment of the effects of each pollutant on human health including the effects on sensitive sub groups (see also air quality objective).
Ambient air	Outdoor air in the troposphere, excluding workplace air.
Annual mean	The average (mean) of the concentrations measured for each pollutant for one year. Usually this is for a calendar year, but some species are reported for the period April to March, known as a pollution year. This period avoids splitting winter season between 2 years, which is useful for pollutants that have higher concentrations during the winter months.
Exceedence	A period of time where the concentrations of a pollutant is greater than, or equal to, the appropriate air quality standard.
Fugitive emissions	Emissions arising from the passage of vehicles that do not arise from the exhaust system.
LDO	Light diesel oil
NO	Nitrogen monoxide, a.k.a. nitric oxide.
NO₂	Nitrogen dioxide.
NO_x	Nitrogen oxides.
O₃	Ozone.
Percentile	The percentage of results below a given value.
PM₁₀	Particulate matter with an aerodynamic diameter of less than 10 micrometres.
ppmw	Parts per million by mass (weight)
Ratification (Monitoring)	Involves a critical review of all information relating to a data set, in order to amend or reject the data. When the data have been ratified they represent the final data to be used (see also validation).
µg/m³ micrograms per cubic metre	A measure of concentration in terms of mass per unit volume. A concentration of 1µg/m ³ means that one cubic metre of air contains one microgram (millionth of a gram) of pollutant.
Uncertainty	A measure, associated with the result of a measurement, which characterizes the range of values within which the true value is expected to lie. Uncertainty is usually expressed as the range within which the true value is expected to lie with a 95% probability, where standard statistical and other procedures have been used to evaluate this figure. Uncertainty is more clearly defined than the closely related parameter 'accuracy', and has replaced it on recent European legislation.



APPENDIX B - STACK EMISSION PARAMETERS

Table B1: Emission Parameters (Main HRSG Stacks)

Parameter / Fuel	Natural Gas	LDO
Stack Height (m)	60.0	
Stack Diameter (m)	4.8	
Temperature (K)	392	427
Actual Flow Rate (Am ³ /s)	446	492
Exit Velocity (m/s)	24.7	27.2
Emission Rate (g/s)		
NO _x	8.6	45.2
PM ₁₀	-	1.8
CO	8.3	6.7
SO ₂	-	193

Table B2: Emission Parameters (Bypass Stacks)

Parameter / Fuel	Natural Gas	LDO
Stack Height (m)	45.0	
Stack Diameter (m)	5.4	
Temperature (K)	832	831
Actual Flow Rate (Am ³ /s)	947	957
Exit Velocity (m/s)	41.4	41.8
Emission Rate (g/s)		
NO _x	8.6	45.2
PM ₁₀	-	1.8
CO	8.3	6.7
SO ₂	-	193

Note: SO₂ emissions rate from LDO is based upon LDO Sulphur content of 1%.

Note: All modelled emissions are based on 15% O₂.

Appendix J

Noise Modelling Report

**Hussein Thermal Power Station – Power Generation
Project
Zarqa, Hashemite Kingdom of Jordan**



**Hussein Thermal Power Station – Power Generation
Project
Zarqa, Hashemite Kingdom of Jordan**

Noise Assessment

Revision	Date	Notes	Author	Checked	Approved
Ver 3	12-06-16	Noise Assessment	SP	ND	ND

**Entran Limited
12 Greenway Farm
Bath Road
Wick
Bristol
BS30 5RL**

**T: 0117 937 4077
www.entranltd.co.uk**

CONTENTS	PAGE
1 Introduction	1
2 Noise Assessment Criteria	5
3 Noise Assessment	7
4 Summary	16
APPENDIX A – Introduction to Noise	17

1 INTRODUCTION

- 1.1 Entran Ltd have been commissioned to undertake a noise assessment for the Al-Hussein Power Plant located at Zarqa, Jordan. Specifically the noise modelling assessment is in regard to the proposed combined cycle power plant project to be developed within the existing landholding of the Hussein TPS.
- 1.2 The Project site is located within Zarqa Governorate in the north of Jordan, around 25km northeast of the capital city of Amman. The proposed project will be located entirely within existing land belonging to the Central Electricity Generating Company (CEGCO) at the Hussein Thermal Power Station. The Hussein TPS is located in the north of Zarqa city, in an area with several industrial and commercial facilities, including a large petrochemical refinery and steelworks facility. The proposed project site is approximately 4 Km north east of the centre of Zarqa city (the capital city of Zarqa Governorate) while to the north is located Al-Hashmiyeh city.
- 1.3 The Hussein TPS Repowering Project will involve the design, construction, ownership financing, operation and maintenance of the expanded thermal power generating facility, under its new operational configuration. The proposed expansion configuration will comprise the following:

a) **3 Gas Turbine Generators (GTG)**

Gas Turbines directly combust fuel to generate electricity via the in built turbine and generator (Operates in a similar method to a turbofan engine on an aeroplane).

- Equipped with Low NO_x burners;
- Each Gas Turbine will have a bypass stack for emissions during simple cycle operation (when required);
- Equipped with Continuous Emissions Monitoring System (CEMS) monitoring systems.

b) **3 Heat Recovery Steam Generators (HRSG);**

HRSG's use the hot exhaust gases from the gas turbine to heat water to steam for transfer to the steam turbine.

- Each HRSG will have a main stack for emissions during combined cycle operations;
- Equipped with main stack and CEMS systems for air emissions monitoring;

c) **Steam Turbine Generator.**

The steam turbine uses the steam from the HRSG to turn generate electricity in combined cycle, additional to the GTG, thereby increasing plant efficiency.

-
- Natural gas (main fuel):
 - Delivered via a new gas pipeline connection to Jordan's main gas pipeline (approximately 900m to the east);
 - Natural Gas receiving station equipped with:
 - Gas forwarding systems;
 - Metering devices;
 - Gas compressors (if required, but not expected to be required);
 - All related auxiliaries.
- d) **LDO fuel (back up):**
- To be delivered by the existing pipeline from the adjacent petrochemical refinery;
 - 14 days of operational on site storage capacity provide on-site.
- e) **Wastewater treatment facilities** for:
- Process/Chemical wastewater;
 - Oily waste water streams;
- f) **Air Cooled Condensers** (for dry cooling of ST steam);
- g) **Deepwater well and pumping station within site boundary:**
- Filter, Reverse Osmosis (RO) and Ion Exchanger for water treatment;
 - Storage for water on site;
- h) **Ancillary Facilities** (including administration building, Central Control Room etc.)
- i) **Evaporation pond**

1.4 The project site is effectively split into four main sections based on the proposed operational uses of these areas. These sections are shown in Figure 1. Some of the receptors adjacent to the project site are shown in Figure 2.


1.5 The purpose of this assessment is to establish the potential noise levels at nearby receptors and, if necessary, formulate mitigation measures to protect existing noise sensitive receptors. Relevant national/local guidance on noise sources is presented in Section 2. The assessment of noise is considered in Section 3 together with our recommendations for mitigation. Our conclusions are summarised in Section 4.

1.6 This Report is necessarily technical in nature and contains terminology relating to acoustics and noise. Therefore, a glossary together with a brief introduction to the subject of noise has been provided in Appendix A.

Figure 1 Project Site



Figure 2 Nearby Receptors

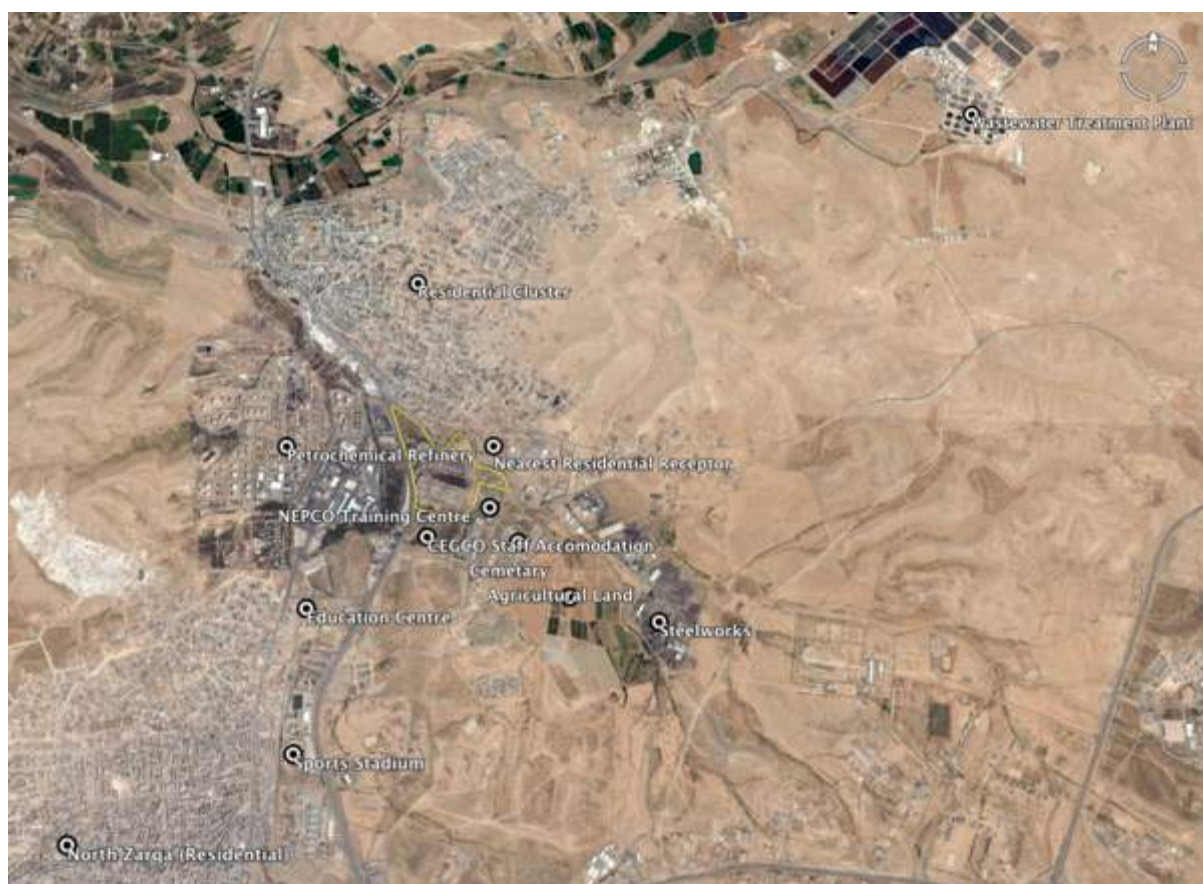

2 NOISE ASSESSMENT CRITERIA

Jordanian Legislative Policy

- 2.1 The Environmental Protection Law no. 52/2006 sets the definitions and outlines the main responsibilities and functions of the ministry of environment. As per the law, the ministry is responsible for setting Jordan's environmental protection policy, monitoring activities, coordinating national efforts for environmental protection, and preparing environmental contingency plans. Article 7 of the law assigns the ministry of environment with the environmental monitoring and inspection responsibilities, and grants its employees the right to enter any facility for inspection needs. Articles 8, 9, 10 relate to marine environment. Article 13 sets the requirements for conducting environmental impact assessment for projects.
- 2.2 The law also calls for the establishment of environmental protection fund (articles 16 and 17); and sets fees for violation of its provision, terms for delegation of authority, and the operation of environmental nongovernmental organizations in Jordan. Finally, it lists the regulations that should be issued in accordance to the law. Of the required 12 regulations set by law; the following regulations have already been issued: marine and coastal environment; environment protection from pollution in emergency cases; air protection; nature reserves and national parks; management, transport and handling of harmful and hazardous substances; management of solid wastes; environmental impact assessment; and soil protection.
- 2.3 The Jordanian Guidelines for the Prevention of Noise (2003) sets the noise limits for the ambient noise climate for various situations:

Table 2.1 Jordanian Guidelines for the Prevention of Noise (2003)

Area	Highest Permissible Limits of Equivalent Sound Level (dB(A))	
	Day	Night
Residential in Urban	60	50
Residential in Sub-Urban	55	45
Residential in Rural	50	40
Residential having Small industries, Offices and Public Buildings	65	55
Industrial	75	65
Schools, hospitals, mosques and Churches	45	35

Table 2.2 IFC EHS Guidelines, 2007 - Noise

Receptor	One Hour LAeq (dBA)	
	Daytime 07:00 – 22:00	Night time 22:00 – 07:00
Residential, Institutional, Educational	55	45
Industrial, Commercial	70	70

2.4 Under the Jordanian regulations the noise sensitive residential receptors (NSRs) in the vicinity of the plant have been classified as 'Residential having Small industries, Offices and Public Buildings'. This is due to the presence of the commercial and industrial activity locally. Therefore, the relevant noise limits for the residential NSRs are 65 dB(A) during the day and 55 dB(A) at night. These limits are 10dB(A) above the guidance of the IFC EHS General Guidelines for noise.

2.5 For receptors such as the NEPCO training centre (located immediately adjacent to the proposed power block, the noise limit has been taken to reflect the industrial criteria, due to the industrial nature of training activities that are undertaken at this facility. In relation to the Jordanian standards the industrial limits reflect 75 dB(A) in the daytime and 65 dB(A) at night. For the IFC EHS Guidelines, this value is considered to be 70 dB(A) for either day or night.

3 NOISE ASSESSMENT


3.1 The projects equipment suppliers have provided the major noise generators both internally (e.g. within the acoustic enclosures) as well as other externally located plant (e.g. air cooled condensers, water pumps the outlet stack, and ancillary equipment). The noise source data of all major plant is presented in Table 3.1.

Table 3.1 Plant Sound Power Noise Levels dB

Freq	31.5 Hz	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz
Gt air inlet filter	111	111	103	99	94	91	88	88	86
Gt inlet duct	103	103	95	91	97	95	97	97	89
Gt inlet duct transition	97	99	94	93	92	91	90	90	87
Generator	121	118	115	112	107	103	108	97	87
Generator coupling	121	114	111	109	104	96	92	83	77
Gt acoustical enclosure	117	118	113	107	106	103	102	108	99
DLN gas acoustical enclosure	104	99	94	88	88	89	93	90	84
Water injection acoustical enclosure	109	104	101	91	84	89	88	84	73
Fin fan coolers	-	109	108	108	107	104	100	96	90
Exhaust lf silencer and transition	119	114	107	98	92	89	84	87	83
ACC	-	78	83	83	80	80	78	75	73
Boiler Inlet ducting						93			
Boiler casing						93			
Boiler outlet ducting and stack						93			
boiler stack exit						93			
Equipment						93			
Safety valve Silencers						138			

-
- 3.2 By taking into account the source noise levels, the area of acoustic or non-acoustic enclosures (where available) and the intervening distance to the receptor, a noise model was constructed using proprietary software IMMI2016 using the methodology outlined in ISO9613 (ISO 9613-2 “Acoustics – Attenuation of sound during propagation outdoors – Part 2: General method of calculation” describes a detailed procedure to calculate sound levels from point sources. Area and line sound sources are divided into component point sound sources).
- 3.3 ISO 9613-2 computes long-term average sound levels in octave bands with nominal mid-band frequencies from 63 to 8000 Hz. ISO 9613-2 makes a difference between calculation of short-term and long-term levels. If the first are calculated in downwind conditions (favourable propagation of sound with significant positive wind from source to receiver), the latter are calculated using the same formulas but corrected by means of the meteorological correction term C_{met} .
- 3.4 The guidance given by ISO 9613-2 on how to determine the meteorological correction term C_0 is rather unsatisfactory and therefore the following global parameters are included in the noise model:
- Temperature 10°C; relative Humidity 70%;
 - Light downwind propagation towards the receptor;
 - No soft ground attenuation
- 3.5 In terms of noise attenuation from buildings off-site, information on these were not available and therefore a worst-case free propagation model was constructed. The results of the noise modelling at representative receptors (NSRs) are presented below (other NSRs are too distant for an accurate calculation of noise levels). Noise contours based on the above methodology have been computed and are presented in Figure 3.
- 3.6 By assuming that the existing ambient noise levels are 55 dB during the day and 50 dB at night, the noise impact is computed and shown in Figures 4 and 5 respectively. However, it should be noted that intervening obstacles (e.g. buildings and other infrastructure) have not been taken into account and therefore the noise impact contours are indicative only.

Figure 3 Computed Noise Contours

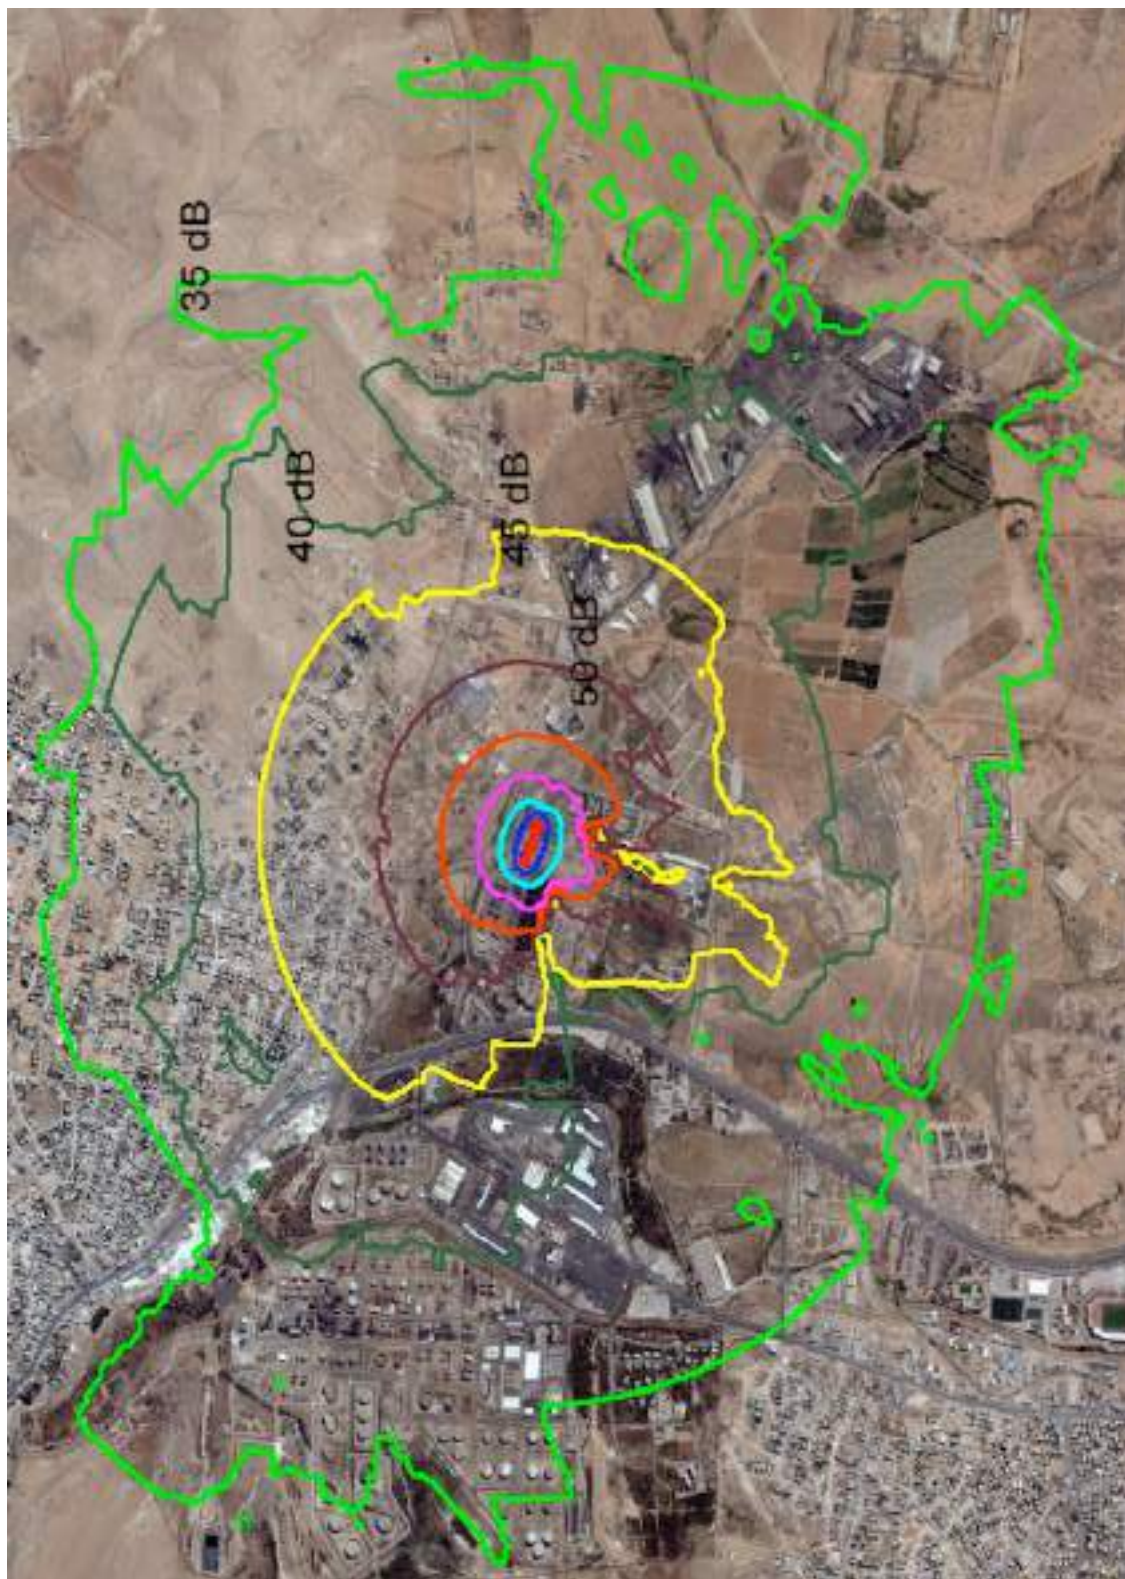

© 2005 Blackwell Publishing Ltd *Journal of Internal Medicine* 258: 105–112

- 3.7 The following figures illustrate the contour at which noise may increase by 3dB(A) in respect to the baseline noise levels. In line with the outcomes of the ESIA noise monitoring studies, the baseline has been taken to be 55dB(A) in the daytime and 50dB(A) at night-time for the wider area.

Figure 4 Computed Noise Impact Contours, Day



Figure 5 Computed Noise Impact Contours, Night



Figure 6 Cumulative Noise Impacts (+3dB(A) Noise – Daytime and Night time)



Table 3.3 Receptor Noise Levels, dB(A) (Base Load)

First Floor (4.5m)	Representative NSRs		Noise Standards per Receptor	
	Receptor Type	Noise Level, dB L _{Aeq,T} Day/Night	Jordanian	WHO
Residential Cluster, Al Hashmiyeh	Residential having Small industries, Offices and Public Buildings	39.1	65 – Day 55 - Night	55 – Day 45 - Night
Nearest Residential Receptor, in Al Hashmiyeh		57.3	65 – Day 55 - Night	55 – Day 45 - Night
Training Centre, NEPCO	Industrial	59.7	75 – Day 65 - Night	70 Day/Night
CEGCO Staff Accommodation	Residential having Small industries, Offices and Public Buildings	50.9	65 – Day 55 - Night	55 – Day 45 - Night
Jordon Petroleum Refinery Al Zarqaa	Industrial	41.1	75 – Day 65 - Night	70 Day/Night
Education Centre	Schools, hospitals, mosques and Churches	37.1	45 – Day 35 - Night	55 – Day 45 - Night
Prince Mohammed Sports Stadium	Recreational (Institutional)	34.6	65 – Day 55 - Night	55 – Day 45 - Night
Steel Works	Industrial	39.1	75 – Day 65 - Night	70 Day/Night

- 3.8 As can be seen from the above, noise levels bar the nearest residential dwelling are within the adopted criteria for the daytime at all modelled receptors.
- 3.9 At night, there is compliance to all Jordanian standards, however the off-site nearest residential receptor and CEGCO accommodation area may be exposed to noise levels in excess of the WHO night time noise guidelines.
- 3.10 The only other receptor that may be exposed to exceeding limits at night is the Education centre in Zarqa, however, this is not considered to be open at night and therefore not applicable for consideration of exceedances.

Mitigation Measures

- 3.11 All mitigation measures detailed in the operational mitigation section of the ESIA shall be considered and implemented.

4 SUMMARY

- 4.1 Noise levels have been assessed at the proposed Hussein TPS Power Generation Project in Zarqa, Jordan.
- 4.2 This assessment has considered the noise effects of the proposed project on noise levels at local receptors, during the operational phase. The assessment has been based on a series of environmental noise predictions using ISO9613 methodology, with input data from the equipment manufacturers of the proposed plant. The assessment is based upon specified noise levels provided by the equipment manufacturers, for combined cycle operation.
- 4.3 During the operational phase of the development, it is predicted that noise from the proposed project will meet the required Jordanian noise standards at all modelled receptors (in regard to the specific receptor classification).
- 4.4 Receptor noise levels are modelled to exceed the WHO noise guidelines at night at some residential receptors to the north of the project site, in regard to the projects process contribution.
- 4.5 The cumulative impact of noise indicates that some properties immediately to the north of the project may be within the +3dB(A) contour (from baseline values) for night time operations.

APPENDIX A – INTRODUCTION TO NOISE

In order to assist the understanding of acoustic terminology and the relative change in noise, the following background information is provided.

The human ear can detect a very wide range of pressure fluctuations, which are perceived as sound. In order to express these fluctuations in a manageable way, a logarithmic scale called the decibel, or dB scale is used. The decibel scale typically ranges from 0 dB (the threshold of hearing) to over 120 dB.

The ear is less sensitive to some frequencies than to others. The A-weighting scale is used to approximate the frequency response of the ear. Levels weighted using this scale are commonly identified by the notation dB(A).

A noise impact on a community is deemed to occur when a new noise is introduced that is out of character with the area, or when a significant increase above the pre-existing ambient noise level occurs. For levels of noise that vary with time, it is necessary to employ a statistical index that allows for this variation. These statistical indices are expressed as the sound level that is exceeded for a percentage of the time period of interest.

In the UK, traffic noise is measured as the L_{A10} , the noise level exceeded for 10% of the measurement period. The L_{A90} is the level exceeded for 90% of the time and has been adopted to represent the background noise level in the absence of discrete events. An alternative way of assessing the time varying noise levels is to use the equivalent continuous sound level, L_{Aeq} . This is a notional steady level that would, over a given period of time, deliver the same sound energy as the actual fluctuating sound.

To put these quantities into context, where a receiver is predominantly affected by continuous flows of road traffic, a doubling or halving of the flows would result in a just perceptible change of 3dB, while an increase of more than 25%, or a decrease of more than 20%, in traffic flows represent changes of 1dB in traffic noise levels (assuming no alteration in the mix of traffic or flow speeds).

Note that the time constant and the period of the noise measurement should be specified. For example, BS 4142 specifies background noise measurement periods of 1 hour during the day and 5 minutes during the night. The noise levels are commonly symbolised as $A_{90(1\text{hour})}$ and

$L_{A90(5mins)}$. The noise measurement should be recorded using a 'FAST' time response equivalent to 0.125 ms.

Table A1: Glossary of Terms

Term	Definition
Decibel (dB)	A scale for comparing the ratios of two quantities, including sound pressure and sound power. The difference in level between two sounds s_1 and s_2 is given by $20 \log_{10} (s_1/s_2)$. The decibel can also be used to measure absolute quantities by specifying a reference value that fixes one point on the scale. For sound pressure, the reference value is $20\mu\text{Pa}$.
A-weighting, dB(A)	The unit of sound level, weighted according to the A-scale, which takes into account the increased sensitivity of the human ear at some frequencies.
Noise Level Indices	Noise levels usually fluctuate over time, so it is often necessary to consider an average or statistical noise level. This can be done in several ways, so a number of different noise indices have been defined, according to how the averaging or statistics are carried out.
$L_{eq,T}$	A noise level index called the equivalent continuous noise level over the time period T . This is the level of a notional steady sound that would contain the same amount of sound energy as the actual, possibly fluctuating, sound that was recorded.
$L_{max,T}$	A noise level index defined as the maximum noise level during the period T . L_{max} is sometimes used for the assessment of occasional loud noises, which may have little effect on the overall L_{eq} noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
$L_{90,T}$	A noise level index. The noise level exceeded for 90% of the time over the period T . L_{90} can be considered to be the "average minimum" noise level and is often used to describe the background noise.
Free-Field	Far from the presence of sound reflecting objects (except the ground), usually taken to mean at least 3.5m
Ambient Noise Level	The totally encompassing sound in a given situation at a given time, usually composed of a sound from many sources both distant and near ($L_{Aeq,T}$).
Residual Noise Level	The ambient noise remaining at a given position in a given situation when specified sources are suppressed to a degree such that they do not contribute to the ambient noise level ($L_{Aeq,T}$)
Specific Noise Level	The equivalent continuous A-weighted sound pressure level at the assessment position produced by the specific noise source (the noise source under investigation) over a given time interval ($L_{Aeq,T}$)
Rating Noise Level	The specific noise level plus any adjustment for the characteristic features of the noise ($L_{Ar,Tr}$).

Appendix K

Soil Quality Laboratory Results (2016)



الجمعية العلمية الملكية
Royal Scientific Society

مختبرات التحليل الكيميائي الآلي

رقم المعاملة المحاسبية : تاريخ :
رقم العينة التحليلية : ٢٠١٦/٠٤/٠٣
رقم التقرير : ٨٧٦-٨٧٢
عدد صفحات التقرير بما فيها الخلف : (٧)

رقم الكتيب : (١٧٠١١) / ٢٠١٦/٠٤/٠٣
تاريخ : ٢٠١٦/٠٤/٠٣

المسألة : شركة توليد الكهرباء المركزية م.ع / CEGCO المحترمين.
العنوان : عمان

تحية طيبة وبعد

بشارة كتابكم رقم (HSEJ 2016-02) تاريخ (٢٠١٦/٠٤/٠٣) ، تجنونا مرفقاً تقرير نتائج الفحص/المعايرة/ للخدمة المطلوبة من قبلكم ، وقد بلغت تكاليف العمل المطلوب مبلغاً وقدره (١٤٢٥,٠٠٠) ألفاً وأربعمائة وخمسة وعشرون ديناراً أردنياً.

أرجو اتخاذ الإجراء المحدد أثناء الإشارة :-
☐ لا حاجة لاتخاذ أي إجراء بخصوص هذه المطالبة و ذلك للسبب التالية:
(القيمة بلغت نقداً) بموجب اتفاقية رقم (/) في أخرى
☐ دفع قيمة المطالبة عند استلامكم الفاتورة الصادرة عن الدائرة المالية في لجمعية لجمعية العلمية الملكية.

و اقبلوا الاحترام،

د. عدنان صقر الخصاونة

Adnan.elkhasawneh@rss.jo
رقم الهاتف : ٥٣٤٤٧٠٦

- ملاحظات: يرجى إمداد التذاكر باسم الخدمة العلمية للشركة
- لا يجوز استملاك نتائج قورسات الجمعية العلمية الملكية لأغراض أخرى إلا بموافقة الجمعية خطياً على قسم البرام شرط
 - تأخير الفحص عبر مصلحة بدون التواريخ والختم.
 - يؤمن إرسال مخطوطة لاستلام المكاتبات خلال فترة السنتين من تاريخ إصدار التقرير.
 - يجب لجمعية الفحص عند تمام مكالمة بعد الفحص إذا لم يتم استلامها من قبل صاحب العلاقة أو من يهيئه خلال كمبيوتر.

RSSPMPI 304a, Rev3

هاتف : ٥٣٤٤٧٠٦ - ٩٦٢٠٦
مكس : ٥٣٤٤٧٠٦
مستوفى براد : ١٥٢٨ عمان ١١٩١١٦ الأردن
Tel: +962 6 5344706 Fax: +962 6 5344806
P.O.Box 1830 Amman 11541 Jordan www.rss.jo





الجمعية العلمية الملكية
Royal Scientific Society
Test Report

Sector: Technical/Labs.

Division: Automated Chemical Analysis labs

Laboratory: Spectroscopy

Sample Designation No.:17/01/16/5268/1

Lab Report No.:872

Client
Address

Central Electricity Generating Co.(CEGCO)

Amman Tel:/56997769

Our Reference No. (17/01/16/55/11/001/7

Date: 17/4/2016

Your Reference No.: HSEJ/2016-02

Date: 03/4/2016

Type of sample: Soil

Method of sampling: collected and delivered by your representative

Date of Receipt: 03/04/2016

Date of end of testing: 17/04/2016

تقرير المختبر غير
رسمي مالم يحمل
التوقيع للمختبر
وختم القسم

لا يسغ التاريخ
بشكل موزع إلا
بأخذ حوالته
حظية من الجهة
المصدرة للشهادة

تسليم الفحص
تمثل العينة
المختبرة فقط

أي كس لا تعيل
يلني هذا التقرير

Test report is
only valid
with
division-
stamp and
signature

Test report
shall not be
reproduced
other than
in full,
except with
the written
approval of
the issuing
party

The test
results relate
only to the
items tested

Any erasure
or attrition
in the report
will invalid it

Parameter

Unit

Results/
Sample Code

Testing method

HUSSEIN 4A
15/3/2016

As	mg/kg	<7.5	SOP17/01/01/02/1
Ba	mg/kg	150	SOP17/01/01/02/1
Cd	mg/kg	<1.0	SOP17/01/01/02/1
Cr	mg/kg	54.8	SOP17/01/01/02/1
Co	mg/kg	6.47	SOP17/01/01/02/1
Cu	mg/kg	18.0	SOP17/01/01/02/1
Pb	mg/kg	13.2	SOP17/01/01/02/1
Ni	mg/kg	36.3	SOP17/01/01/02/1
Hg	mg/kg	<1.0	SOP17/01/01/02/1
Zn	mg/kg	87.1	SOP17/01/01/02/1

Notes:

- Samples were received in a good condition.
- Samples were labeled by your representative.
- Attached is TPII result.

Lab Supervisor: Eman Ta'an

Division Head: Eng. Haitham Naser

Page (1) of (1)

FORM Q-055 MP110

المعرفة
Knowledge

المؤد جرد
Testing

الجودة
Quality





الجمعية العلمية الملكية
Royal Scientific Society
Test Report

Sector: Technical/Labs.

Division: Automated Chemical Analysis labs

Sample Designation No.:17/01/16/5268/2

Laboratory: Spectroscopy

Lab Report No.:873

Client

Central Electricity Generating Co.(CEGCO)

Address

Amman

تقرير الفحص غير
رسمي عالم فحص
التوقيع المستند
ورقم القسم

لا يشيخ التقرير
بشكل مجزأ إلا
يأخذ موافقة
خطية من الجهة
المستندة للشهادة

Our Reference No.: (170101) 164/55/1/8017

Type of sample: Soil

Date: 17/4/2016

Method of sampling: collected and delivered by your representative

Your Reference No.: JSFD 2016-32

Date of Receipt: 03/04/2016

Date: 03/04/2016

Date of end of testing: 12/04/2016

نتائج الفحص
تعمل المينة
للمقارنة فقط

أي كلمة أو تعديل
يلغي هذا التقرير

Test report is
only valid
with
device ori-
stamp and
signature

Test report
shall not be
reproduced
other than
in full,
except with
the written
approval of
the issuing
party

The test
results relate
only to the
items tested

Any erasure
or attrition
in the report
will invalid it

Parameter

Unit

Results/
Sample Code

Testing method

HUSSEIN IB
15/3/2016

As	mg/kg	<7.5	SOP17/01/01/02/1
Ba	mg/kg	183	SOP17/01/01/02/1
Cd	mg/kg	3.97	SOP17/01/01/02/1
Cr	mg/kg	98.7	SOP17/01/01/02/1
Cu	mg/kg	<5.0	SOP17/01/01/02/1
Cu	mg/kg	27.2	SOP17/01/01/02/1
Pb	mg/kg	10.4	SOP17/01/01/02/1
Ni	mg/kg	62.6	SOP17/01/01/02/1
Hg	mg/kg	<1.0	SOP17/01/01/02/1
Zn	mg/kg	164	SOP17/01/01/02/1

Notes:

- Samples were received in a good condition
- Samples were labeled by your representative.
- Attached is TPH result.

Lab Supervisor: Eman Ta'an

Division Head: Eng. Haitham Naser

Page (1) of (1)

هاتف: +962 6 5344701 فاكس: +962 6 5344806 ص.ب. 1438 عمان 11941 الأردن

Tel: +982 6 5344701 Fax: +862 6 5344806 P.O.Box 1438 Amman 11941 Jordan

FORM



المعرفة
Knowledge

المختبرات
Testing

الجودة
Quality

البيئة
Environment



الجمعية العلمية الملكية
Royal Scientific Society
Test Report

Sector: Technical/Labs.

Division: Automated Chemical Analysis labs

Sample Designation No.:17/01/16/5268/3

Laboratory: Spectroscopy

Lab Report No.:874

Client
Address

Central Electricity Generating Co.(CEGCO)

Amman

التقرير الخاص بغير
رسمي مالم يحفل
بالتوقيع المعتمد
وختم القسم

Our Reference No.: (170101) 164/55/1/ 874

Type of sample: Soil

Date: 07/07/2016

Method of sampling: collected and delivered by your representative

Your Reference No.: JSED 2016-02

Date of Receipt: 03/04/2016

Date: 03/07/2016

Date of end of testing: 17/04/2016

لا يسعخ التقرير
يشكل سورا ١٦
أخذ موالفة
خطية من جهة
المصدرة للشهادة

Parameter	Unit	Results/ Sample Code	Testing method
HUSSEIN 3A 15/3/2016			
As	mg/kg	<7.5	SOP17/01/01/02/1
Ba	mg/kg	114	SOP17/01/01/02/1
Cd	mg/kg	<1.0	SOP17/01/01/02/1
Cr	mg/kg	42.9	SOP17/01/01/02/1
Co	mg/kg	<5.0	SOP17/01/01/02/1
Cu	mg/kg	13.1	SOP17/01/01/02/1
Pb	mg/kg	19.3	SOP17/01/01/02/1
Ni	mg/kg	212	SOP17/01/01/02/1
Hg	mg/kg	<1.0	SOP17/01/01/02/1
Zn	mg/kg	78.0	SOP17/01/01/02/1

نتائج الفحص
تمثل العينة
المفحوصة فقط

أي كسب أو تعديل
يلغي هذا التقرير

Test report is
only valid
with
division-
stamp and
signature


Test report
shall not be
reproduced
other than
in full,
except with
the written
approval of
the issuing
party

The test
results relate
only to the
items tested

Any erasure
or attrition
in the report
will invalid it

Notes:

- Samples were received in a good condition.
- Samples were labeled by your representative.
- Attached is TPEI result






Lab Supervisor: Eman Ta'an

Division Head: Eng. Haitham Naser

Page (1) of (1)

FORV



المعرفة
Knowledge

القياس
Testing

الجودة
Quality

السلامة
Safety



الجمعية العلمية الملكية
Royal Scientific Society
Test Report

Sector: Technical/Labs.

Division: Automated Chemical Analysis labs

Sample Designation No.: 17/01/16/5268/4

Laboratory: Spectroscopy

Lab Report No.: 875

Client

Central Electricity Generating Co.(CEGCO)

Address

Amman

Our Reference No.: (170101) 164/55/1/1/1/1/1

Date: 14/1/2016

Your Reference No.: HSED 2016-02

Date: 03/4/2016

Type of sample: Soil

Method of sampling: collected and delivered by your representative

Date of Receipt: 03/04/2016

Date of end of testing: 17/04/2016

تقرير الفحص غير

رسمي، ما لم يحمل

التوقيع للمختبر

وحقن القسم

لا يشيخ التقرير

بشكل جزئي إلا

بأخذ مرفقة

حظية من الجهة

المصدرة للشهادة

نتائج الفحص

تحتل العينة

المجموعة فقط

أي كشط أو تعديل

يلغي هذا التقرير

Test report is

only valid

with

division

stamp and

signature

Test report

shall not be

reproduced

other than

in full,

except with

the written

approval of

the issuing

party

The test

results relate

only to the

items tested

Any erasure

or attrition

in the report

will invalid it

Parameter

Unit

Results/

Sample Code

Testing method

HUSSEIN ZACC
15/3/2016

As	mg/kg	<7.5	SOP17/01/01/02/1
Ba	mg/kg	224	SOP17/01/01/02/1
Cd	mg/kg	4.98	SOP17/01/01/02/1
Cr	mg/kg	45.4	SOP17/01/01/02/1
Co	mg/kg	<5.0	SOP17/01/01/02/1
Cu	mg/kg	11.4	SOP17/01/01/02/1
Pb	mg/kg	<5.0	SOP17/01/01/02/1
Ni	mg/kg	25.9	SOP17/01/01/02/1
Hg	mg/kg	<1.0	SOP17/01/01/02/1
Zn	mg/kg	40.3	SOP17/01/01/02/1

Notes:

- Samples were received in a good condition
- Samples were labeled by your representative.
- Attached is TPII result.

Lab Supervisor: Entan Ta'an

Division Head: Eng. Haitham Naser

Page (1) of (1)

ملف ٩٦٢ ٦ ٥٢٤٧٠٩ + ٩٦٢ ٦ ٥٢٤٨٠٦ فاكس ص.ب ١٤٣٨ عمان ٩٦٢ ٦ ٥٢٤٧٠٩

Tel: +962 6 5344701 Fax: +962 6 5344806 P.O.Box 1438 Amman 11841 Jordan

FORM



المعرفة
Knowledge

المختبرات
Testing

المسؤولية
Quality

المسؤولية
Quality



الجمعية العلمية الملكية
Royal Scientific Society
Test Report

Sector: Technical/Labs.

Division: Automated Chemical Analysis labs

Laboratory: Spectroscopy

Sample Designation No.: 17/01/16/5268/5

Lab Report No.: 876

Client
Address

Central Electricity Generating Co.(CEGCO)
Amman

لترير الفحص غير
رسمي مالم يعمل
التوقيع المختبر
وخم القسم

Our Reference No.: (170101) 164/55/17/KC/1
Date: 17/01/2016

Type of sample: Soil

لا يسمح التقرير
بشكل مجزأ إلا
بأخذ موافقة
خطية من الجهة
المصدرة للشهادة

Your Reference No.: HSF0 2016-02

Method of sampling: collected and delivered by your representative

Date of Receipt: 03/04/2016

Date: 03/04/2016

Date of end of testing: 17/04/2016

Parameter	Unit	Results/ Sample Code	Testing method
RUSSEIN 1A 15/3/2016			
As	mg/kg	<7.5	SOP17/01/01/02/1
Ba	mg/kg	301	SOP17/01/01/02/1
Cd	mg/kg	6.02	SOP17/01/01/02/1
Cr	mg/kg	678	SOP17/01/01/02/1
Co	mg/kg	5.66	SOP17/01/01/02/1
Cu	mg/kg	1772	SOP17/01/01/02/1
Pb	mg/kg	157	SOP17/01/01/02/1
Ni	mg/kg	508	SOP17/01/01/02/1
Hg	mg/kg	<1.0	SOP17/01/01/02/1
Zn	mg/kg	1040	SOP17/01/01/02/1

نتائج الفحص
تمثل العينة
المختبرة فقط

أي كسب أو تعديل
ينفي هذا التقرير

Test report is
only valid
with
division
stamp and
signature

Test report
shall not be
reproduced
other than
in full,
except with
the written
approval of
the issuing
party

The test
results relate
only to the
items tested

Any erasure
or attrition
in the report
will invalidate it

Notes:

- Samples were received in a good condition.
- Samples were labeled by your representative.
- Attached is TPR result.

Lab Supervisor: Emman Ta'an

Division Head: Eng. Haitham Naser

Page (1) of (1)



الجمعية العلمية الملكية
Royal Scientific Society

تقرير فحص

الرقم السجري للمعدة: ١٧/١٢/٥٢٩٨

رقم التقرير: ٤٩٢ - ٤٩٧

القطاع: المليون الجديد المحميات

الغرض: المختبرات البيئية والغذاء

المختبر: مختبر المياه

تقرير الفحص غير
رسمي، ولم يعط
التوقيع الممنوع
وختم القسم

شركة توليد الكهرباء المركزية / CEGCO المحترمين
عمان

السادة

العنوان

لا ينبغي للتقرير
بشكل مجزأ إلا
بأخذ موافقة
خطية من الجهة
المصدرة للشهادة

مع تحية زية

إشهاد رقم: (١٧٠١٠٢) / ١٧٥٥/٢٢٠٠

تاريخ: ١٤/٠٤/٢٠١٦

طريقة أخذ العينة: م حديد وأصباغها من الملصق

المباركة رقم: 2016-02 HSD

تاريخ الاستلام: ١٤/٠٤/٢٠١٦

تاريخ انتهاء الفحص: ١٤/٠٤/٢٠١٦

تاريخ: ١٤/٠٤/٢٠١٦

نتائج الفحص
تمثل للعينة
المفحوصة فقط

الفحص		النتيجة / رمز العينة				الوحدة	طريقة الفحص
1 A	3 A	1B	2 ACC	4 A			
< 400	< 400	< 400	< 400	< 400	mg/kg	Water Air Soil Pollutant Journal, 2008	
TPH							
ملاحظات:							
- حالة العينة عند الاستلام : جيدة .							
تم إرسال العينة من المختبر							

أي كشف أو تعديل
يلغي هذا التقرير

Test report is
only valid
with
division-
stamp and
signature

Test report
shall not be
reproduced
other than
in full,
except with
the written
approval of
the issuing
party

The test
results relate
only to the
items tested

Any erasure
or attrition
in the report
will invalidate it

رئيس قسم - صامد القطارنة

مسؤول المختبر: عبدالله عبيدات

FORM NO RSSPMP1302 REV.(1)

صفحة (١) من (١)



المعرفة
Knowledge



الاستخبارات
Testing



الجودة
Quality



المعيار
Standard

Appendix L

Groundwater Quality Laboratory Results (2016)

مختبرات البيئة والغذاء

رقم العينة التمييزي: ٢٤٤١/٢٠١٦/٠١/١٧
رقم التقرير: ١١٨٩-١١٨٧ + ٢٢٨-٢٢٦
عدد صفحات التقرير بما فيها الملحق: (٧)

رقم الكتاب: (١٧٠١٠٢) ٥٥٦٨/١/٥٥/٢٢٠
تاريخ: ٢٠١٦/٠٣/١٥

السادة : شركة توليد الكهرباء المركزية المحترمين

العنوان : عمان

تحية طيبة وبعد،،،

إشارة لكتابكم رقم: HSED 2016-01 تاريخ ٢٠١٦/٠٣/٠١، تحنون مرفقاً تقرير نتائج الفحص/المعايرة/الختم المطلوبة من قبلكم، وقد بلغت تكاليف العمل المطلوب مبلغاً وقدره (٥٥٥) خمسمائة و خمسة و خمسون ديناراً اردنياً فقط لا غير.

أرجو اتخاذ الإجراء المحدد أثناء بالإشارة [X] :-

☐ لا حاجة لاتخاذ أي إجراء بخصوص هذه المطالبة و ذلك للأسباب التالية:-

القيمة تقعت نفذاً ☐ بموجب اتفاقية رقم { / } ☐ أخرى

☐ دفع قيمة المطالبة عند استلامكم الدائرة الصادرة عن الدائرة المالية في الجمعية العلمية الملكية.

و أقبلاً الاحترام،،،،



د. عدنان صقر الخسارنة
Adnan.elkhasawneh@rss.jo
رقم الهاتف: ٥٢٤٤٧٠١٦

ملاحظات: يرجى إصدار النتائج باسم الجمعية العلمية الملكية

- لا يجوز استعمال نتائج قعودات الجمعية العلمية الملكية لأغراض تجارية إلا بموافقة الجمعية خطياً على نفس البريد الإلكتروني.
- تقرير الفحص غير صالحة بدون التوقيع والختم.
- يرجى إرسال ملاحظاتكم لاستلام النتائج خلال فترة أسبوعين من تاريخ إصدار التقرير.
- يحل للجمعية التصرف بالشكايات بعد الفحص إذا تم يتم استلامها من قبل صاحب العلاقة أو من يتوكله خلال أسبوعين.

RSSPMP1304a, Rev3



الجمعية العلمية الملكية
Royal Scientific Society



1797

تقرير فحص

Test-053

القطاع: الشؤون الفنية/ المختبرات

القسم: المختبرات البيئة والغذاء

المختبر: مختبر المياه

السادة

العنوان

تقرير الفحص غير
رسمي مالم يحصل
التوقيع المعتمد
وختم القسم

لا يتسخ التقرير
بشكل مجزأ إلا
بأخذ موافقة
خلفية من الجهة
المصدرة للشهادة

نتائج الفحص
تمثل العينة
المفحوصة فقط

أي كشط أو تعديل
يلغي هذا التقرير

Test report is
only valid
with
devision-
stamp and
signature

Test report
shall not be
reproduced
other than
in full,
except with
the written
approval of
the issuing
party

The test
results relate
only to the
items tested

Any erasure
or attrition
in the report
will invalid it.

الرقم التمييزي للعبئة: ٣٤٤١/١٦/٠١/١٧

رقم التقرير: ٣٣٦

شركة توليد الكهرباء المركزية المحترمين

عمان

نوع العينة: مياه (No. 1)

طريقة أخذ العينة: تم جمعها وإحضارها من قبلكم

تاريخ الاستلام: ٢٠١٦/٠٣/٠١

تاريخ انتهاء الفحص: ٢٠١٦/٠٣/١٥

إشارتنا رقم: 5561/1/00/33.0 (١٧٠١٠٢)

تاريخ: ٢٠١٦/٠٣/١٥

إشارتنا رقم: HSED 2016-01

تاريخ: ٢٠١٦/٠٣/٠١

طريقة الفحص	الوحدة	النتيجة	الفحص
4500 - H ⁺ B*	SU	7.04	PH
2510 B*	µs/cm	4260	EC at 25° C
5520 - B*	mg/ L	<8	FOG**
Water Air Soil Solution, 2008	mg/ L	<8	TPH**

*: Standard Methods for the Examination of Water & Wastewater, Online, 2011
**: Test is not accredited by JAS & UKAS.

ملاحظات

- حالة العينة عند الاستلام: جيدة

- تم ترميز العينة من قبلكم

- معلومات العينة: Deep well No. 1 - Sampling @ 11:40 (03/03/2016)

رئيس القسم: صامد القطارنة

مسؤول المختبر: عبدالله عبيدات

FORM NO. RSSPMP1302 REV.(1)

صفحة (١) من (١)



المعرفة
Knowledge

المختبرات
Testing

الجودة
Quality

تسمية المجتمع
Outreach



الجمعية العلمية الملكية
Royal Scientific Society



تقرير فحص

Test-053

القطاع: الشؤون الفنية/ المختبرات

القسم: المختبرات البيئة والغذاء

المختبر: مختبر المياه

تقرير الفحص غير رسمي مالم يحمل التوقيع المعتمد وختم القسم

لا ينسخ التقرير بشكل جزأ إلا بأخذ موافقة خطية من الجهة المصدرة للشهادة

نتائج الفحص تمثل العينة المفحوصة فقط

أي كشط أو تعديل يلغي هذا التقرير

Test report is only valid with deviation-stamp and signature

Test report shall not be reproduced other than in full, except with the written approval of the issuing party

The test results relate only to the items tested

Any erasure or attrition in the report will invalid it

الرقم التمييزي للعبئة: ٣٤٤١/١٦/٠١/١٧

رقم التقرير: ٣٣٧

شركة توليد الكهرباء المركزية المحترمين
عمان

السادة

العنوان

نوع العينة: مياه (No. 8)

طريقة أخذ العينة: تم جمعها وإحضارها من قبلكم

تاريخ الاستلام: ٢٠١٦/٠٣/٠١

تاريخ انتهاء الفحص: ٢٠١٦/٠٣/١٥

إشعارنا رقم: ٥٥٦١/١/٥٥/٣٣٠ (١٧.١.٢)

تاريخ: ٢٠١٦/٠٣/١٥

إشارتكم رقم: HSED 2016-01

تاريخ: ٢٠١٦/٠٣/٠١

النقص	النتيجة	الوحدة	طريقة الفحص
PH	7.10	SU	4500 - H ⁺ B*
EC at 25° C	3650	μs/cm	2510 B*
FOG**	<8	mg/ L	5520 - B*
TPH**	<8	mg/ L	Water Air Soil Solution, 2008

* Standard Methods for the Examination of Water & Wastewater, Online, 2011
** Test is not accredited by JAS & UKAS

ملاحظات:
- حالة العينة عند الاستلام: جيدة
- تم ترميز العينة من قبلكم
- معلومات العينة: Deep well No. 8 - Sampling at 14.45 (02/03/2016)

رئيس القسم: صامد القطارنة

مسؤول المختبر: عبدالله عبيدات

FORM NO. RSSPMP1302 REV.(1)

صفحة (١) من (١)



المعرفة
Knowledge



المختبرات
Testing



الجودة
Quality



لتوعية المجتمع
Outreach



الجمعية العلمية الملكية
Royal Scientific Society



تقرير فحص

Test-053

القطاع: الشؤون الفنية/ المختبرات

القسم: المختبرات البيئة والغذاء

المختبر: مختبر المياه

تقرير الفحص غير رسمي مالم يحمل التوقيع المعتمد وختم القسم

الرقم التمييزي للعبئة: ٣٤٤١/١٦/٠١/١٧

رقم التقرير: ٣٣٨

شركة توليد الكهرباء المركزية المحترمين
عمان

السادة

العنوان

لا يتسغ التقرير بشكل مجزأ إلا بأخذ موافقة خطية من الجهة المصدرة للشهادة

نوع العينة: مياه (No. 9)

طريقة أخذ العينة: تم جمعها واحضارها من قبلكم

تاريخ الاسلام: ٢٠١٦/٠٣/٠١

تاريخ انتهاء الفحص: ٢٠١٦/٠٣/١٥

أشارتنا رقم: (١٧٠١٠٢) ٥٥٦١/١/٥٥/٢٣٠

تاريخ: ٢٠١٦/٠٣/١٥

أشارتكم رقم: HSED 2016-01

تاريخ: ٢٠١٦/٠٣/٠١

نتائج الفحص تمثل العينة المفحوصة فقط

أي كشط أو تعديل يلغي هذا التقرير

الفحص	النتيجة	الوحدة	طريقة الفحص
PH	7.14	SU	4500 - H ⁺ B*
EC at 25° C	3440	µs/cm	2510 B*
FOG**	<8	mg/ L	5520 - B*
TPH**	<8	mg/ L	Water Air Soil Solution, 2008

*: Standard Methods for the Examination of Water & Wastewater, Online, 2011
**: Test is not accredited by JAS & UKAS.

ملاحظات:

- حالة العينة عند الاستلام جيدة
- تم ترميز العينة من قبلكم
- معلومات العينة (Deep well No 9 - Sampling @ 14.20 (03/03/2016))

Test report is only valid with deviation-stamp and signature

Test report shall not be reproduced other than in full, except with the written approval of the issuing party

The test results relate only to the items tested

Any erasure or attrition in the report will invalid it

رئيس القسم: صامد القطارنة

مسؤول المختبر: عبد الله عبيدات



صفحة (١) من (١)

FORM NO. RSSPMP1302 REV.(1)





الجمعية العلمية الملكية
Royal Scientific Society

تقرير فحص

الرقم التمييزي للعينه: ١/٣٤٤١/١٦/٠١/١٧

رقم التقرير: ١١٨٧

القطاع: الشؤون الفنية/المختبرات

القسم: مختبرات التحليل الكيميائي الآلي

المختبر: الكروماتوغرافي

تقرير الفحص غير رسمي مالم يحمل التوقيع المعتمد وختم القسم

شركة توليد الكهرباء المركزية المحترمين
عمان

السادة

العنوان

لا ينسخ التقرير بشكل مجزأ إلا بأخذ موافقة خطية من الجهة المصدرة للشهادة

نوع العينة: مياه Deep well No.1

طريقة اخذ العينة: من صاحب العلاقة

تاريخ الاستلام: ٢٠١٦/٠٣/١٠

تاريخ الفحص: ٢٠١٦/٠٣/١٥

اشارتنا رقم: (١٧٠١٠١) ١/٥٥/١٦٣ ٥٥٩

تاريخ: ٢٠١٦/٣/١٥

اشارتكم رقم: HSED 2016-01

تاريخ: ٢٠١٦/٠٣/٠١

نتائج الفحص تمثل العينة المفحوصة فقط

طريقة الفحص	الوحدة	النتيجة	الفحص
Polyaromatic Hydrocarbons			
6410-B*	µg/L	<0.04	Acenaphthylene
		<0.07	Flourene
		<0.07	Phenanthrene
		<0.06	Anthracene
		<0.2	Pyrene
		<0.3	Benzo (a) anthracene
		<0.3	Chrycene
		<0.35	Benzo (b) flourene
		<0.35	Benzo (k) flourene
		<0.6	Benzo (a) pyrene
		<1.1	Indeno (1,2,3-cd) pyrene
		<1.3	Dibenzo (a,h) anthracene
		<1.3	Benzo (g,h,i) pyrene
ملاحظات:			
- حالة العينة عند الاستلام: جيدة.			
*: Standard Methods for the Examination of Water & Wastewater, Online, 2011.			

أي كشط أو تعديل يلغي هذا التقرير

Test report is only valid with deviation-stamp and signature

Test report shall not be reproduced other than in full, except with the written approval of the issuing party

The test results relate only to the items tested

Any erasure or attrition in the report will invalid it

رئيس القسم: م. هشام نصر

مسؤول المختبر: محمد ابو عصفان

FORM NO. RSSPMP1302 REV. (1)

صفحة (١) من (١)



الجمعية العلمية الملكية
Royal Scientific Society

تقرير فحص

الرقم التمييزي للعينه: ٢/٣٤٤١/١٦/٠١/١٧

رقم التقرير: ١١٨٨

القطاع: الشؤون الفنية/المختبرات

القسم: مختبرات التحليل الكيميائي الآلي

المختبر: الكروماتوغرافي

تقرير الفحص غير رسمي مالم يحمل التوقيع المعتمد وختم القسم

شركة توليد الكهرباء المركزية المحترمين
عمان

السادة

العنوان

لا ينسخ التقرير بشكل مجزأ إلا بأخذ موافقة خطية من الجهة المصدرة للشهادة

نوع العينة: مياه Deep well No.8

طريقة اخذ العينة: من صاحب العلاقة

تاريخ الاستلام: ٢٠١٦/٠٣/١٠

تاريخ الفحص: ٢٠١٦/٠٣/١٥

إشارتنا رقم: ١٧٠١٠١ (١٦/٠٣/١٥) ٥٥

تاريخ: ٢٠١٦/٣/١٥

إشارتكم رقم: HSED 2016-01

تاريخ: ٢٠١٦/٠٣/٠١

نتائج الفحص تمثل العينة المفحوصة فقط

طريقة الفحص	الوحدة	النتيجة	الفحص
Polyaromatic Hydrocarbons			
6410-B*	µg/L	<0.04	Accenaphtylene
		<0.07	Flourene
		<0.07	Phenanthrene
		<0.06	Anthracene
		<0.2	Pyrene
		<0.3	Benzo (a) anthracene
		<0.3	Chrycene
		<0.35	Benzo (b) flourene
		<0.35	Benzo (k) flourene
		<0.6	Benzo (a) pyrene
		<1.1	Indeno (1,2,3-cd) pyrene
		<1.3	Dibenzo (a,h) anthracene
		<1.3	Benzo (g,h,i) pyrene
ملاحظات:			
- حالة العينة عند الاستلام: جيدة.			
*: Standard Methods for the Examination of Water & Wastewater, Online, 2011.			

أي كسب أو تعديل يلغي هذا التقرير

Test report is only valid with deviation-stamp and signature

Test report shall not be reproduced other than in full, except with the written approval of the issuing party

The test results relate only to the items tested

Any erasure or attrition in the report will invalid it

رئيس القسم: م. هيثم نصر

مسؤول المختبر: محمد ابو عمان

FORM NO. RSSPMP1302 REV. (1)

صفحة (١) من (١)





الجمعية العلمية الملكية Royal Scientific Society

تقرير فحص

الرقم التمييزي للعينه: ٣/٣٤٤١/١٦/٠١/١٧

رقم التقرير: ١١٨٩

القطاع: الشؤون الفنية/المختبرات

القسم: مختبرات التحليل الكيميائي الآلي

المختبر: الكروماتوغرافي

تقرير الفحص غير رسمي مالم يحمل التوقيع المعتمد وختم القسم

شركة توليد الكهرباء المركزية المحترمين
عمان

السادة

العنوان

لا ينسخ التقرير بشكل مجزأ إلا بأخذ موافقة خطية من الجهة المصدرة للشهادة

نوع العينة: مياه Deep well No.9

طريقة اخذ العينة: من صاحب العلاقة

تاريخ الاستلام: ٢٠١٦/٠٣/١٠

تاريخ الفحص: ٢٠١٦/٠٣/١٥

إشارتنا رقم: ١٧٠١٠١ / ١/٥٥/١٦٣

تاريخ: ٢٠١٦/١٠

إشارتكم رقم: HSED 2016-01

تاريخ: ٢٠١٦/٠٣/٠١

نتائج الفحص تمثل العينة المفحوصة فقط

طريقة الفحص	الوحدة	النتيجة	الفحص
Polyaromatic Hydrocarbons			
6410-B*	µg/L.	<0.04	Acenaphthylene
		<0.07	Flourene
		<0.07	Phenanthrene
		<0.06	Anthracene
		<0.2	Pyrene
		<0.3	Benzo (a) anthracene
		<0.3	Chrycene
		<0.35	Benzo (b) flourene
		<0.35	Benzo (k) flourene
		<0.6	Benzo (a) pyrene
		<1.1	Indeno (1,2,3-cd) pyrene
		<1.3	Dibenzo (a,h) anthracene
		<1.3	Benzo (g,h,i) pyrene
ملاحظات:			
حالة العينة عند الاستلام: جيدة.			
*: Standard Methods for the Examination of Water & Wastewater, Online, 2011.			

أي كشط أو تعديل يلغي هذا التقرير

Test report is only valid with devisions-stamp and signature

Test report shall not be reproduced other than in full, except with the written approval of the issuing party

The test results relate only to the items tested

Any erasure or attrition in the report will invalid it

رئيس القسم: م. هشام نصر

مسؤول المختبر: محمد بن عثمان

FORM NO. RSSPMP1302 REV. (1)

صفحة (١) من (١)





CENETRAL ELECTRICITY GENERATING COMPANY
HUSSEIN THERMAL POWER STATION
CHEMICAL DEPARTMENT
LAB & CHEMICAL INJECTION SECTION

DEEP WELLS MONTHLY REPORT

SAMPLE TYPE: DEEP WELLS WATER	REPORTING DATE : 03/01/2016
LOCATION: HTPS – DEEP WELL	SAMPLING MONTH: December

Test ↓ \ Deep No →	1	2	3	7	8	9	10
pH @ 25 °C	7.38	-	7.35	-	-	-	7.48
X , $\mu\text{S}/\text{cm}$ @ 25 °C	4500	-	4020	-	-	-	2500
TDS ppm	2880	-	2573	-	-	-	1600
SiO ₂ ppm	16.6	-	16.8	-	-	-	17.2
Cl ⁻ ppm	968	-	984	-	-	-	672
T.H as CaCO ₃ ppm	983	-	1016	-	-	-	748
Ca ⁺⁺ ppm	236	-	225	-	-	-	163
Mg ⁺⁺ ppm	147	-	158	-	-	-	123
Na ⁺ ppm	489	-	434	-	-	-	256
Total Fe ppm	0.059	-	0.062	-	-	-	0.046
SO ₄ ⁻² ppm	558	-	573	-	-	-	392
K ⁺ ppm	13	-	12	-	-	-	8
Total alkalinity as CaCO ₃ ppm	208	-	206	-	-	-	224

NOTES:

- Deep wells (2,7,8,9) are not available .

ANALYST
Raid Karajeh

SUPERVISOR
Said Tobassi

SECTION HEAD
Abdullah Alhasani



CENETRAL ELECTRICITY GENERATING COMPANY
HUSSIE THERMAL POWER STATION
CHEMICAL DEPARTMENT
LAB & CHEMICAL INJECTION SECTION

WASTE WATER & NEUTRALIZATION PITS REPORT

SAMPLE TYPE: WASTE WATER	SAMPLING DATE : 29/11/2015
LOCATION: HTPS – WASTE WATER SYSTEM	SAMPLING HOUR: @ 9:30 am

Sample ↓ / Test →	pH @ 25 °C	X , μ S/cm @ 25 °C	TDS ppm	Oil ppm	Remarks
NEUTRALIZATION PIT 4&5	-	-	-	-	Empty
NEUTRALIZATION PIT 6	-	-	-	-	Empty
NEUTRALIZATION PIT R.O	-	-	-	-	Stop
AFTER OIL SEPARATOR	6.31	77	49	-	-
TOTAL WASTE WATER	7.36	569	364	11	-
RECOMMENDED VALUES	6.0 - 9.0	-	-	<100	-

NOTES:

.....

.....

.....

.....

.....

.....

ANALYST

Raed Karajeh

SUPERVISOR

Said Tobassi

SECTION HEAD

Abdullah Alhasani

CENTRAL ELECTRICITY GENERATING COMPANY

HTPS - DW # 8 Monitoring Report

Date & Hour	07:00	08:00	09:00	11:30	14:00	19:00	Notes
01/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
02/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
03/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
04/02/2016			Nil				
07/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
08/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
09/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
10/02/2016			Nil		Nil		* sample @ 9:00 is Turbid but @ 14:00 is clear
11/02/2016				Nil			sample is clear / conductivity : 4000 μ S/cm , pH : 7.20

HFO Concentration, v/v %

Appendix M

Hydrogeology Study



Groundwater Investigation in the Vicinity of the Hussein Thermal Power Plant



November 2012

Table of Contents

1) Introduction	3
2) Geologic Setting	4
3) Topography	4
4) Hydrogeologic Settings	7
5) Groundwater Flow	11
6) Groundwater Quality.....	14
7) Recommendations	17

1) Introduction

Hussein power plant is located in the northern region of Jordan, approximately 30 km northeast of the capital Amman. The plant site is located within Zarqa Industrial area and is situated 560 m above sea level. Hussein power plant comprises 7 generating units, 3 of which are steam turbines, nominally rated at 33 MW gross, 4 are steam turbines rated at 66 MW gross (CEGCO).

Within the power plant the water demand is being satisfied through groundwater wells distributed mainly in the northern parts of the plant penetrating mainly the upper B2A7 limestone aquifer which outcrops in the area with partial penetrating of the A4 aquifer in some wells (Figure 1)

According to the records of the Ministry of Water and Irrigation the average depth of groundwater wells ranges from 86m to 280m with a static water level between 480 and 490m asl.

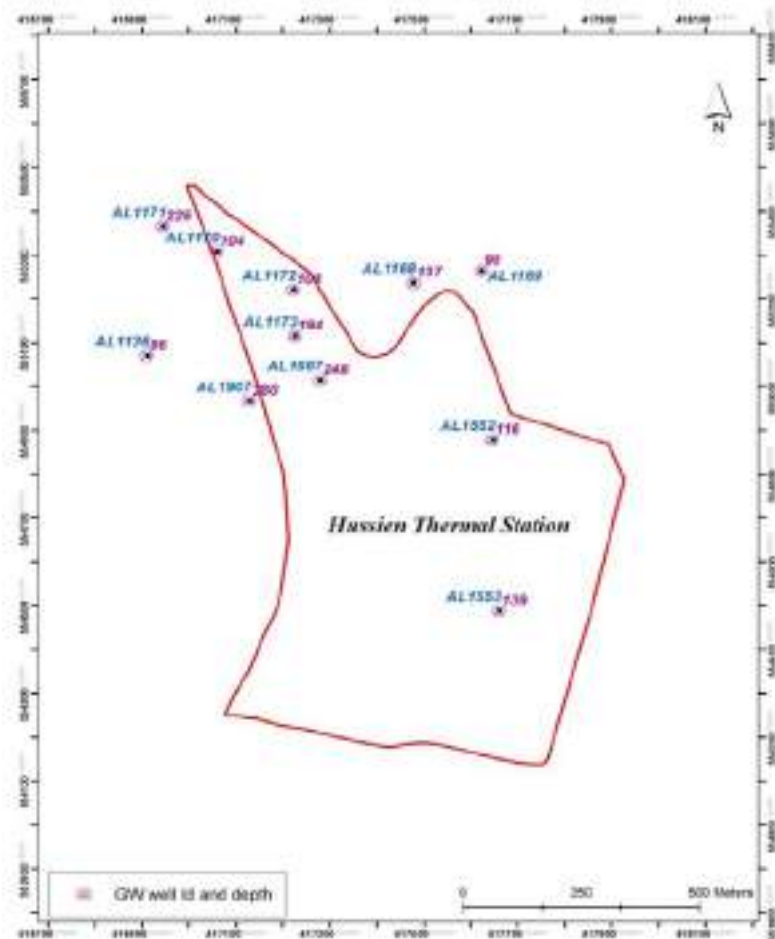


Figure 1: Groundwater wells location and depth within and in the surroundings of the thermal station.

2) Geologic Setting

The geologic outcrops in the study area are shown in figure 2. The dominant geologic units are of late Cretaceous age composed of limestone, marl and marly limestone belonging to Ajlun and Balqa groups. Inplaces they are covered by quaternary soil, alluvium and lacustrine gravels.

In the northern parts of the area a Tertiary basaltic flow crops out and extends from Samra treatment plant to the north along Zarqa River. The geologic succession is given in table 1.

Table 1: Geologic outcrops in the study area.					
Formation	Symbol	Group	Period	Era	Stage
Soil over bedrock	S		Quaternary	Cenozoic	Holocene - Recent
Alluvium and Wadi Sediments	Al		Quaternary	Cenozoic	Holocene - Recent
Fluviatill and Lacustrine Gravels	Pl		Quaternary	Cenozoic	Pleistocene
Abed Olivine Phyric Basalt	AOB	Safawi	Tertiary	Cenozoic	Miocene
Amman Silicified Limestone	ASL	Belqa	Late Cretaceous	Mesozoic	Campanian
Wadi Umm Ghudran	WG	Belqa	Late Cretaceous	Mesozoic	Santonian
Wadi as Sir Limestone	WSL	Ajlun	Late Cretaceous	Mesozoic	Turonian
Fuhays/Hummar/Shu'ayb	FHS	Ajlun	Late Cretaceous	Mesozoic	Cenomanian

3) Topography

The station is located within Amman Zarqa ground and surface water basins with an elevation range within the station from 530 to 580 masl.

The vicinity of the station is modeled to form a medium relief area with elevations ranging from 475 masl 3 km northwest of the station to a maximum of 690masl 3 km south west of the station as shown in figure 3.

The power station site is located between two main drainage courses trending from south and east and pour in Zarqa River in the northern part of the study area as shown in figure 4.

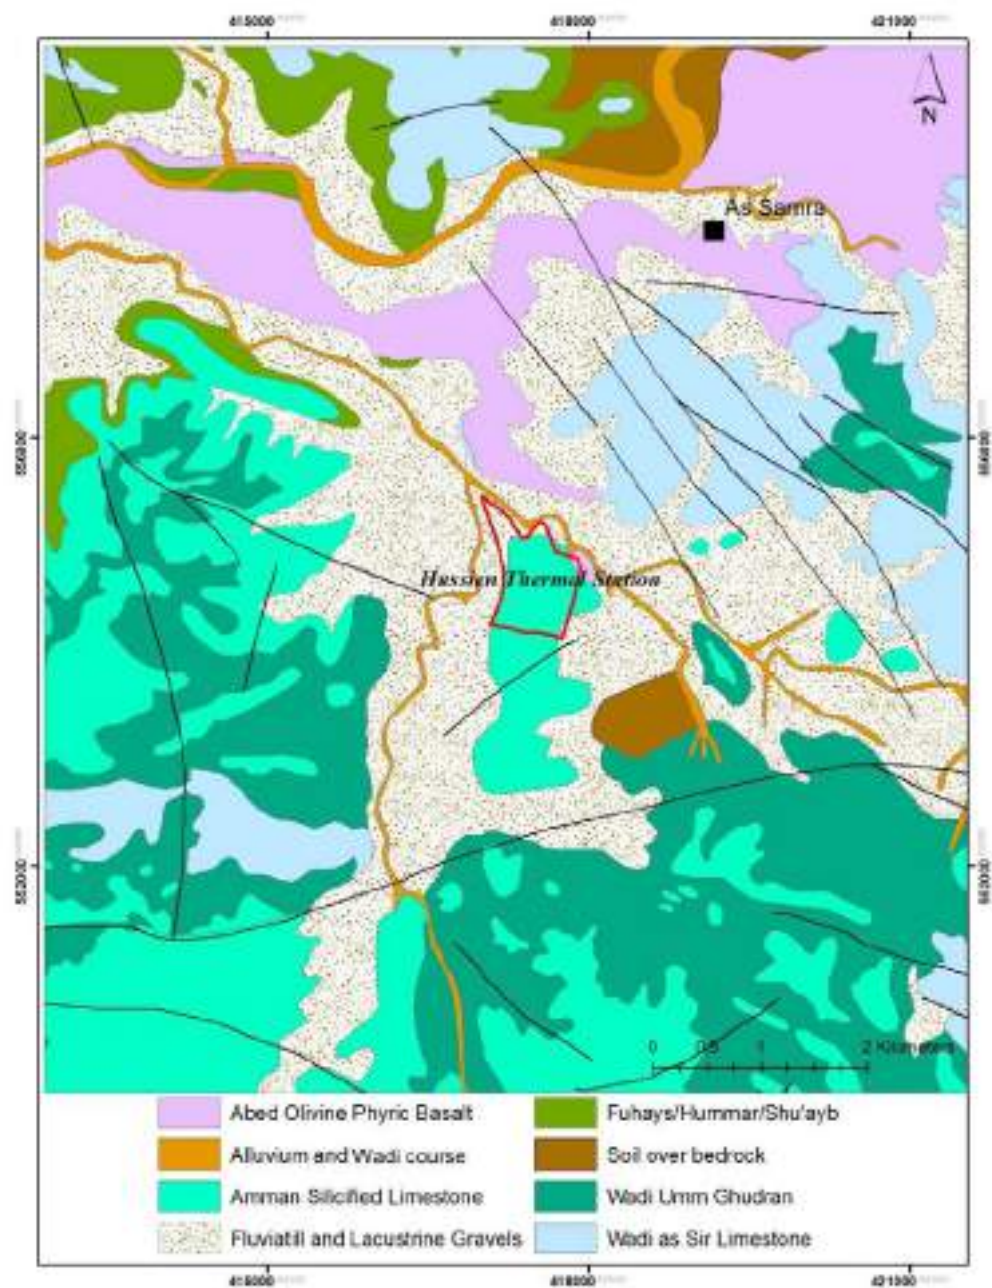


Figure 2: Geologic outcrops in the study area.

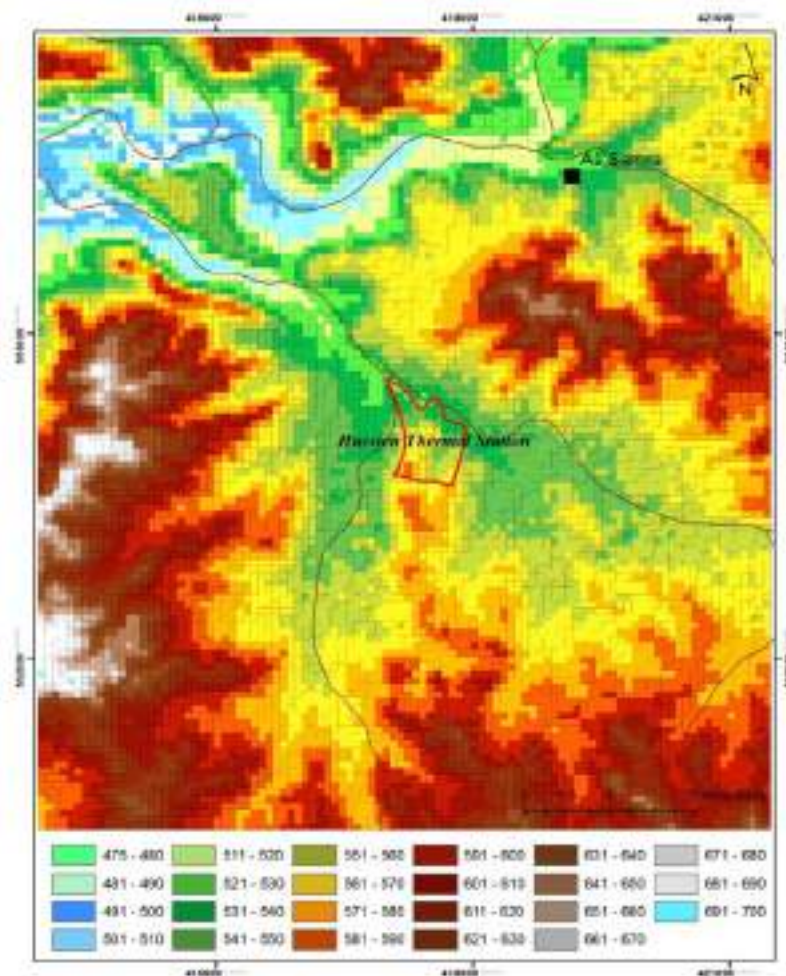


Figure 3: Digital Elevation model of the area.

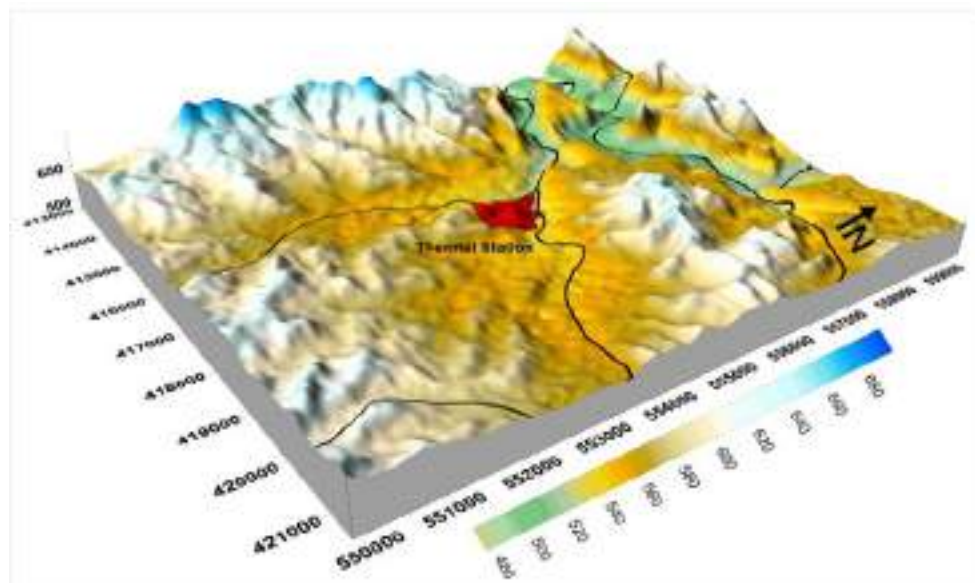


Figure 4: 3D model of the study area.

4) Hydrogeologic Settings

The power station is located in the center of Amman Zarqa groundwater basin which is one of the most important groundwater basins in Jordan.

The main hydrogeologic unit is the composite aquifer of the A7 and B2 units, which are high productive units, composed of Wadi Sir Lime stone (A7) and Amman Silicified Limestone unit with an average thickness of 130m within the thermal station. Um Ghudran chalky Limestone unit (B1) between the B2 and A7 aquifers is a semi aquifer, but it hydraulically connects the overlying B2 with the underlying A7 aquifers, building the B2/A7 composite aquifer system.

The base of this productive composite aquifer system is located at a depth of 80 m in the north western parts of the area increasing gradually to reach a maximum of 240m in the southern parts of the area (Figure 5)

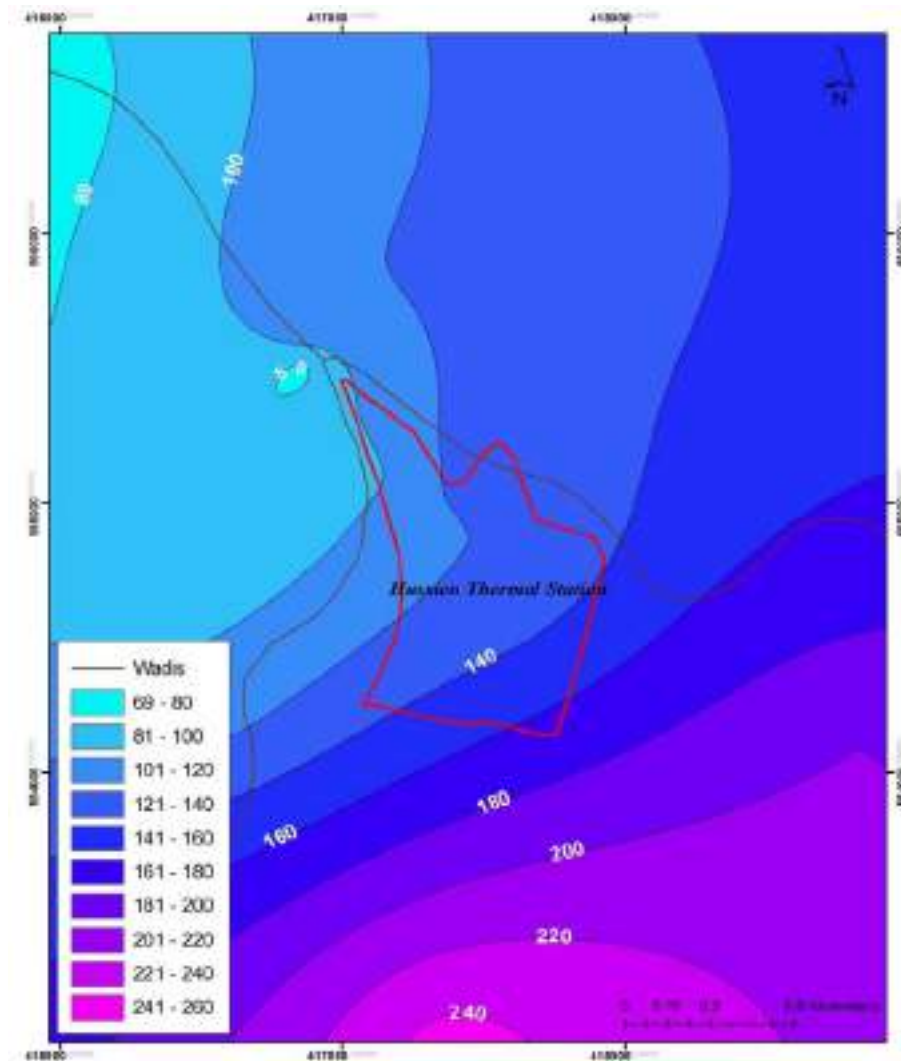


Figure 5: Depth to the base of B2A7 aquifer unit

Within the Thermal power station the base level of this unit is restricted between depths of 100m to 160m giving a maximum well depth of 160m in the southern parts of the power station.

The thickness of this unit or the base depth to the underlying aquiclude (not a water producing unit) represents the limiting factor for the depth of groundwater wells in the area.

Due to this distribution of the B2A7 units the groundwater wells in the area were drilled to depths ranging from 38 m in the low thickness zone reaching a maximum of 238m in the southern parts of the area where the thickness is relatively high (Figure 6).

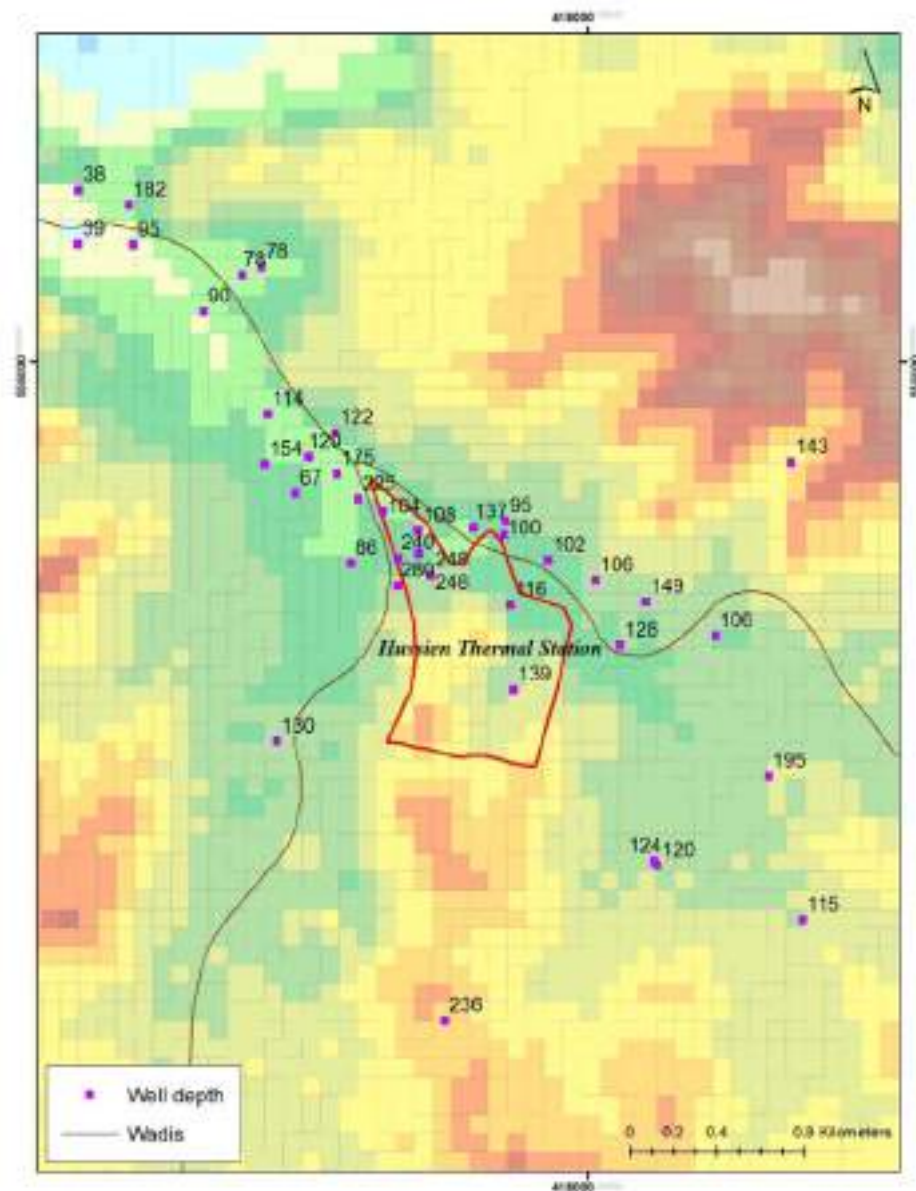


Figure 6: Groundwater wells distribution and depth within and in the vicinity of the thermal station.

In the central parts of the area few wells were drilled with a depth exceeding 200 m to invest the second productive groundwater aquifer, known as Hummar Formation (A4) in the middle Ajlun group.

The B2 A7 aquifer is underlain by the A5 A6 Aquitard unit which separates it from the A4 (middle aquifer) systems.

The Base depth of the A5,6 layer ranges from 200m in the North western parts of the area reaching a maximum of 340m below the surface in the southern parts of the area (Figure 7).

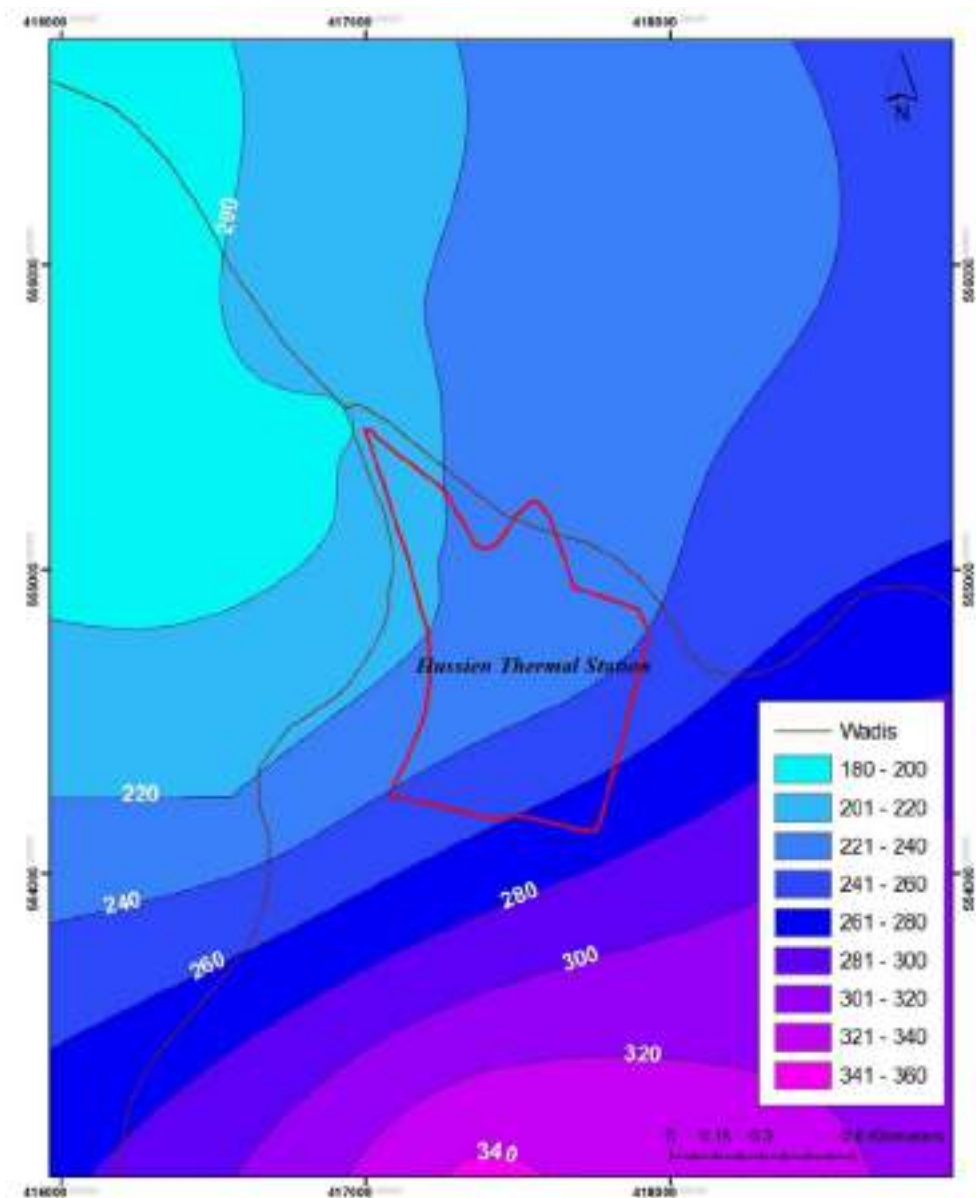


Figure 7: Depth to the base of A5-6 aquitard unit.

By modeling of the hydrogeological units base distribution the thickness of the A5 A6 Aquitard unit is calculated to be in a range of 100m to 108m separating the two aquifer system with a low permeability layer preventing hydraulic connection between these two aquifer systems (Figure 8).

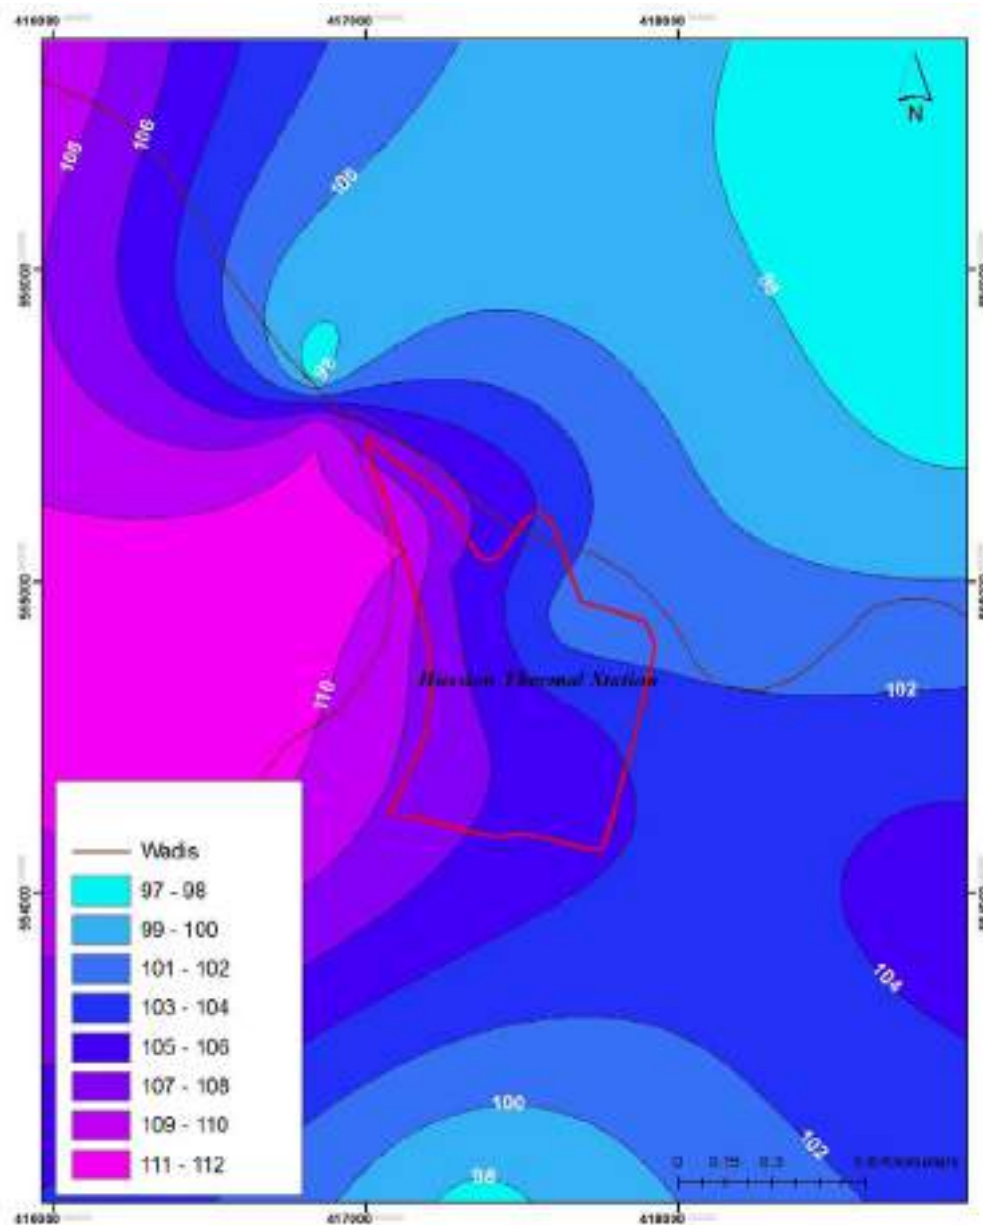


Figure 8: Thickness distribution of the A5-6 aquitard unit.

5) Groundwater Flow

The records of the Ministry of Water and Irrigation (MWI) updated in October 2012, show that the water levels of observation wells data were recently measured for wells within and around the power station.

A map of groundwater flow was created in the GIS environment based on static water level measurements. Information of the observation wells data allowed constructing groundwater table and groundwater flow lines (Fig. 9).

The obtained groundwater flow map of the area of the power station illustrate the severe with over pumping resulting from the high concentration of groundwater wells in the Hashimya area leading to a drop in the water level forming a sink for the groundwater and allowing water from all the surrounding areas to flow to this sink.

The water table within the power station was found to be in the range of 480 masl to 490m asl.

The surrounding water levels are relatively high in the southern parts of the area with a water table of 510m asl generating a groundwater flow towards the power station well field.

The presence of Samra waste water treatment plant produced a recharge mound created due to the infiltration of treated waste water into the upper aquifer system and giving a water table as high as 550m asl.

The presence of the recharge mound created a groundwater divide located 3 km north of the power station that enhanced the groundwater flow towards the power station with a high hydraulic gradient. It also generated another groundwater flow from that recharge mound to the north.

The presence of this high groundwater recharge and flow amount from the treatment plant to the power station may lead to NO₃ enrichment in the groundwater.

A major flow line crosses the Oil Refinery and reaches the power station which may be considered as the source of the oil in the groundwater wells within the power station.

A cross section was constructed from the recharge mound downstream of Samra treatment plant to the south eastern parts of the study area (Figure 10).

The cross section shows a very high hydraulic gradient of 3% from the recharge mound to the thermal station compared with a relatively low gradient of 0.4% for the groundwater flow coming from the south east, while the hydraulic gradient for the groundwater flowing from the oil refinery to the thermal station is around 1.2%.

The high hydraulic gradient has formed due to two factors, the groundwater over drafting in the vicinity of the thermal plant and the recharge from Samra waste water treatment plant effluent creating a recharge mound raising the water table about 50 meter above the average groundwater table in the area as shown in the records of the observation wells (Figures 11, 12 and 13).

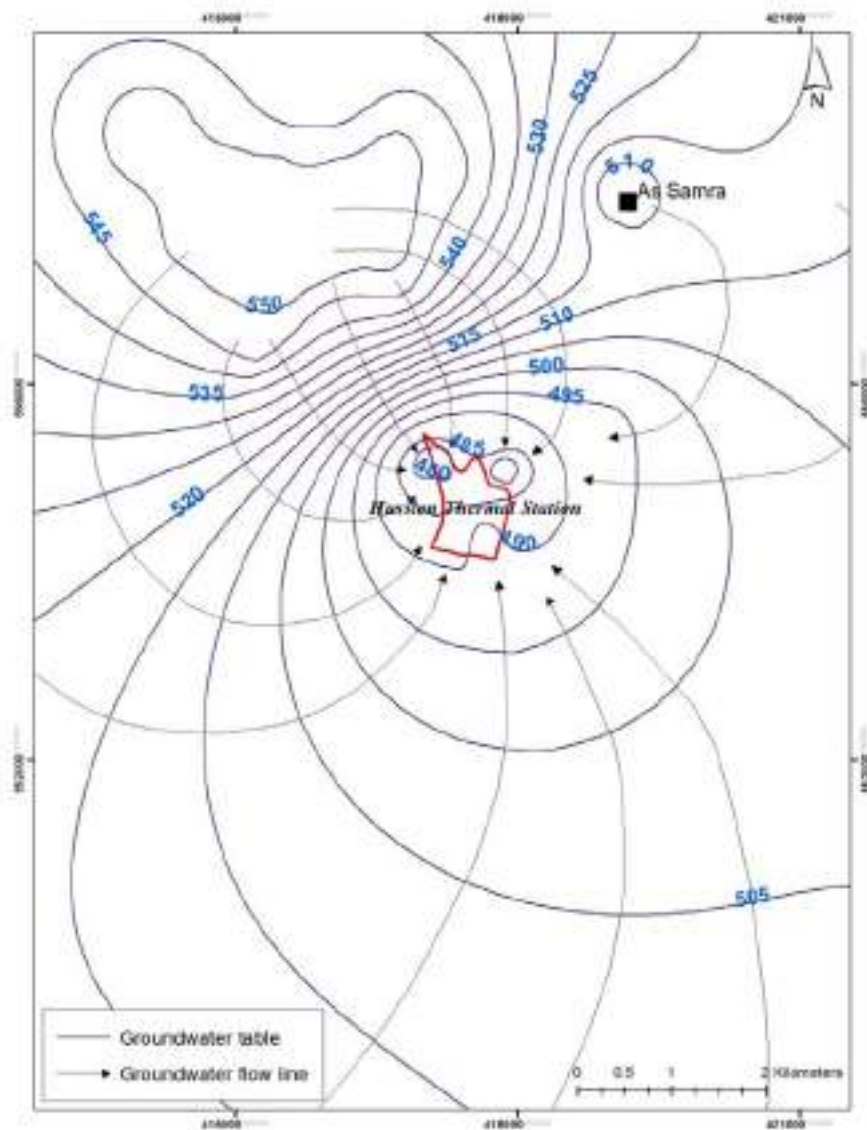


Figure 9: Groundwater flow pattern of the B2A7 aquifer.

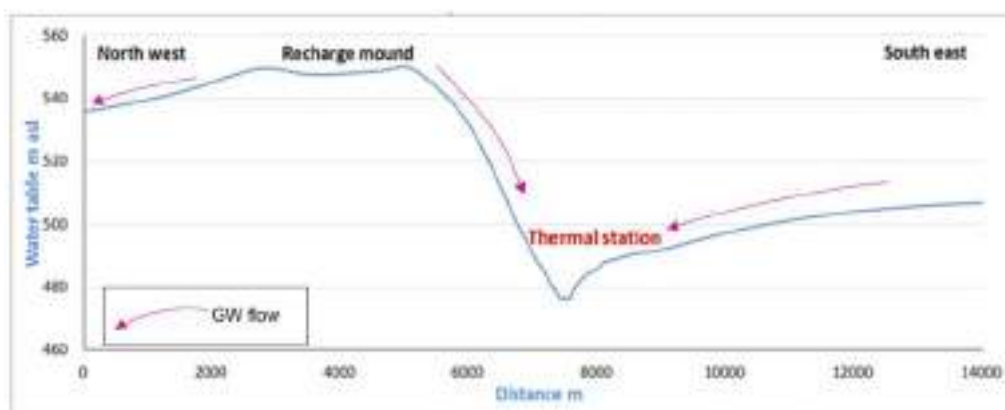


Figure 10: Water table cross section

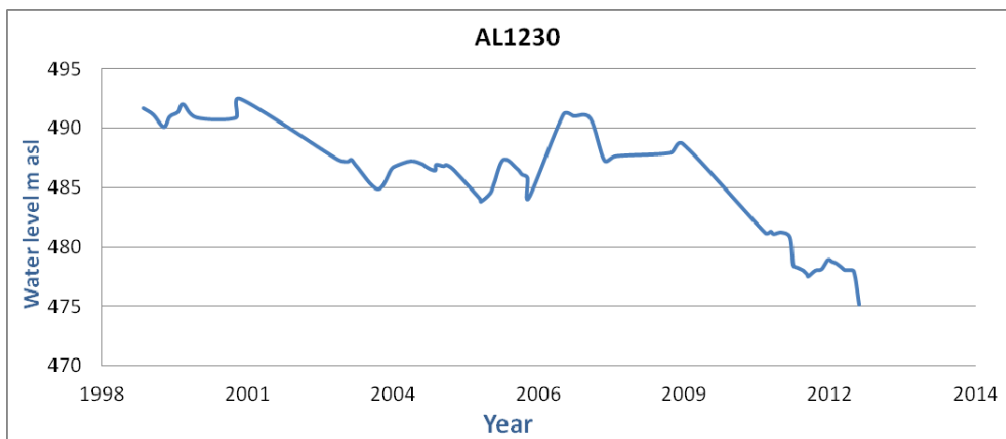


Figure 11: Groundwater hydrograph east of the thermal station (In general, declining water level).

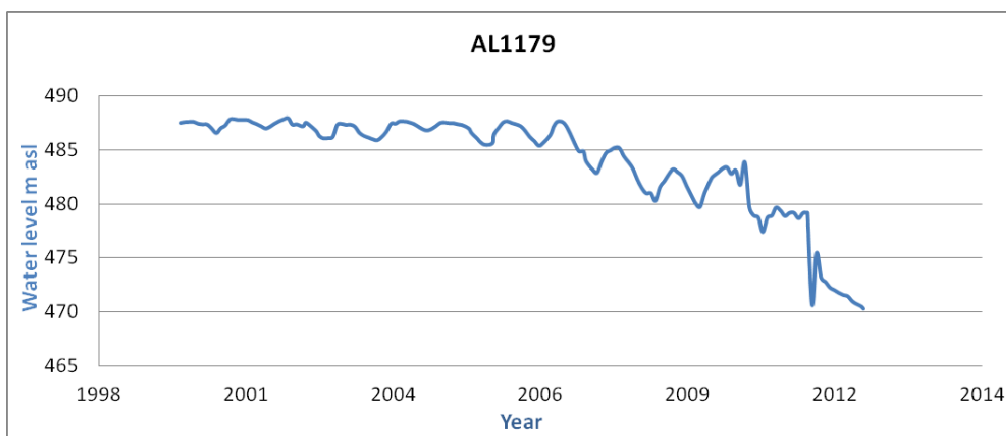


Figure 12: Groundwater hydrograph west of the thermal station (declining water level).

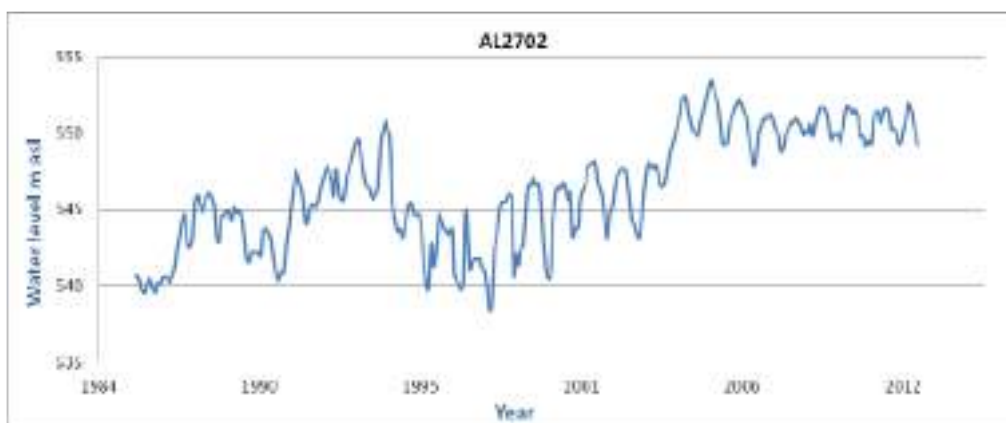


Figure 13: Groundwater hydrograph downstream of Samra treatment plant (Increasing water level).

6) Groundwater Quality

The salinity of the groundwater in the water wells of the plant, (wells: 1, 2, 3, 7, 8, 9, and 10) range from around 2000 to 4000 $\mu\text{S}/\text{cm}$, without a clear pattern of areal distribution.

The nitrate content, which can shed light on the origin of groundwater and the affecting environmental conditions range in average from around 35 to 80 mg/l. Natural, unpolluted groundwater in Jordan has values of less than 15mg/l. Therefore, it can be concluded that a major source of pollution causes the deterioration of the area's groundwater resources (Fig. 14)

The presence of phosphate in concentrations of 10 to 60 microgram/l is also a sign of pollution resulting from a municipal or agricultural type of wastes, but agriculture is very limited in the area and its wider surroundings. Therefore, the pollution can originate from household waste waters, which is collected and treated in Khirbet es Samra treatment plant lying 4km north of the power plant.

The other parameters of calcium, magnesium, sodium, potassium, chloride, sulfate, and bicarbonate are salinity indicators and reflect water rock interactions. Their concentration in the wells of the area can not allow specifying the origin of the water or its sources.

Well 2 in the northeastern area of the plant has low salinity (EC value) of around 2000 $\mu\text{S}/\text{cm}$. The same applies for wells 7 and 10 lying in the central western part of the area, with their low salinity of 2000 and 2100 mg/l (Fig. 15)

When combining the water quality findings with the groundwater flow pattern (Figure 9) the following can be concluded:

1. The area receives groundwater from all directions; north, east, south and west.
2. The groundwater coming from the east-northeast direction has relatively low salinity but the contributions of that flow to the groundwater of the area are limited in quantity.
3. The contributions from the recharge mouth in the area lying in the northwest of the plant also contribute to the groundwater resources of the area. But that groundwater on its underground course to the aquifer underlying the plant receives recharge from the effluents of Khibet es Samra along wadi Dhuleil.
4. Knowing that the effluents of Khirbet es Samra are highly aggressive and dissolve minerals from the rock matrix during their infiltration to the groundwater and when moving as a groundwater flow. Now, and depending on the flow pattern of the groundwater, and the permeability of the rocks and the geologic structures present in them, mixing ratios of the original groundwater with the infiltrating water from Khirbet es Samra effluents produce a variety of groundwater qualities even in wells hundreds of meters apart. Therefore, wells in the central western area show a high range of salinities within a small area, ranging from 2000 to 3800 $\mu\text{S}/\text{cm}$.
5. On its way to the plant site the groundwater coming from a southwestern direction flows in the underground of the Oil Refinery plant, which might contribute to the groundwater of the area with leakages, containing pollutants, which later on feed the groundwater underlying the Power Plant as indicated by the water quality of well 9.

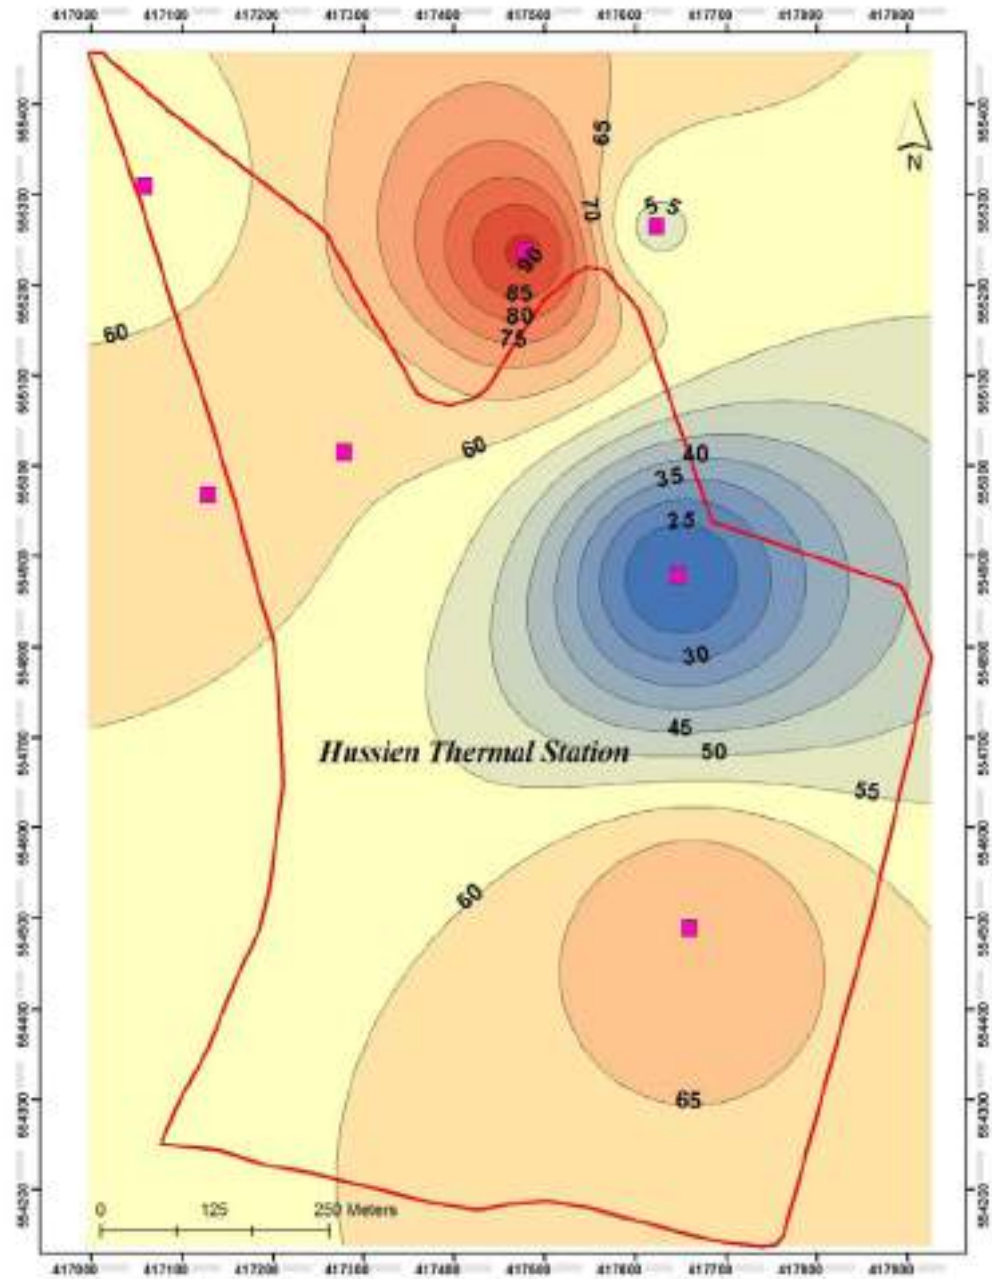


Figure 14: Concentrations of NO_3 in the thermal plant area in mg/l.

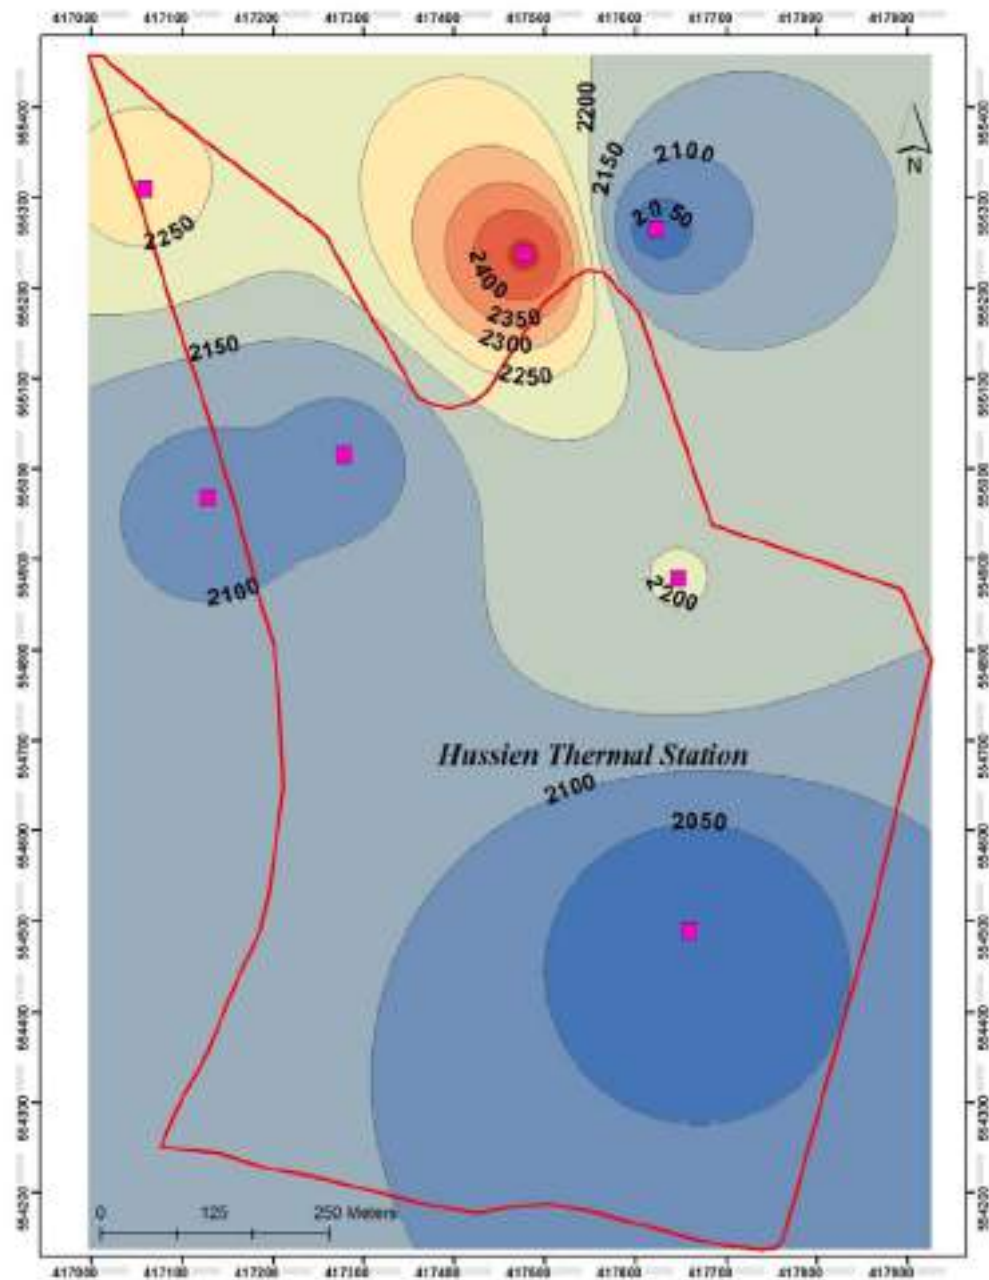


Figure 15: TDS value in the thermal plant area mg/l.

7) Recommendations

The power plant can drill more wells in the plant or its surroundings areas and can extract more water. But that water will continue to remain of impaired quality until the recent improvement of treatment in Khirbet es Samra are reflected in the water quality of the wells. Given the above, the following serves as a recommendation for the power plant.

- 1) Whether the water is taken from the groundwater underlying the plant or its further surroundings or from the effluents of Khirbet es Samra directly or indirectly from wadi Dhuleil is the same for the water balance of the area. Therefore, it is recommended that negotiations with the Ministry of Water and Irrigation (MoWI) take place in order to provide the power plant with treated waste water instead of getting it after infiltration and flow to the existing wells of the power station
- 2) Drilling wells or deepening of existing wells into the deeper aquifer A4, Hummar Formation can also provide water with good quality. But, such wells may need development to enhance their yield because their yields under natural conditions may not be high enough to serve the purpose of the power station. In addition, the depth to the A4 may be 350 m and more, but the water level will certainly be shallower than the aquifer, because the aquifer; A4 in the area is confined. Deepening the current wells or drilling new deep wells require penetrating the A56 unit which is around 110 m, so the available wells needs to be deepen with at least 200 additional meter for each well to go through the A56 Aquitard unit and penetrate the productive A4 unit with a good saturated thickness.

Appendix N

EIA Approval from Ministry of Environment in Jordan

Appendix O

Project Land Use Breakdown

SCHEDULE 1
HTPS REPOWERING PROJECT
LANDS TO BE LEASED TO THE PROJECT COMPANY

LAND AREA
50106M²

LAND AREA
26565M²

LAND AREA 1689M²

LAND AREA 1015M²

LAND AREA
37527M²

LAND AREA
14582M²

LAND AREA 3092M²

LAND AREA
11766M²

LAND AREA 3650M²

HUSSEIN THERMAL POWER STATION
EXTENSION PLANT
LAND AREA ≈ 149992M²
CEGCO DWG NO. 2-1-21-G0-0001

N=170472.674
E=253886.041

N=170458.631
E=253870.143

N=170309.957
E=256108.953

N=170257.851
E=256408.610

N=170210.406
E=256460.446

N=170199.988
E=256465.646

N=170190.474
E=256095.931

N=170165.176
E=256193.895

N=170141.908
E=253973.516

N=170169.038
E=256178.939

N=170113.193
E=256224.394

N=170102.978
E=256293.271

N=170115.890
E=256076.765

N=170090.346
E=256227.647

N=170092.251
E=256299.527

N=170036.969
E=256501.475

N=170029.941
E=256527.149

N=170008.393
E=256508.643

N=170001.034
E=256506.331

N=169989.632
E=256541.721

N=169921.421
E=256753.878

N=169846.292
E=256788.881

N=169875.039
E=256466.250

N=169869.217
E=256486.602

N=169854.616
E=256496.578

N=169813.537
E=256483.196

N=169809.998
E=256486.364

N=169844.259
E=256580.544

N=169731.711
E=256474.859

N=169738.672
E=256469.732

N=169635.744
E=256461.560

N=169635.602
E=256415.629

N=169645.014
E=256387.200

N=169660.678
E=256534.069

N=169596.593
E=256371.579

N=256437.161
E=169575.160

N=169552.576
E=256506.213

N=256448.585
E=169571.427

N=256359.055
E=169281.189

N=256370.570
E=169277.795

Appendix P

Project Well Licenses

The attached below are Licenses issued from WAJ (Water Authority of Jordan) regarding the Drilling of THREE new deep water wells to replace Three of the existing deep wells in Project land, in a circle of 50 meters around each of the old deep wells center, as indicated in the below table & picture:

#	Existing DW	Location		License Issue Date	Expected Date
		East	West		
W01-2	Deep Well No.2	256460.32	170161.82	7-Apr-2016	7-Aug-2016
W01-6	Deep Well No.6	256131.14	170227.22	7-Apr-2016	7-Aug-2016
W01-10	Deep Well No.10	256022.03	170187.4	7-Apr-2016	7-Aug-2016



١٣٢٧ / ٥ - ١ - ٤
٢٠١٦ - ٤ - ١٥

عطوفة أمين علم منطقة المواء المحترم
عمان - الأردن

الموضوع :- الأنبار الارتوازية في محطة الحسين الحرارية.

بالإشارة الى موافقة عطوفتكم على رخص عمل والخاصة بحفر بئر ارتوازي عند (3) في محطة الحسين الحرارية من اراضي الهاشمية محافظة الزرقاء ، وبحسب الموافقات الداء :-

- 1- كتابكم رقم م/٤٢٦٠/١٠/٤/٤ ، تاريخ ٢٠١٦/٤/٧ الخاص بحفر بئر بدل بئر الشركة رقم (2) صناعي.
- 2- كتابكم رقم م/٤٢٦١/١٠/٤/٤ ، تاريخ ٢٠١٦/٤/٧ الخاص بحفر بئر بدل بئر الشركة رقم (4) صناعي.
- 3- كتابكم رقم م/٤٢٦٦/١٠/٤/٤ ، تاريخ ٢٠١٦/٤/٧ الخاص بحفر بئر بدل بئر الشركة رقم (5) صناعي.

بناء عليه ارجو عطوفتكم التكرم بالإيعاز لمن يلزم بإعداد المواصفات الفنية الخاصة بحفر الابار حسب الاصول ليتم طرح عملاء من قبلنا بهذا الخصوص .

وتتعهد بضديد ودفع كافة الرسوم والمصاريف المطلوبة بهذا الخصوص .

ونفضلوا عطوفتكم بقبول فائق الاحترام ...

ع/ الرئيس التنفيذي بالوكالة

نديم زريقي

المدير التنفيذي لإدارة الموجودات

المهندس ماهر طييشات

نسخة / م. ت. موحدة

مست. تشغيل وصيانة

/ المراقب المالي

/ م. د. تهنية المتنية والامكانات

بسم الله الرحمن الرحيم

المملكة الأردنية الهاشمية

وزارة المياه والري

سلطة المياه

ورخصة عمل

رقم الكتاب الصادر من م/٤/٤/١٠/٢٠١٦/٤٤٦٦

التاريخ: ٢٠١٦/٤/٤

رقم الرخصة: (بئر الشركة ٥)

نوعها: رخصة حفر بئر بئر / صناعي

تاريخ انتهاء الرخصة: ٢٠١٧/٤/٤

يصرح السند / شركة توليد الكهرباء المركزية

حفر بئر ماء في قطعة الأرض رقم () حوض رقم () من أراضي (الهاشمية) محافظة (الزرقاء)

يقصد استخراج المياه الجوفية خلال سنة واحدة من تاريخ صدور هذه الرخصة .

أمين عام سلطة المياه

المهندس توفيق الحياثي

- نوع ومبنى الأعمال المصرح بها حفر البئر في ملتقى الإحداثيات التالية شرقاً (٢٥٦.٠١٥) شمالاً (٢١٧٠.١٩٧) على أن يتقيد صاحب العلاقة بالشروط التالية :-
 ١. أن لا يباشر عملية الحفر إلا بعد إعلام هذه السلطة وبيان موقع البئر على الطبيعة واحضار صورة مصلقة عن رخصة الحفارة والحفار.
 ٢. تجري تجرية البئر تحت إشراف سلطة المياه.
 ٣. ستقوم سلطة المياه بتركيب عند ماني على بئركم وعلى نفقتكم الخاصة وعليكم للحفاظ عليه من العبث وإعلام السلطة خلال ٢٤ ساعة في حال حدوث عطل في العند.
 ٤. عدم بيع المياه لأي غرض كان سواء للشرب أو الصناعة أو للزراعة.
 ٥. عدم استعمال المياه إلا لأغراض المشروع فقط.
 ٦. تركيب ماسوره (١) أنش بجلت للضخه لقياس سطح الماء عند الضرورة .
 ٧. دفع رسم مقداره (٥٠٠) فلس عن كل متر مكعب من المياه المستخرجة من البئر.
 ٨. تزويد سلطة المياه بتقارير شهرية عن مسحوباتكم من مياه البئر .
 ٩. اتخاذ كافة التدابير لحماية مصادر المياه من التلوث بالنفايات الصلبة والسائلة.
 ١٠. أن لا يتجاوز العمق الكلي للبئر عن (١٠٨) متر.
 ١١. فتلخص من المخلفات الصلبة في الموقع الذي تعينه الجهات المختصة وأن تكون عملية التجميع والنقل والتخلص ضمن إشرافات دائرة البيئة / وزارة الشؤون البلدية والبيئة.
 ١٢. معالجة المخلفات السائلة والسائلة الناتجة عن الاستعمالات البشرية بما لا يترك أثر على البيئة.
 ١٣. الالتزام بشروط وزارة الشؤون البلدية والبيئة كاملة للحفاظ على البيئة والصحة والسلامة العامة.
 ١٤. تعتبر هذه الرخصة ملغاة حكماً في حالة مخالفة أي شرط من شروط الرخصة.
 ١٥. تلغى الرخصة تلقائياً في حال عدم إقامة المشروع أو اغلاقه لأي سبب ويغلق البئر أو يردم ما تم إنجازه من العمل فيه خلال عام من تاريخه.
 ١٦. تقديم كفالة بنكية بقيمة (١٠٠٠٠) دينار للإلتزام بشروط الرخصة.
 ١٧. ردم البئر بتقديم تحت إشراف السلطة قبل المباشرة بعملية حفر البئر الجديد .
 ١٨. احضار شركته للتعهد لتقديم تعهد خطي للإلتزام بشروط الرخصة .
 ١٩. أن تتم عملية حفر البئر تحت إشراف السلطة .
 ٢٠. الحصول على رخصة استخراج عند الانتهاء من حفر البئر.
- اطلعت على الشروط وأعلم بالالتزام بتنفيذها
- صاحب العلاقة

بسم الله الرحمن الرحيم

المملكة الأردنية الهاشمية

وزارة المياه والري

سلطة المياه

رخصة عمل

رقم الكتاب الصادر من م/ ١٠/٤/٤ / ٤٠٦٦

التاريخ: ٢٠١٦/٤/٧

رقم الرخصة: (بشر الشركة ٤)

نوعها: رخصة حفر بئر بلبل بشر / صناعي

تاريخ انتهاء الرخصة: ٢٠١٧/٤/

يصرح للملح / شركة توليد الكهرباء المركزية

حفر بئر ماء في قطعة الأرض رقم () حوض رقم () من أراضي (الهاشمية) محافظة (الزرقاء)

بقصد استخراج المياه الجوفية خلال سنة واحد من تاريخ صدور هذه الرخصة .

أمين عام سلطة المياه

المهندس توفيق الحباشنة

- نوع ومدى الاعمال المصرح بها حفر البئر في مئتي الأحتاثات التالية شرقا (٢٥٦,١٣٩) شمالا (١١٧٠,٢٢٢) على ان يتقيد صاحب العلاقة بالشروط التالية -
١. ان لا يباشر عملية الحفر الا بعد اعلام هذه السلطة وبيان موقع البئر على الخريطة واحضار صورة مصدقة عن رخصة الحفارة والحفار.
 ٢. تجري تجربة البئر تحت اشراف سلطة المياه.
 ٣. ستقوم سلطة المياه بتركيب عداد مائي على بئركم وعلى نفقتكم الخاصة وعليكم المحافظة عليه من العبث والاعلام السلطة خلال ٤٨ ساعة في حال حدوث عطل في العداد.
 ٤. عدم بيع المياه لأي غرض كان سواء للشرب أو للصناعة أو للزراعة.
 ٥. عدم استعمال المياه إلا لأغراض المشروع فقط.
 ٦. تركيب ماسوره (١) انش بجانب المضخة لقياس سطح الماء عند الضرورة .
 ٧. دفع رسم مقداره (٥٠٠) فلس عن كل متر مكعب من المياه المستخرجة من البئر.
 ٨. تزويد سلطة المياه بتقارير شهرية عن مسحياتكم من مياه البئر .
 ٩. اتخاذ كافة التدابير لحماية مصادر المياه من التلوث بالنفايات الصلبة والسائلة.
 ١٠. أن لا يتجاوز العمق الكلي للبئر عن (٢٢٥) متر.
 ١١. التخلص من المخلفات الصلبة في الموقع الذي تحدده الجهات المختصة وان تكون عملية التجميع والنقل والتخلص ضمن اشتراطات وزارة البيئة / وزارة الشؤون البلدية والبيئة.
 ١٢. معالجة المخلفات الصلبة والسائلة الناتجة عن الاستعمالات البشرية بما لا يترك اثر على البيئة.
 ١٣. الالتزام بشروط وزارة الشؤون البلدية والبيئة والبيئة والصحة والسلامة العامة.
 ١٤. تعتبر هذه الرخصة ملغاة حكماً في حالة مخالطة أي شرط من شروط الرخصة.
 ١٥. تلغى الرخصة تلقائياً في حال عدم اقامة المشروع او اغلاقه لأي سبب ويعلق البئر او يردم ما تم حفره من العمل فيه خلال عام من تاريخه.
 ١٦. تقديم كفالة بئكية بقيمة (١٠٠٠٠) دينار للإلتزام بشروط الرخصة.
 ١٧. ردم البئر القديم تحت اشراف السلطة قبل المباشرة بعملية حفر البئر الجديد .
 ١٨. احضار الشركة للضمان لتقديم تعهد خطي للإلتزام بشروط الرخصة .
 ١٩. ان تتم عملية حفر البئر تحت اشراف السلطة .
 ٢٠. الحصول على رخصة استخراج عند الانتهاء من حفر البئر.
- اطلعت على الشروط اعلاه وملتزم بتنفيذها
- صاحب العلاقة

المملكة الأردنية الهاشمية

وزارة المياه والري

سلطة المياه

رخصة عمل

٦٠

رقم الترخيص الصادر: م/٤/٤/١٠

التاريخ: ٢٠١٦/٤/١٠

رقم الرخصة: (بئر الشركة ٢)

نوعها: رخصة حفر بئر بدل بئر / صناعي

تاريخ انتهاء الرخصة: ٢٠١٧/٤/

يصرح للمادة / شركة توليد الكهرباء المركزية

حفر بئر ماء في قطعة الأرض رقم () حوض رقم () من أراضي (الهاشمية) محافظة (الزرقاء)

بمقصد استخراج المياه الجوفية خلال سنة واحدة من تاريخ صدور هذه الرخصة .

أمن عام سلطة المياه


المهندس توفيق الخطيب

نوع ومدى الاعمال المصرح بها حفر بئر في ملقى الاحداثيات التالية شرقاً (٢٥٦,٦٦٢) شمالاً (١١٧٠,٦٦٠) على ان يتقيد صاحب العلاقة بالشروط التالية :-

١. ان لا يبشر عملية الحفر الا بعد اعلام هذه السلطة وبيان موقع البئر على الطبيعة وحضور مصادره
 ٢. عن رخصة الحضارة والحفر.
 ٣. تجري تجرية البئر تحت اشراف سلطة المياه.
 ٤. ستقوم سلطة المياه بتركيب عماد مائي على بئركم وعلى نفقتكم الخاصة وعليكم المحافظة عليه من الحبث واعلام السلطة خلال ٤٨ ساعة في حال حدوث عطل في العداد .
 ٥. عدم بيع المياه لأي غرض كان سواء للشرب او الصناعة او للزراعة.
 ٦. عدم استعمال المياه الا لغراض المشروع فقط.
 ٧. تركيب ماسوره (١) فئس بجانب المضخة لقياس سطح افاء عند الضرورة .
 ٨. دفع رسم مقداره (٥٠٠) فلس عن كل متر مكعب من المياه المستخرجة من البئر .
 ٩. تزويد سلطة المياه بتقارير شهرية عن مسجوباتكم من مياه البئر .
 ١٠. اتخاذ كافة التدابير لحماية مصادر المياه من التلوث بالنفايات الصلبة والسائلة.
 ١١. ان لا يتجاوز العمق الكلي للبئر عن (٩٥) متر.
 ١٢. التخلص من المخلفات الصلبة في الموقع الذي تحدده الجهات المختصة وان تكون عملية التجميع والنقل والتخلص ضمن إجراءات دائرة البيئة / وزارة الشؤون البلدية والبيئة.
 ١٣. معالجة المخلفات الصلبة والسائلة الناتجة عن الاستعمالات البشرية بما لا يترك أثر على البيئة.
 ١٤. الالتزام بشروط وزارة الشؤون البلدية والبيئة والبيئة والصحة والسلامة العامة.
 ١٥. تعتبر هذه الرخصة ملغاة حكماً في حالة مخالفة أي شرط من شروط الرخصة.
 ١٦. تُلغى الرخصة تلقائياً في حال عدم إقامة المشروع او اغلاقه لأي سبب ويخلق البئر او يردم ما تم انجازه من العمل قية خلال عام من تاريخه.
 ١٧. لتقيد كفاية بنكية بقيمة (١٠٠٠٠) دينار للإلتزام بشروط الرخصة.
 ١٨. ردم البئر القديم تحت اشراف السلطة قبل المباشرة بعملية حفر البئر الجديد .
 ١٩. لحضور الشركة المنفذة لتقيدهم تعهد خطي للإلتزام بشروط الرخصة .
 ٢٠. ان تتم عملية حفر البئر تحت اشراف السلطة .
 ٢١. الحصول على رخصة استخراج عند الانتهاء من حفر البئر.
- اطلعت على الشروط لاعلام والتزم بتنفيذها
- صاحب العلاقة

Appendix Q

Projects Cut/Fill Balance Document

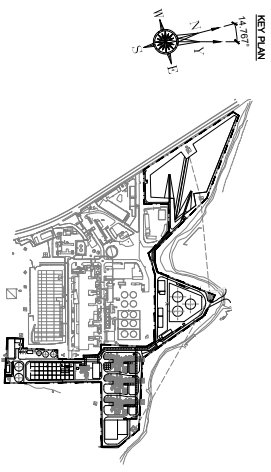

NOTES

1. RELATIVE LEVEL +1000.00 IS ACCORDING TO ABSOLUTE LEVEL OF 5XX.XX m ABOVE M.S.L.
2. X= 0.000 m Y= 0.000 m LOCAL COORDINATES CENTER CORRESPONDS TO E= 26540.000 m N= 16940.000 m IN CASIN.
3. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE NOTED.
4. ALL LEVELS AND COORDINATES ARE IN METERS, UNLESS OTHERWISE NOTED.
5. REFER TO THE SITE EARTHWORKS TECHNICAL SPECIFICATION (AP201-00-U-CDM-IDM-1030) TO SEE THE CHARACTERISTICS OF THE FILL MATERIAL AND THE EXCAVATION REQUIREMENTS.
6. BASED ON THE SOIL SURVEY REPORT AND ON THE TOP LAYERS TOP SOIL AND SILTY CLAY LAYERS) ARE CLASSIFIED AS M AND A. THE THICKNESS OF THESE UNSATURABLE LAYERS IS REMOVED EVERYWHERE. NEVERTHELESS, ON THESE AREAS CLOSE TO BOROHOLES NH16, NH12, NH18, NH20 AND NH21, THE THICKNESS OF THE UNSATURABLE LAYERS IS BETWEEN 1.5 m AND 5 m APPROXIMATELY FROM THE FINAL GROUND LEVEL, THEREFORE ON THESE AREAS ADDITIONAL EXCAVATION WILL BE REQUIRED TO COMPLETELY REMOVE THE TOP SOIL AND SILTY CLAY LAYERS.

LEGEND

- SITE BOUNDARY
EXCAVATION
FILL

REFERENCES


1. FOR GENERAL ARRANGEMENT PLOT PLAN SEE DWG. AP201-00-Y-CDM-IDM-10015


ACWA Power Zarga CCGT Project



OWNER		OWNER'S ENGINEER	
EPC CONTRACTOR		DESIGNER	
PROJECT		DRAWING NAME	
DRAWING NUMBER		SHEET	
AP201-00-U-CDM-IDM-1030		1	
NEXT		2	
DRAWING SCALE		SITE EARTHWORKS	
A1 1:2000		PLAN VIEW	
DATE		FIRST ISSUE	
REVISION		INGANG	
DRAWING APPROVAL		AMH	
DRAWING APPROVAL		ACB	
DRAWING APPROVAL		CHECKED	
DRAWING APPROVAL		APPROVED	
DRAWING APPROVAL		IDOM	

EARTHWORKS BOQ			
PLATFORM LEVEL (m)	TOP SOIL EXCAVATION (m)	EXCAVATION (m)	FILL (m)
EVAPORATION POND AREA (+42.00)	4555	187025	-
LUG AREA (+44.00)	94100	93650	179265
PLASTER LOCK AREA (+45.00)			
WTF & ADMINISTRATION AREA (+105.00)			

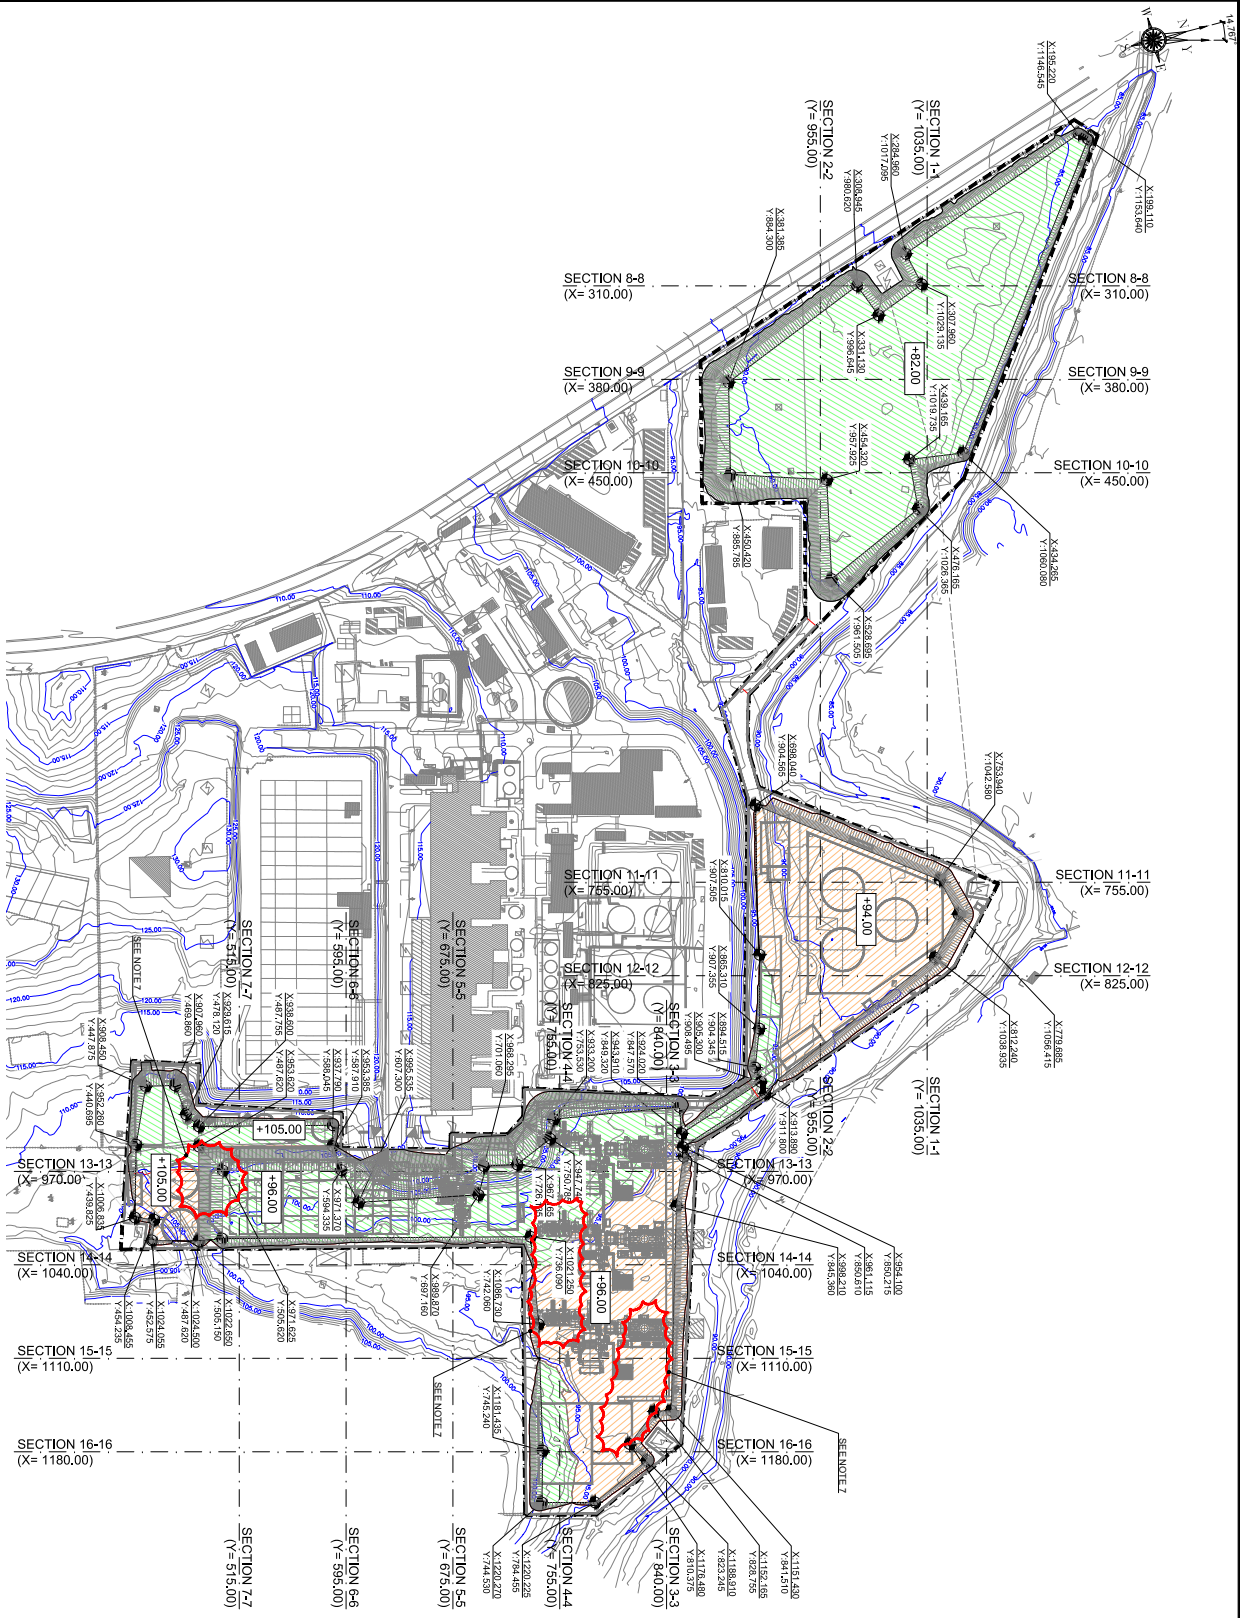

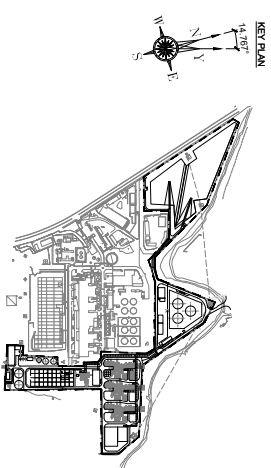

NOTES


1. RELATIVE LEVEL +1000.00 IS ACCORDING TO ABSOLUTE LEVEL OF 5XXX.XX m ABOVE M.S.L.
2. X=0.0000 m Y=0.0000 LOCAL COORDINATES CENTER CORRESPONDS TO E=265400.000 m N=168400.000 m IN GASSINI.
3. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE NOTED.
4. ALL LEVELS AND COORDINATES ARE IN METERS, UNLESS OTHERWISE NOTED.
5. REFER TO THE SITE EARTHWORKS TECHNICAL SPECIFICATION (AP201-00-U) TO SEE THE CHARACTERISTICS OF THE FILL MATERIAL AND THE EXECUTION REQUIREMENTS.

- LEGEND:
- SITE BOUNDARY
 - EXCAVATION
 - FILL
 - EXISTING SOIL LEVEL
 - NEW SOIL LEVEL
 - TOP SOIL EXCAVATION (1 m)

REFERENCES DRAWINGS

1. FOR GENERAL ARRANGEMENT PLOT PLAN SEE DWG. AP201-00-Y_—GDW-IDM-0015.

OWNER		OWNER'S ENGINEER		EPC CONTRACTOR		DESIGNER		PROJECT	
								ACWA Power Zarga CCGT Project	
DRAWING NUMBER: AP201-00-U_—CDW-IDM-1030		SHEET: 2		DRAWING NAME: SITE EARTHWORKS SECTIONS I		NEXT: 3			

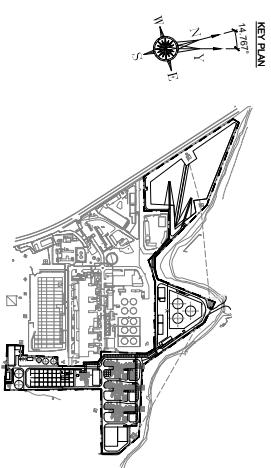

NOTES:

1. RELATIVE LEVEL +1000.00 IS ACCORDING TO ABSOLUTE LEVEL OF +XX.XX m ABOVE M.S.L.
2. X=0.000 m Y=0.000 m LOCAL COORDINATES CENTER CORRESPONDS TO E-28540.000 m N-16940.000 m IN CASSINI.
3. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE NOTED.
4. ALL ELEVATIONS COORDINATES ARE IN METERS, UNLESS OTHERWISE NOTED.
5. THE SITE EARTHWORKS TECHNICAL SPECIFICATION (A201-00-U) SHALL BE REFERRED TO FOR THE CHARACTERISTICS OF THE FILL MATERIAL AND THE EXECUTION REQUIREMENTS.

LEGEND:

- SITE BOUNDARY
- EXCAVATION
- FILL
- EXISTING SOIL LEVEL
- NEW SOIL LEVEL
- TOP SOIL EXCAVATION (1 m)

REFERENCES DRAWINGS:

1. FOR GENERAL ARRANGEMENT PLOT PLAN SEE DWG. A/P201-00-Y-000-1DM-0015.

OWNER:



OWNER'S ENGINEER:



ERC CONTRACTOR:



DESIGNER:









PROJECT:


ACWA Power Zarga CCGT Project

SIZE	SCALE	A	00-05-16	FIRST ISSUE	INGOING	AMH	ACB
A1	V 1:250	REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED
H 1:1000	REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED	







DESIGNER	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED
idam	00-05-16	FIRST ISSUE	INGOING	AMH	ACB

DRAWING NUMBER	SHEET	DRAWING NAME	SITE EARTHWORKS
A/P201-00-U-CDM-1DM-1030	3		
	NEXT		SECTIONS II

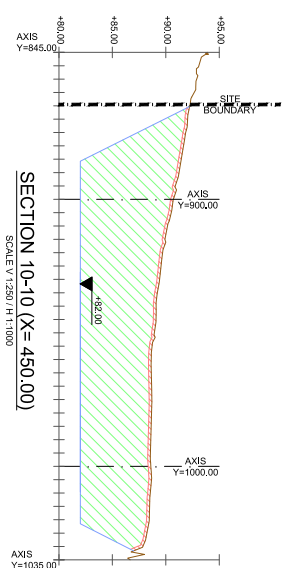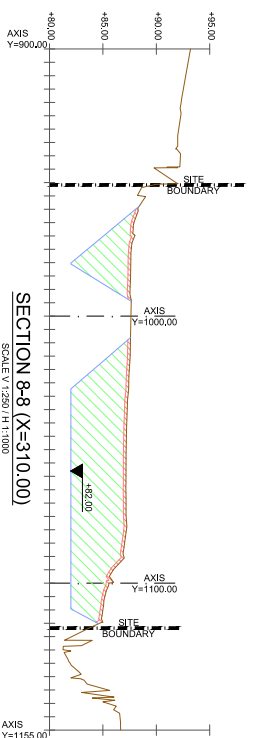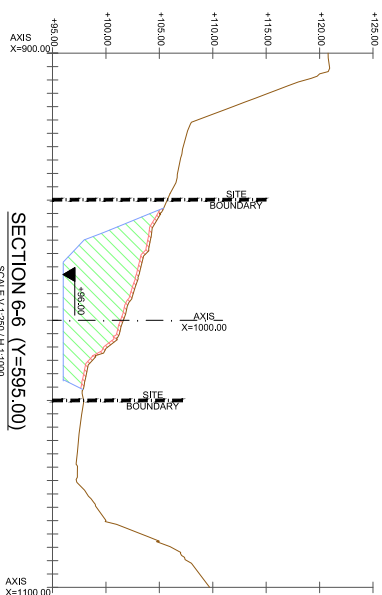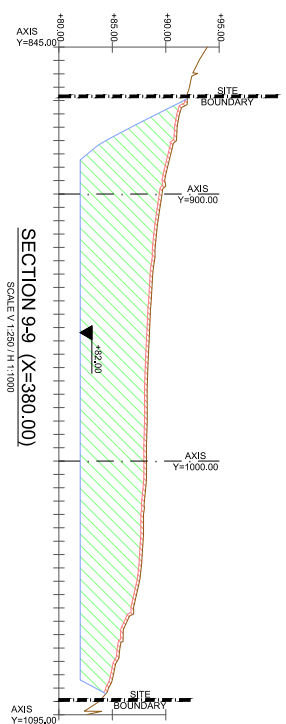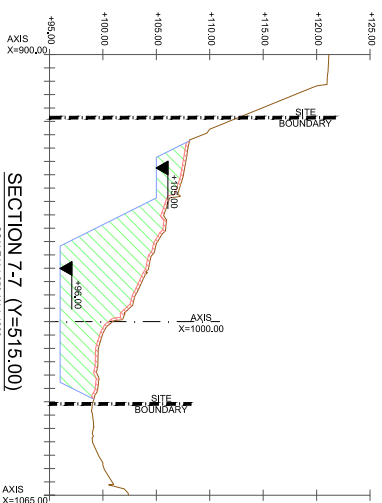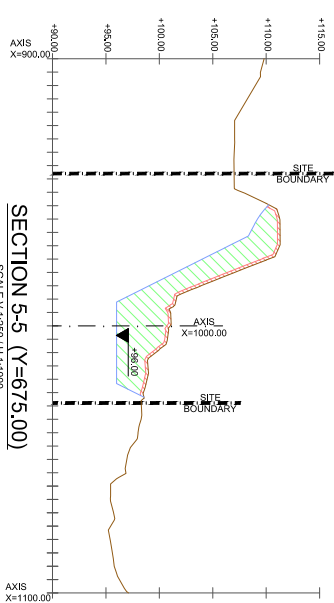

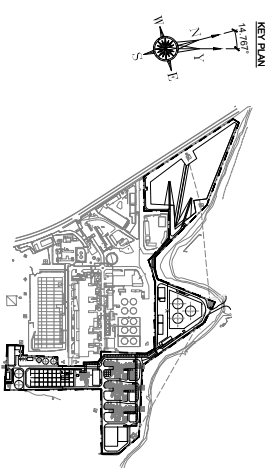

- NOTES:
1. RELATIVE LEVEL +1000.00 IS ACCORDING TO ABSOLUTE LEVEL OF XXXXX m ABOVE M.S.L.
 2. X= 0.000 m Y= 0.000 m LOCAL COORDINATES CENTER CORRESPONDS TO E-28540.000 m N- 168400.00 m IN CASSINI.
 3. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE NOTED.
 4. ALL ELEVATIONS AND COORDINATES ARE IN METERS, UNLESS OTHERWISE NOTED.
 5. THE DESIGNER HAS CONDUCTED VISUAL INSPECTION OF THE SITE AND HAS FOUND IT TO BE SUITABLE FOR THE PROPOSED DEVELOPMENT.
 6. REFER TO THE SITE EARTHWORKS TECHNICAL SPECIFICATION (A2201-00) TO SEE THE CHARACTERISTICS OF THE FILL MATERIAL AND THE EXECUTION REQUIREMENTS.

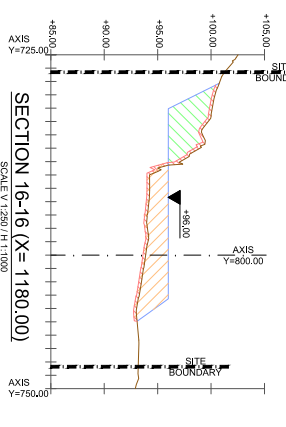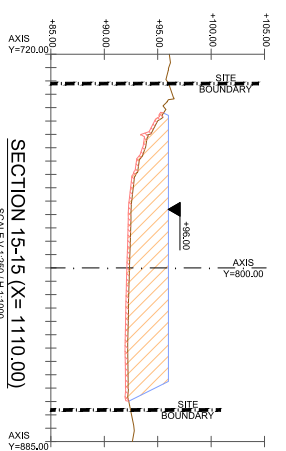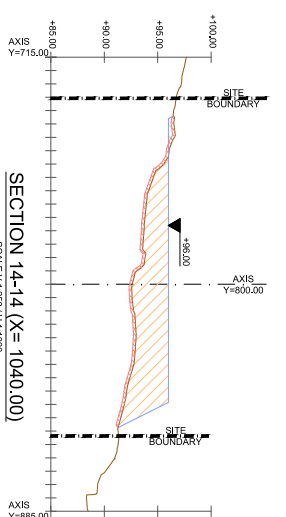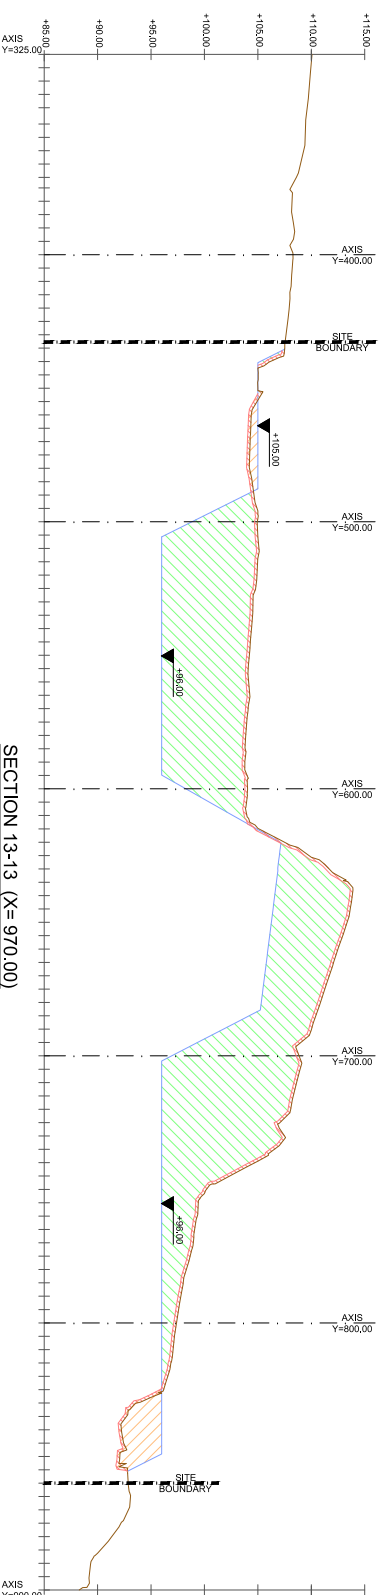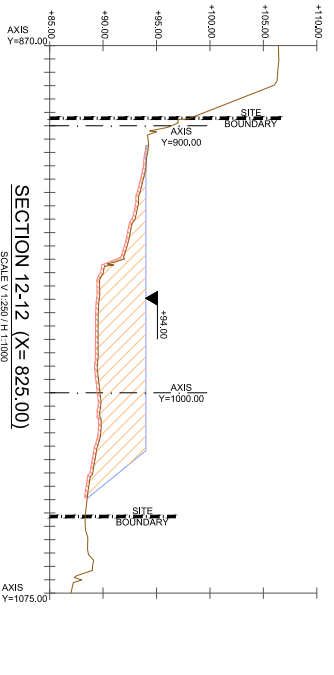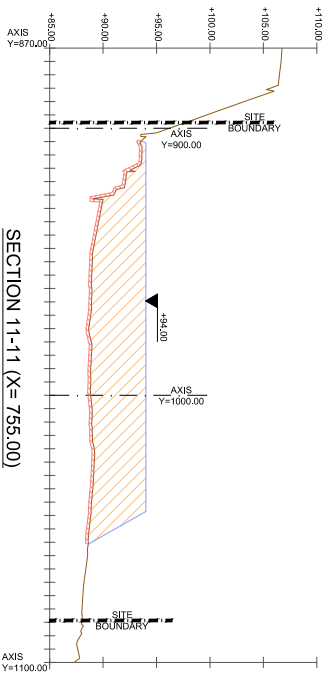

- LEGEND:
- SITE BOUNDARY
 - EXCAVATION
 - FILL
 - EXISTING SOIL LEVEL
 - NEW SOIL LEVEL
 - TOP SOIL EXCAVATION (1 m)

REFERENCES DRAWINGS:

1. FOR GENERAL ARRANGEMENT PLOT PLAN SEE DWG. AP201-00-Y...-GDW-IDM-0015.

OWNER:

ACWA POWER

DESIGNER:

idam

PROJECT:

ACWA Power Zarga CCGT Project

SIZE	SCALE	A	00-05-16	FIRST ISSUE	INGANG	AMH	ACB
A1	V 1:250	REV	H 1:1000	DATE	DESIGNED	CHECKED	APPROVED
DESIGNER	DATE	APPROVED	DATE	APPROVED	DATE	APPROVED	DATE
AP201-00-U...-CDW-IDM-1030	SHEET	4	4	SITE EARTHWORKS	SECTIONS III		

Appendix R

EPC Camp Land Lease Agreement

Leasing Contract

Contract No.

FIRST PARTY:

Mr. Jamal Ibrahim Faneek
Mr. Maher Ibrahim Faneek

Hereinafter referred to as the Lessor

SECOND PARTY

Sepco III Electric Power Construction Corp.

Hereinafter referred to as the Lessee

Preamble

Whereas the first party (Lessor) owns the land number 349 parcel 18 Alwadi Alkarbi situated in Al-hashemiah - Zarqa, the land size is around 16,175 square meters referred to here under as the premises and whereas the first party has agreed to rent the whole land to the second party.

Therefore both parties had agreed upon the following terms and conditions:

1. The above preamble is an integral part of the contract.
2. Period of the contract, one year starting May 6, 2016, till May 6, 2017.
3. Both Parties agreed that if the second party wishes to renew the contract for another period of 6 months, it will be done without the objection of the first party or who owns this land without any change on the rent value.
4. The amount of rent is JD 14,494. (Fourteen Thousands Four Hundred and Ninety Four Jordanian Dinars) to be paid in advance at the beginning of the rental period
5. The lessee has the right to use the leased premises for the purpose of his benefits and will return it upon the expiry of the lease in its condition with the changes rise.
6. The whole amount of rent to be paid in one payment.
7. In case of disputes, the governing laws of Jordan shall prevail and the courts of Amman shall be the sole authority of jurisdiction over such dispute.

8. The contract has been arranged into two copies and signed by both parties after being studied and read.
9. The contract consist of preamble and 9 clauses including this clause.

This contract is made on 5/...../2016.

First Party (Lessor)

Maher I. Fouad

Second Party (Lessee)

[Signature]

[Signature]
Amal Ibrahim Fouad

Appendix S

Projects Permits Required

List of required permits\Authorisations

No.	PERMITS / AUTHORISATIONS	ISSUING AUTHORITY	Owner	EPC
1.	Registration of the Project Company	Ministry of Industry and Trade		
2.	Generation License	Electric sector Regulatory Commission		
3.	EIA Approval	Ministry of Environment		
4.	Import registration or import permit to import into Jordan all plant, machinery, equipment, spare parts, materials and supplies required for construction, completion and operation of the Facility	Investment Promotion Committee, Ministry of Industry and Trade		
5.	Permission to export and re-import plant machinery for purposes of repair and refurbishment in accordance with Article of the Implementation Agreement.	Investment Promotion Committee, Ministry of Industry and Trade		
6.	No objection certificate to obtain export permit to export the imported equipment not forming the permanent part of the Facility.	Investment Promotion Committee, Ministry of Industry and Trade		
7.	Approval of lists of fixed assets (machinery, equipment, spare parts, materials, supplies etc.) to be imported by the Project Company and its Contractors for construction, completion and operation of the Facility for purposes of customs exemptions	Investment Promotion Committee		
8.	Approval of exemption from university fees and stamp duties as expressly	Council of Ministers		

No.	PERMITS / AUTHORISATIONS	ISSUING AUTHORITY	Owner	EPC
	provided in Article of the Implementation Agreement.			
9.	Statutory notifications granting exemption from Sales Tax on the importation of plant and equipment for incorporation into the Facility and the temporary importation of erection materials, machinery and equipment (subject to re-export), and services as expressly provided in Article and of the Implementation Agreement	Council of Ministers		
10.	Government Authorizations	Relevant Authority		
11.	Statutory notification that the Lenders will be exempted from taxation on their income in Jordan, as expressly provided in Article of the Implementation Agreement	Council of Ministers		
12.	Statutory notifications granting exemption from Sales Tax on the importation of Spare Parts for incorporation into the Facility, as expressly provided in Article of the Implementation Agreement	Council of Ministers		
13.	Statutory Notification to ISTD of the exemption from Income Tax for the first 10 years, as expressly provided in Article of the Implementation Agreement	Council of Ministers		
14.	Permission for the appointment of non-Jordanian Construction Contractor and O&M Contractor	Council of Ministers , Construction Contractors Association		

No.	PERMITS / AUTHORISATIONS	ISSUING AUTHORITY	Owner	EPC
15.	Approval of the Facility as satisfying the fire safety and protection standards under the Fire Service Act	Civil Defense Department		
16.	Permission for storage of Sulphuric acid, Caustic (NaOH) and Hydro Chloric acid at site.	Civil Defense Department		
17.	Work permits and national security clearance for expatriate employees of Project Company and the Construction and O&M Contractor(s)	Ministry of Labor		
18.	Easement or lease agreement and approval for construction of Access Road.	Ministry of Public Works		
19.	No Objection Certificate to build exhaust stacks and bypass stacks at the site as part of the plant.	Civil Aviation Authority		
20.	Professional License	Municipality of Great Amman		
21.	Registration with Chamber of Industry	Chamber of Industry		
22.	Registration for business	Ministry of Trade and Industry		
23.	Registration for construction license	Ministry of Public Works and Housing		
24.	Registration for construction activities	Jordan Construction Contractors Association		
25.	Registration for Engineering Activities	Jordan Engineers Association		
26.	Excavation Material Disposal	Municipality		

No.	PERMITS / AUTHORISATIONS	ISSUING AUTHORITY	Owner	EPC
27.	Wireless & Walkie-Talkie	Telecom Authority		
28.	Temporary Office Permit	Municipality		
29.	Construction Permit	Municipality		
30.	Signboard Permit	Municipality		
31.	Labor Clearance	Ministry of Interior/Ministry of Labor		
32.	Site Camp Approval	Municipality		
33.	Approval to import the Project material without test	Jordan Institute for Standards and Metrology		
34.	Advance approval to import the Project firefighting material without test	Civil Defence Department		
35.	Approval for transportation of heavy equipment inside Jordan	Ministry of Public Works and Housing		
36.	Registered the company in the ministry of industry and trade			
37.	Chamber of Industry registration license (Zaqaar)			
38.	Certificate of Jordanian construction contractors association			
39.	Professions of the municipal license			
40.	Agency mandate on behalf of the director (authorization)			
41.	The general budget of the company			
42.	Permit of Road layout and construction			
43.	Permit of Fire fighting system pipes connection			

No.	PERMITS / AUTHORISATIONS	ISSUING AUTHORITY	Owner	EPC
44.	Permit of Night work			
45.	Permit of Interphone using			
46.	Permit from Worker ministry			

Appendix T

SEPCO III Security Risk Assessment and Security Plan

Risk Assessment										
Description of the task: Security Arrangements.				Assessed By :SEPCOIII		Assessment number : APZ/RA/Security Arrangements/S003				
Location: APZ Project				Date: 23.06.2016		Review Date:				
No.	Hazard	How might harm be caused	Persons at Risk	Existing control measures	Risk Rating			Proposed corrective measures if any	Risk Level	Residual Risk level
					S	L	R		L/M/H/VH	Yes /No
1	Unauthorized Entry/ trespassers /Peer group formation/ Threats	Bullying to employees/ Crime/damages of facilities and equipment/ damage of communication utilities.	Security guards/ Employees / Project Managemen t team / Visitors/ Suppliers	<ul style="list-style-type: none">Physical protection measures such as fences, barriers, lights, CCTV surveillance shall be provided to completely avoid the tress passing.Training/ Screening shall be done for all the personnel before entering inside the premises and provided the identity badges.Warehouse and storage areas are designated as restricted and only authorized personnel will be allowed entrance. These areas are fenced and will be secured during non-working hours.Exterior protective lighting shall be employed to serve as a deterrent to intrusion and to assist in the detection of intruders.Manned guard posts which operate during periods of darkness sufficient to allow for the inspection of personnel and vehicles.Lighting controls, including on/off switches, shall be installed within protected areas or shall be capable of being locked against tampering.Contract security officers shall be licensed/certified/registered as required by local, state, federal, or province law or regulation.Contractor security officers shall complete initial and refresher training programs to ensure their competency.	4	1	4	<ul style="list-style-type: none">Security procedures shall be put in place and to be followed.Effective monitoring facilities shall be in place such as management oversight of operationsChecking of performance of the security management system effectiveness of those who supervising the execution.Keeping senior management / Project teams appraised of progress / Challenges.	L	Yes

			<ul style="list-style-type: none"> • Internal and external investigations shall be conducted in accordance with Company security policies and the appropriate civil and criminal statutes. • Sensitive information and records shall be managed, classified, and safeguarded in accordance with the Company Records Management program and applicable local, state and federal laws. • Company information and records, whether written, electronic, or oral, shall be classified as either "Unrestricted", "Restricted", "Confidential", or "Most Confidential". The responsibility for classifying and marking information is that of the originator and/or appropriate manager. • Where lockers or storage containers are provided by the company for personal use by employees or contractors, they shall be fitted with an appropriate locking device, and shall be locked at all times when not attended by their assigned user. • The proper communication channel must be implemented, how to act for emergency including with state intelligence, Rescue and Police dept. for the Emergency assistance. • All correct back up and reinforcement strategies are established and tested. • The security system shall be effectively communicated to those with responsibility for its execution. • Security registers shall be provided to record the details of the entrants. • All the control mechanisms are established such as gates, Badges checking, PPE's checking, Checking for unauthorized carrying of weapons, drugs etc. 					
--	--	--	---	--	--	--	--	--

				<ul style="list-style-type: none">Intelligence networking shall be adopted such as Local social/ Political leaders/Intelligence providers/ Local police etc.Adequate unauthorized entry control resources such as Security personnel, equipment's shall be established.Adequate communication system shall be established for the adequate communications.						
2	Unauthorized vehicles entry/ Equipment entry/ Defective equipment operation	Traffic accidents, Failure of the equipment or machinery/ Unauthorized operation.	Security guards/ Employees / Project Managemen t team / Visitors/ Suppliers	<ul style="list-style-type: none">Establish the Physical protection measures such as gates, fences, barriers to prevent the unauthorized entry.Specific equipment/ Vehicle inspection shall be carried out by the authorized authority to ensure the reasonable entry inside the plant premises.Issuance of vehicle/ equipment badges to identify the authorized entry.Vehicles and Equipment shall be checked while enter and exit to prevent the taking in of unauthorized materials such as weapons, hazardous chemicals, drugs etc. and stealing of plant properties.Entry and exit register log shall be maintained to record the information.	4	1	4	<ul style="list-style-type: none">Security procedures shall be put in place and to be followed.Effective monitoring facilities shall be in place such as management oversight of operationsChecking of performance of the security management system effectiveness of those who supervising the execution.Keeping senior management / Project teams appraised of progress / Challenges.	L	Yes
3	Terrorist Attacks / Strikes / Violence	Fire explosion, Firing, Armed Weapons attacks, Bomb	Security guards/ Employees / Project	<ul style="list-style-type: none">The facility of the Site security and safety system from the terrorist attacks / Strikes / Communal violence etc...Shall comply with all applicable local and state laws and government regulations.	4	1	4	<ul style="list-style-type: none">Security procedures shall be put in place and to be followed.Effective monitoring	L	Yes

	attacks, Atomic weapons etc.	Management team / Visitors/ Suppliers/ Publics	<ul style="list-style-type: none">• Identify security concerns and criteria and ensure Safeguards, Where permitted by law, persons employed by, or on behalf of, the Company shall be subject to a satisfactory background investigation prior to hire or assignment.• The access gate of site facility will be staffed by licensed security guards and they will control the access in accordance with the procedure, the parking/ movement of vehicles within the perimeter of Site area is controlled by the security guards.• The possession of weapons, including firearms, is prohibited on Company premises.• The Project site access main gate is staffed by a team of Security personnel consisting Security Officer/guards for 24 hours on shift basis. This team controls the entry of vehicle/ material/ equipment/ visitors.• All personnel, including employees, contractors, vendors, and visitors, shall be required to enter through designated and/or controlled access points with proper identification of approved company photo- identity cards.• All Project employee vehicles, brief cases, bags, tools, etc. are subject to search by Project Security Services Officers at any time at the gates or on site.• In compliance with Project management requirements, vehicles entering the Project construction site through the construction gate will require an Authorized Vehicle Pass (Sticker) issued by the Project Safety and Security In charge.• The security personnel will be provided with mobile phone for effective communication.• A security team will patrol all the sites on regular		<p>facilities shall be in place such as management oversight of operations</p> <ul style="list-style-type: none">• Checking of performance of the security management system effectiveness of those who supervising the execution.• Keeping senior management / Project teams appraised of progress / Challenges.	

			<p>basis and will ensure the implementation of the security measures. Random check shall be conducted frequently in the project site to trace out unauthorized people/ vehicle, if any others.</p> <ul style="list-style-type: none"> • Identification of restricted areas, and address the level of protection required for each. Restricted areas are defined as those areas for which extra security precautions are required, and which, through the commission of a criminal or terrorist act, may (1) threaten the safety of individuals, (2) cause a severe adverse impact on operations, environment, or the community, (3) result in major economic losses to the Company, and/or (4) adversely affect the Company's reputation. • Company facilities, main offices, including buildings, Structures, lay down yards and all over the other premises, shall be protected against intrusion by a perimeter fence or other physical barrier of equal or greater protection. • Facilities shall display security signage designed to control traffic, deter criminal activity, and provide emergency contact information to the public. Signage shall be posted in accordance with local, state, federal or province laws/regulations and shall be in Arabic, English and other languages as required. • NO TRESPASSING: signs shall be posted on the perimeter fence and gates so as to be readily visible from any approach In the absence of ordinance mandated language with English Hindi and Tamil (No Trespassing - Violators shall Be Prosecuted" or words to that effect.) • PROHIBITED SUBSTANCE: signs shall be posted at all routinely used entrances such as the restricted to 					
--	--	--	--	--	--	--	--	--

			carrying the weapons, chemicals and the other items which may harm to personnel's / Equipment's and Environment. • CONCEALED WEAPONS: signs prohibiting the carrying of such shall be posted on all routinely used entrances where local ordinances or state/province laws require such signage as a condition of enforcement. • EMERGENCY CONTACT: signs shall be posted on all routinely used gates and entrances, including the site premises. Signs shall be readily visible to the public and shall display the Company name and emergency contact number. •				<ul style="list-style-type: none">• Security procedures shall be put in place and to be followed.• Effective monitoring facilities shall be in place such as management oversight of operations• Checking of performance of the security management system effectiveness of those who supervising the execution.• Keeping senior management / Project teams		
4	Unauthorized entry inside the commissioned/ operation areas	Unauthorized operation, Damage of equipment/ properties/ incorrect operation, stealing.	Security guards/ Employees / Project Managemen t team / Visitors/ Suppliers/ Publics <ul style="list-style-type: none">• Security guards shall be deployed to control the unauthorized entry.• The commissioning and trial running area shall be cordoned off and declare as the exclusion zone.• Display the caution/ warning signs to alert or create awareness about the hazards in commission and operation areas.• The security personnel shall be well trained about the hazards and precautions.• Entry to the operation areas shall be controlled by permit to work system.	4	1	4	<ul style="list-style-type: none">• Checking of performance of the security management system effectiveness of those who supervising the execution.• Keeping senior management / Project teams	L	yes

ENGINEER'S STAMP:					CONTRACTOR'S STAMP:		
					Signature		
FOR APPROVAL							
B0	Issue for Approval						
A0	Issue for Approval		/	/			
REV	DESCRIPTION	PREPARED	CHECKED	CHECKED	CHECKED	APPROVED	DATE
			ACWA POWER				
			SEPCO III ELECTRIC POWER CONSTRUCTION CORPORATION				
PROJECT: APZ LOCATION: Zarqa – Jordan PACKAGE: Total Plant			TITLE: Security Procedure				
			DOCUMENT No.: SEPCOIII-AM002-SE-202-00-A0				REV:A1
SUBCONTRACTOR:							

Contents

1. INTRODUCTION	4
1.1 Purpose	4
2. SCOPE	4
3. REFERENCE	4
4. RESPONSIBILITIES	4
4.1 CONTRACTOR. SEPCO III.....	4
4.1.1 HSE manager.....	4
4.1.2 HSE Supervisors	5
4.1.3 Animators.....	5
4.1.4 Access Control Leader	5
4.1.5 Security guards	6
4.1.6 Personnel present on site	7
5. SITE ACCESS	9
5.1 Access to site through the outer gate (ACWA – MASEN).....	9
5.2 Access to the site through the APZ	10
5.2.1 Employees.....	10
5.2.2 Vehicles.....	11
5.2.3 Machinery	13
5.2.4 Visits.....	14
5.2.5 Suppliers	14
5.2.6 Maintenance companies	16
6. CONSTRUCTION SITE ID BADGE	16
6.1 Requirements for obtaining site ID badges	16
6.2 Site Identification Badge Costs.....	16
6.3 Obligations and rights.....	16
7. DATA CONTROL OPERATIONS.....	17
7.1 Worker access	17
7.2 Vehicle access.....	17
7.3 Work permits outside of working hours	17
8. ENTRY AND EXIT OF MATERIALS, EQUIPMENT AND TOOLS.....	18

8.1 General rule.	18
8.2 Entry.....	18
8.3 Exit.....	18
9. BOOTHS AND STORAGE AREAS	18
10. SECURITY INCIDENT REPORTS.....	18
11. FIREARMS AND OTHER ARMS	18
12. ALCOHOL, DRUGS AND TOBACCO	19
13. CONFIDENTIAL INFORMATION	19

1. INTRODUCTION

1.1 Purpose

The purpose of this document is to define the conditions and required processes for granting authorization and access to ACWA Power Zarqa Project Construction site.

SEPCO III workers and companies and any of its subcontractors, clients as well as representatives (i.e. all companies wanting to enter the site) must comply with this procedure.

2. SCOPE

The scope of this procedure is company-wide and affects workers and work teams (ancillary means, machinery, etc.) requiring access to the ACWA Power Zarqa Construction site.

Subcontractor's staff and facilities services all visitors must be accompanied by staff notice 24 hours and forbidden to take pictures.

3. REFERENCE

3.1 ACWA POWER ZARQA HSEMP

3.2 OSHA Standard/ <https://www.osha.gov/>

4. RESPONSIBILITIES

4.1 CONTRACTOR. SEPCO III

The contractor is responsible for overall security related activities by ensuring that plans and procedures are transmitted to all personnel accessing the site and that all of the resources that are necessary for their execution are available.

The SEPCO III contractor along with the human and materials means available to him (both own and external) assumes contractually and before ACWA power the commitment to execute all of the works as per the project specifications and will appoint the Head of Safety who will manage all occupational safety and personal safety related activities.

4.1.1 HSE manager.

The Head of Safety is responsible for: Applying this procedure.

Health and Safety Department personnel.

Having available the necessary resources to implement the procedure and manage HSE activities during the daily execution of construction and commissioning operations.

Receiving daily HSE reports. Conducting appropriate analyses in accordance with foreseen safety/security risks. Informing

Managing the activities that must be conducted by security guards in relation to site security.

Managing the activities that must be conducted by security team to assure of only authorized personnel go into the site.

Liaising with ACWA power on all aspects pertaining to Health and Safety and Security.

Generating reports that may be required by the Site Manager or any other authorized person.

4.1.2 HSE Supervisors

Conduct HSE Induction for newly mobilized/hired employees and conduct/assist in training of employees at all levels.

Keep records of HSE meetings, inspections, safety violations, trainings and other relevant field HSE documentations.

Assure that the person at site has the ID badge and they are in the correct area that they are allowed to work.

4.1.3 Animators

Assist to the HSE supervisors in the correct apply of HSE rules, informing about any safety or environment problem they detect at site.

4.1.4 Access Control Leader

The Head of Safety will appoint an Access Control Leader.

He/she will have the obligation to inform the Head of Safety and Site Manager immediately in the event of any incident.

His/her functions are:

Reviewing the documentation sent by companies and authorizing companies, workers and equipment requiring access to the site.

Managing all security related functions according to this procedure.

Administering company, worker and equipment documents and files that may have been required for approving their access to the site.

Maintaining all security standards and procedures in accordance with security management policies.

Checking visitor as well as loading and unloading and maintenance reports or other documentation supplied by subcontractor companies.

Keeping an updated log of companies, workers, equipment, etc. that can access the site.

Verifying compliance with security and other associated procedures.

Providing periodic reports on construction site security matters to the Head of Security.

Reviewing documentation required to working materials that require access to the site.

Verifying that security guards fulfil their duties and that all workers are provided of the necessary training prior to the commencement of work.

4.1.5 Security guards

Security guards will belong to a specialized company and must have the corresponding permits to perform their duties. Said guards shall have knowledge and experience in similar positions at other construction sites.

The security guard team will receive specific training on project procedures and specific safety and security aspects in connection with the areas requiring surveillance.

Security guards will wear uniforms and will make use of their personal protective equipment when walking about the site.

Security guards will be responsible for:

Surveillance of site access ways, perimeter fencing, stored materials, etc.

In the case of theft, loss or vandalism at the construction site all available information must be sent to the Site Manager and the site's Head of Security.

Access control. Verifying that any person, vehicle, work equipment, etc. is authorized to access the site as defined in Annex 1 of this procedure.

Access log. Compiling and filing all necessary documents for obtaining access authorization for visitors, materials, maintenance personnel, etc.

Protecting and safeguarding the defined construction zone under their responsibility.

Conducting inspection rounds through the entire zone in order to identify any dangers, inspect the site's perimeter, access gates, etc.

Maintaining order and watching over compliance with established construction site rules.

Authorizing and controlling worker identification badges.

Managing site keys (temporary installations as well as site buildings).

Taking action in case of an emergency and bringing together all members of the emergency team.

Notifying the Site Manager and the Head of Security in the event of any anomalous situation at the construction site.

The Access Control Lead will be responsible for the control and verification of the documentation in coordination with the site's security guards. This process will be formalized by means of the corresponding access authorization log.

Security guards will conduct rounds of surveillance on site and even after the contractor's working hours and on holidays.

Security guards will conduct regularity checks on people and vehicles.

In case of suspected theft, security guards will notify the Site Manager and the Head of Security and will carry out special checks on people and vehicles.

Security guards will be the ones implementing this procedure for access control.

They may deny access/exit to any person or vehicle suspected of being involved in criminal activities and will be obliged to notify of this situations to the Access Control Leader and Head of Safety.

In case of an emergency or evacuation from site, both drill or real, security guards will be responsible for directing site traffic in order to ensure that access pathways remain free of obstacles and can facilitate the entry of ambulances and fire trucks, if necessary. They will close the access to prevent the entry of vehicles and people and will provide SEPCO III a record with the identification of the workers and visitors currently on site.

Communication with security guards

Security guards, the Head of Safety, Access Control Leader and the Site Manager must be notified by phone, walkie-talkie or any other means of communication.

4.1.6 Personnel present on site

Anyone authorized to enter the construction site is responsible for participating actively in the application of this procedure in order to ensure that a maximum level of security is attained.

Taking into account that any action by any person could have a negative impact on the safety of others, people present on site will be informed about any situation that could pose a danger to their own safety or that of others.

Every person present on site will be obliged to notify ACWA POWER -SEPCO III, either the Site Manager, Head of Safety, Supervisors, etc. of any anomaly that may lead to any risk for the safety of people.

They must also inform in the case of:

- Loss, theft or vandalism of both personal goods and company property.
- Suspicious situations.
- Threats to people.
- Any anomalous situation requiring prompt notification.
- All personal present at site will also have the following responsibilities:
- Facility and materials protection.
- Information protection (intellectual property and communications).
- Physical protection (personal).
- Vehicle safety.
- Restriction of objects that are forbidden on site.

If any person that is working with one company of the EPC leaves it voluntarily before finish his work in, will not can enter to other company for doing the same work while his owner company continues having same type of work.

The next flow diagram defines the process to follow for accessing at site for new companies, personal, vehicles and machinery, supplies and visitors:

No	Matters	Company/subcontractor	Access control leader	Security guard
01	New company	supply the required documentation and/or communication of company	<ul style="list-style-type: none"> ➤ Review documentation sent by companies and approve their legal status. ➤ Notify to Consortium HSE manager and the Client with ➤ information of new companies 	NA
02	Personal entry	Supply the required documentation of new workers 48 hours in advance to the arriving time to the Consortium.	<ul style="list-style-type: none"> ➤ Reviewing and approve documentation of workers. ➤ Send the access request to ACWA power for new workers before 24 hours. ➤ Ensure that all new workers pass the HSE induction before entry to site. Make a sticker for putting in the worker's helmet after pass the HSE induction ➤ Provide new workers with ID badge after pass the HSE induction.(the card is prepared exactly for the Project the worker is going to work: 	<ul style="list-style-type: none"> ➤ Verifying that any person is authorized to ➤ Access to site and had his ID access badge.
03	Vehicle and machinery entry	Supply the required documentation of new Vehicle and machinery before 48 hours to the Consortium.	<ul style="list-style-type: none"> ➤ Reviewing and approve documentation of Vehicle and ➤ Machinery. ➤ Send the access request to ACWA power for new Vehicle and machinery before 	<ul style="list-style-type: none"> ➤ Verifying that any machine and vehicle is authorized to access to site and had it access card and give instructions to park on the parking lot

			24 hours. ➤ Ensure that all new machinery pass the safety inspection check-list by Consortium HSE department before entry to site. ➤ Provide all new Vehicle	
04	Supply	All supplier must inform the consortium for the delivery arrival date and time 48 hours in advance, and submit the necessary documents in case of special delivery (hazardous material ...)	➤ Send the access request for delivery to ACWA power 24 hours before.	➤ Identify the supplier before the access control Guard. Notify the warehouse manager or subcontractor responsible about the arrival of the supplies, and the person responsible will then authorize entry and will indicate the Location where supplies must be unloaded.
05	Visitors	Visitors must request authorization to access the construction site (with reason for the visit and the person and company being visited) From the Consortium at least 48 Hours in advance.	➤ Send the Access request for visitor to ACWA Power before 24 hours.	➤ Visitor must head over to the access control point on the given date, identify themselves and notify the reason for the visit and the person and company being visited. ➤ Any visitor must be informed of the risks at site and in the case of needed to access to working areas must go through the safety induction training The security guard will contact said person or department; once notified, the security guard will issue a sheet

5. SITE ACCESS

People must go through two access control points in order to enter the site, an outer one, which is located on the access road.

5.1 Access to site through the outer gate (ACWA – MASEN)

All people and vehicle having to access the site, such as for example companies that must execute works, supply vehicles or people visiting APZ will need an authorization from SEPCO III. To this end, they must previously supply the required documentation and/or communication as indicated in this procedure.

Any person or vehicle authorized by SEPCO III is only authorized to access the APZ site within the ACWA site and therefore is not authorized to access the APZ project. SEPCO III will appoint a person who will be responsible for providing ACWA with all of the necessary information, via e-mail and 24 hours in advance, to allow access to the site for people and vehicles that have been authorized by SEPCO III.

When communicating with ACWA, those people or vehicles that are regularly authorized to access the construction site will be identified. Similarly, those who have been temporarily or permanently denied authorization to enter the site, either as a result of termination of employment, disciplinary reasons or any other reason will likewise be notified.

5.2 Access to the site through the APZ

5.2.1 Employees

All necessary documentation **MUST** be supplied with the required anticipation in order for workers to access the construction site.


Access to the facility will be authorized once the documentation has been supplied, reviewed and approved by the SEPCO III Access Control Leader.

Prior to commencing work at the site, all workers will attend a safety induction and will be given documentation describing the general risks present at the construction site. Upon its conclusion, workers must complete a short questionnaire in order to ensure proper understanding of the contents being imparted and to assess the level of assimilation of the safety concepts that were discussed. A log of all attendees will be maintained.

The access control (input and output) will be exclusively with a magnetic badge and anyone that don't have the magnetic badge must pass for the Office (on this case S office for taking the photo

New workers must take the photo at the same date that allowed to entrance of the plant and must wait at the security guard for the leader safety control access for allowing to entrance on site. If someone doesn't respect these rules the leader control access have the right to send a warning notice on first time and on second time even maybe be fired of the project definitely

The badge is strictly personal and if safety guard verify that someone are using the badge for another person the control access lead have the right to cancel the badge

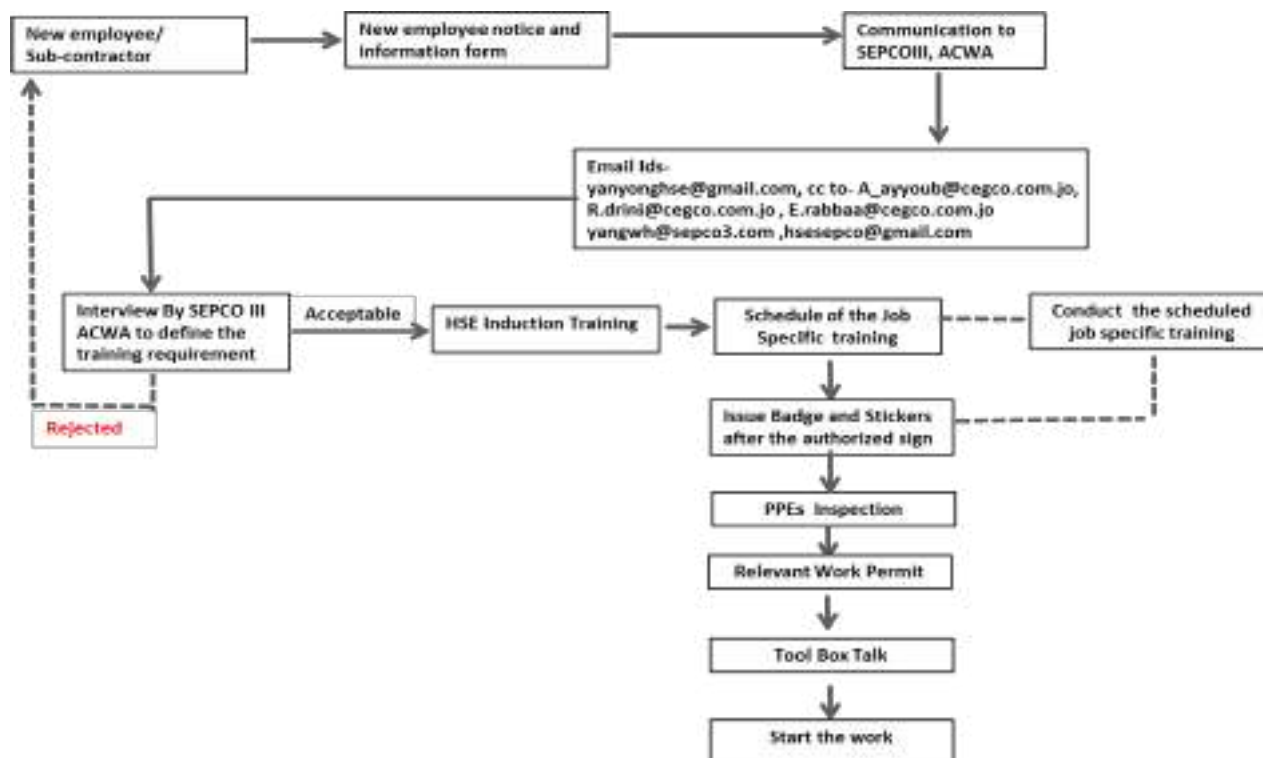

Flow chart for the process of making the employees badges

This badge shows the following information in a visible form:

Name	:	
Nationality	:	
Date of Birth	:	
Blood Group	:	
Company	:	
Position	:	
ID No:	:	
Serial Number	:	APZ/SEPCO III/S.....

The sample of the employee badge is a rectangular card. At the top, it features the SEPCO III logo and the text 'SEPCO III APZ Project'. Below this, there is a section for personal information with fields for Name, Nationality, Date of Birth, Blood Group, Company, Position, ID No, and Serial Number. The Serial Number is pre-filled with 'APZ/SEPCO III/S.....'. Below the personal information section, there is a 'SAFETY NOTICE' section with five icons: a hard hat, a safety vest, a safety helmet, a safety harness, and a safety sign. At the bottom, there is a section for 'Data Entered', 'Serial Number', 'HSE or Security Manager', and 'Signature', along with an 'Emergency' contact number and a date field.

Sample of the employee badge

5.2.2 Vehicles

Vehicles entering any of the zones will have restricted access. The SEPCO III Security will be responsible for deciding and issuing the entry permits to vehicles that, out of need, must enter the site. Vehicles entering the site MUST surrender the necessary documentation to the SEPCO III Security Lead at least 48 hours in advance in order to obtain access. Vehicles authorized to enter

the site will have an identification card that will show the vehicle's license plate number, the person responsible for it and the company to which it belongs. Vehicle access cards must be placed on the vehicle's windscreen permanently and be visible at all times.

Vehicles carrying several passengers will not be allowed to enter. Passengers must step out of the vehicle and proceed as instructed in the previous section regarding worker access. Security guards may stop and inspect vehicles randomly as necessary as a preventive measure in order to safeguard the goods of all subcontractors. Security guards may inspect authorized visitor vehicles both at entry and exit. In addition, all vehicles with regular access may be inspected and photographed both at entry and exit. Security guards will keep a daily list of all inspected vehicles.

Authorized vehicles shall observe all site traffic rules:

- Use of seatbelts.
- Maximum speed of 20km/h.
- Parking in dedicated areas prepared for this purpose, facing outward and with vehicle keys available at all times in areas other than offices.
- The use of mobile phones while driving is strictly prohibited.
- Observe the established direction of traffic.
- Respect temporary road traffic cuts.

This card will be removed in case of non-compliance with road rules and road signs.




Sample of Vehicle entry badge

5.2.3 Machinery

All required documentation of machinery entering the construction site MUST be supplied in order to obtain authorization. Subcontractor companies must previously provide SEPCO III's Safety Department with a list of all the machinery they wish to bring to the construction site as well as its associated/required documentation. Machinery that has been authorized to work on site must be inspected at least every three months in order to keep the authorization valid.

ACWA POWER Zarga Project	
EQUIPMENT ENTRY PASS	
Name of the equipment	
Company	
Equipment Serial No.	
Pass Number	APZ-SEPCOIII ----500----
Issued Date	
Valid Until	
Authorized Signature	

Sample of construction equipment / machinery entry badge

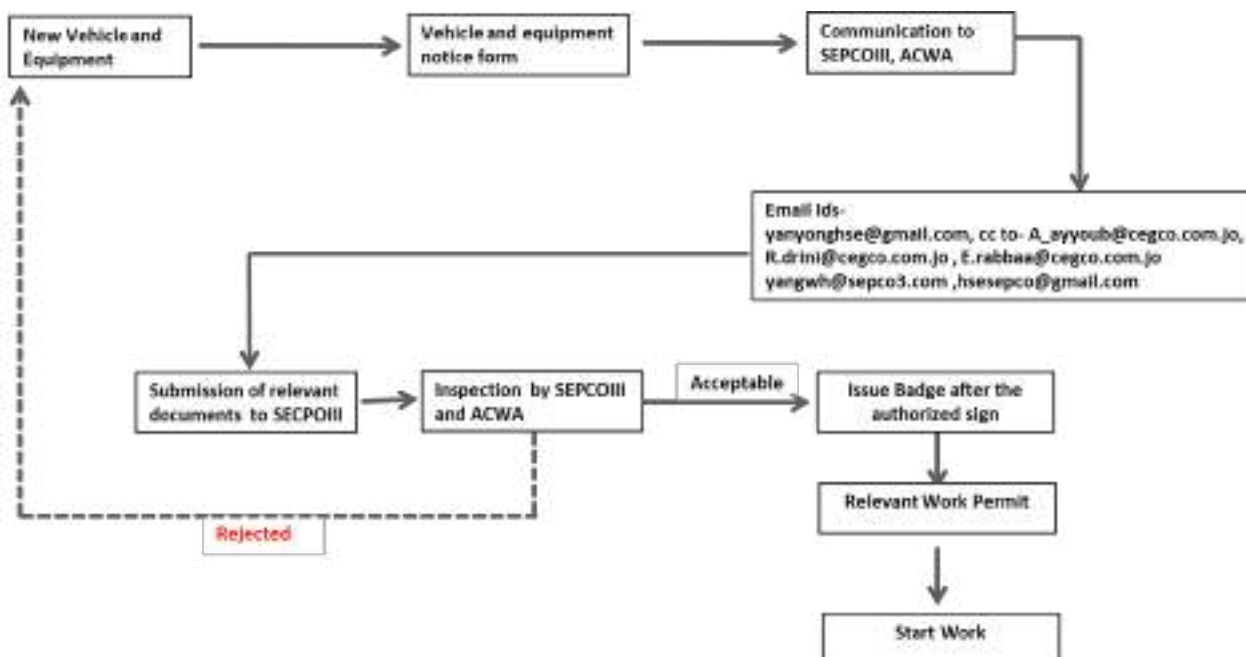

Flow chart for the process of making the Vehicle / Machinery

5.2.4 Visits

Visits for ACWA Power SEPCO III

All visitors wanting to access the construction site must attend a safety brief induction before access can be authorized. Furthermore, they must sign the access authorization and a document in which they are informed about the risks present at the construction site.

This process will work as follows:

- All visitors must request authorization to access the construction site at least 48 hours in advance.
- Once authorization has been obtained for a specific date or period, visitors will head over to the access control point and identify themselves on the given date and must inform on the person being visited and the purpose of the visit.
- The security guard will contact said person or department; once notified, the security guard will issue a sheet which must be signed by a person from SEPCO III at the beginning of the visit and returned at the exit at the access control point. This document will contain general information about site safety and a map of the site.
- In general, visitors will have restricted access to the construction site except those visitors who, due to the nature of their work, must inevitably access said zone. In this case, visitors must go through the safety induction training and will ALWAYS be escorted by the person being visited or otherwise by another person on whom this task may have been delegated. All safety rules must be complied with and compulsory PPE must be worn at all times.

Visits for subcontractor companies.

SEPCO III must authorize visits from subcontractor companies at least 48 hours in advance.

- Once an authorization has been obtained for a specific date or period, people must head over to the access control point on the given date, identify themselves and notify the reason for the visit and the person and company being visited. They must remain in the control checkpoint until entry has been authorized.
- The security guard will contact the person or company being visited.
- The person being visited will head over to the access control point and collect the completed report and will contact a person from SEPCO III with powers to authorize the entry to the site so that he/she may sign the authorization.

5.2.5 Suppliers

Regular supplies for SEPCO III

- The supplier will identify him/herself before the person responsible for access control.

- Access control personnel will notify the warehouse manager by phone about the arrival of the supplies.
- The person responsible will then authorize entry and will indicate the location where supplies must be unloaded. Personnel and vehicles in connection with regular supplies for SEPCO III are considered to be the same as an authorized subcontractor company.

Regular supplies for subcontractor companies

- As previous step, subcontractor companies must have turned in the documentation that may be considered necessary for accessing the site.
- The supplier will identify him/herself before the access control guard.
- Personnel and vehicles in connection with regular supplies for subcontractors are considered to be the same as the authorized subcontractor company with which they are related.

Specific supplies for ACWA Power -SEPCO III.

Must show to the responsible of control the following documentation:

- Permit circulation
- Vehicle Insurance
- Driver's License
- The supplier will be identified in the access control
- From access control will be notified by phone or walky-talky to the storehouse responsible

The person responsible for the warehouse authorizes the entry and will escort or indicate where the supplier must go to unload. In this case, a specific entry report will be prepared. The report must be returned and signed by the person responsible for access control upon exiting the facility.

Must show to the responsible of access control the following documentation:

- Permit circulation
- Vehicle Insurance
- Driver's License

The supplier must identify him/herself before the access control guard. The subcontractor company responsible for receiving the supplies will be contacted by phone from the access control post. The subcontractor responsible for receiving the supplies will proceed to the access control post and collect the completed report (Annex 3) and will then approach a person from SEPCO III who has authorization to grant access to the site so he/she may sign the report. Once signed, the

subcontractor will again head over to the access control post where he/she will surrender the report to the responsible person, at which time he/she will be allowed on site.

5.2.6 Maintenance companies

- The staff of the maintenance company will identify in the access control
- Shall submit in access control the following documents:
- VEHICLE who is going to enter for the maintenance:
- Technical specification sheet.
- Technical inspection.
- Driver's license.
- Compulsory insurance.

The maintenance technician must contact a person from SEPCO III or from the subcontractor company. He/she must proceed to the access control point to receive the maintenance technician. The person responsible for access control will issue a report, which will be authorized by a person from SEPCO III with authority to grant access to the site. The report must then be signed and returned to the person responsible for access control upon exiting the facility.

6. CONSTRUCTION SITE ID BADGE

6.1 Requirements for obtaining site ID badges

To obtain the Site ID Badge a number of mandatory requirements established by the Health & Safety Department and described in the site's Safety Plan must be fulfilled. The Health & Safety Department must be contacted in order to obtain Vehicle Identification Cards (once in possession of the Construction Site ID Badge).

6.2 Site Identification Badge Costs

The Construction Manager will establish the cost of each Site Identification Badge. This cost will apply to each issued badge (duplicate in case of loss, deterioration, etc.) and charged to the company to which the worker belongs.

6.3 Obligations and rights

The badge allows people to enter and exit the site and will leave a record with all of the associated data. The badge must be mandatorily surrendered for destruction once the work is over, when the worker no longer works at the site and, in all, when the intended purpose for which the badge was originally issued no longer exists. Companies that have subcontractors working for them will be responsible for collecting and surrendering their badges to the SEPCO III Security department.

ID can be removed by HSE Department team in case of any violation committed by worker.

7. DATA CONTROL OPERATIONS

7.1 Worker access

The entry and exit of workers to the site will always be controlled by means of an access control system or manually (in the case that turn styles are not operational), which will consist in verifying the records in the authorized worker lists kept by security guards. All workers must show their identification (by showing their ID badge) to the security guards and sign off when entering or exiting the site.

A dedicated an exclusive access path will be made available to pedestrians. This path will be delimited and signalized.

7.2 Vehicle access

The entry of vehicles will take place through a gate that will open automatically using the badge that identifies authorized workers or by means of a manual access control system similar to what was described earlier. In the case of manual control systems, drivers must identify themselves before safety guards and sign off both when entering and exiting the site. Only the driver can enter inside the vehicle all the other personnel must go into the site through the turn tile.

Vehicle access cards to the construction zone must be placed on the vehicle's windscreen and remain always visible.

7.3 Work permits outside of working hours

The work schedule as per the client requirements. Outside of this schedule subcontractors must request a special permit from SEPCO III to work.

The following must be indicated in the permit request:

- Name of Subcontractor Company.
- Proposed timeframe outside of normal working hours.
- Name of company safety lead (safety specialist). The role of the safety lead is considered to be fundamental and necessary, which means he/she must be present on site at the time indicated on the PERMIT at the beginning of the works and remain there until their completion.
- ACCESS TO THE SITE WILL NOT BE ALLOWED if a Safety Lead from the requesting company is not present.
- Type of job and location.

8. ENTRY AND EXIT OF MATERIALS, EQUIPMENT AND TOOLS

8.1 General rule.

Entry and exit of materials, equipment and tools will be controlled by the access control security guards. For any material, equipment or tools enter or exit from the site, must be used signed by the subcontractor manager, head of consortium relevant department and HSE department.

8.2 Entry.

Companies performing work on site must provide to the surveillance team (access control) a list of all materials, tools or machinery they will be introducing to the site using.

8.3 Exit.

The exit of materials, equipment or tools must always be accompanied by the corresponding authorization which must be duly signed by the person from the Subcontractor Company, the Supervisor from the affected area and ACWA POWER -SEPCO III's Safety Department. The same criteria shall apply to those materials, tools, etc. that subcontracting companies must take out from the site for the performance of those works that may occasionally take place off site.

9. BOOTHS AND STORAGE AREAS

All companies with on-site booths, offices, cantinas, locker rooms, etc. or storage areas will be responsible for closing them and for the custody of the items contained therein. Security guards will have the keys to facilities as dictated by the Site Manager and will control stored materials, chemical and hazardous products, etc. All equipment and materials must be stored in places set up to that effect. SEPCO III and subcontractors will be responsible for their own equipment and materials. Security guards will have information about which materials that are stored in the warehouse are hazardous. Hazardous product material safety data sheets must be taken into account when considering their storage and preservation.

10. SECURITY INCIDENT REPORTS

A report must be issued as soon as incidents occur and must include a statement from workers, property damages, causes, etc. All thefts and incidents of any kind must be notified immediately to the Site Manager and the Head of Security. The latter will be responsible for conducting investigations and issuing the subsequent reports. The site security team (guards) will record all incidents, thefts or threats.

11. FIREARMS AND OTHER ARMS

Firearms or any other type of arms (switchblades, knives, teaser guns, mace, etc. are strictly forbidden on site.

The Site Manager must be notified as soon as firearms are detected on site. The latter must be surrendered to the police.

Situations that entail danger to the security of people will require fencing off the area in order to neutralize the danger; the police department will then be summoned, if necessary.

12. ALCOHOL, DRUGS AND TOBACCO

The consumption of alcohol and drugs is strictly forbidden. Tobacco will be an exception if dedicated smoking areas are available.


If any worker seems to be under the influence of alcohol or drugs the worker will be submitted to an alcohol and drugs test, for this subject the medical team will be required to check this circumstance and if the check is positive the sanction procedure will be applied.

13. CONFIDENTIAL INFORMATION



All workers will be provided with information about data protection policies

Appendix U

SEPCO III Potential Noise Barrier Design

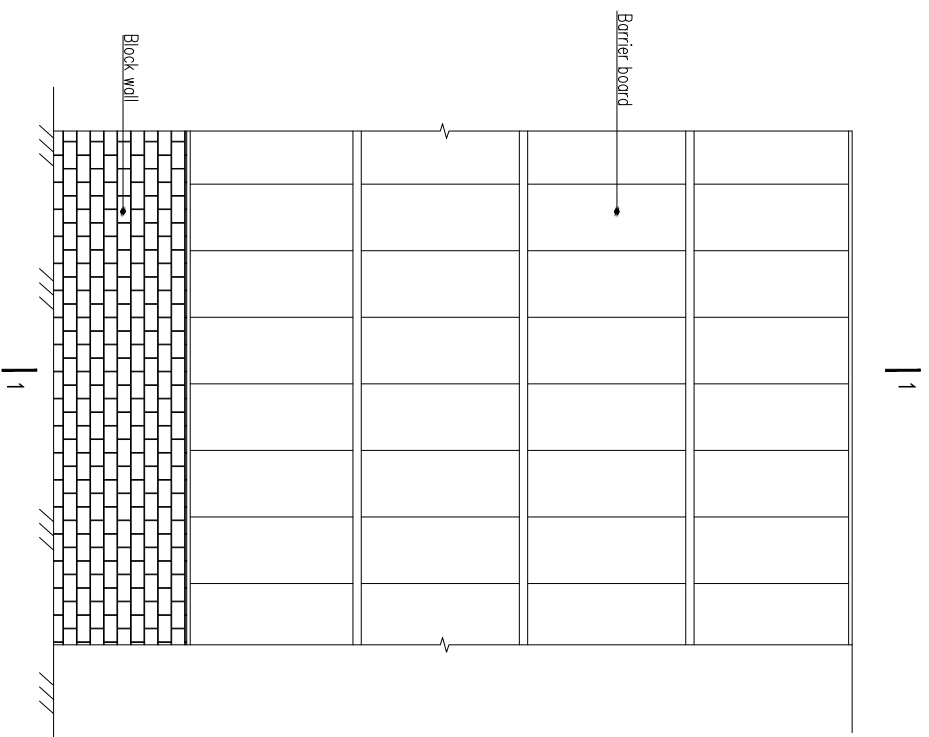

Noise barriers facade elevation

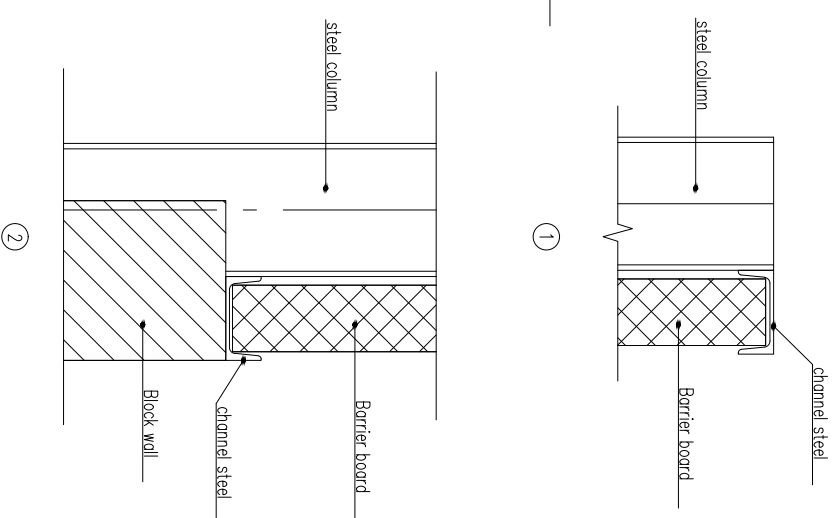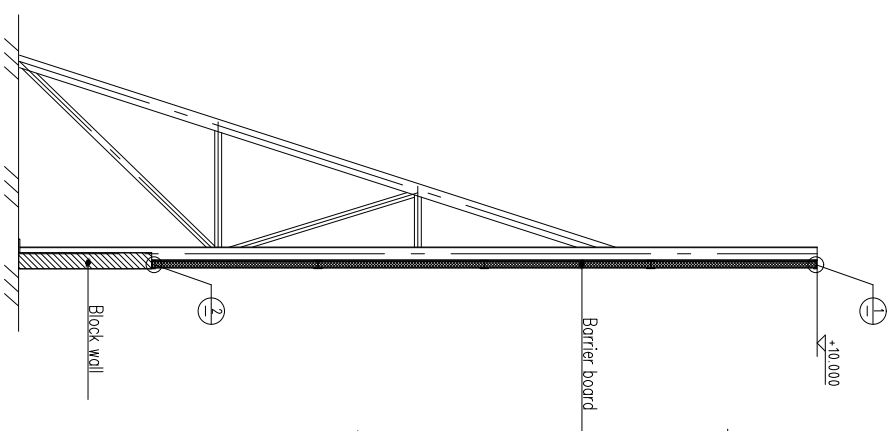

CONTRACTOR: SEPCOIII ELECTRIC POWER CONSTRUCTION CORP.
山东电力建设第三工程公司

QINGDAO HONGRUI ELECTRIC POWER ENGINEERING CONSULTING CO., LTD.
青岛鸿瑞电力工程咨询有限公司



QINGDAO HONGRUI ELECTRIC POWER ENGINEERING CONSULTING CO., LTD.
青岛鸿瑞电力工程咨询有限公司

PROJECT SEPCOIII-ACWA-Hussain IPP Extension Plant-001

APPRD RVWD CHKD DSGD SCALE

DESIGN PHASE BID



NOISE BARRIERS INDICATIVE DRAWING

DATE	DWG. NO.	REV.	0

TYPICAL, FOR INFORMATION ONLY



MATERIAL TABLE FOR MAIN MEMBER

No.	Component	member	Section	Material	Remark
1	STEEL COLUMN	GZ	H	Q235B	
2	STEEL BEAM1	GL1	CHANNEL	Q235B	
3	STEEL BEAM2	GL2	H	Q235B	
4	STEEL BEAM3	GL3	CHANNEL	Q235B	
5	BRACEING PIPE	XCG	WELDED PIPE	Q235B	
6	WEB MEMBER	FG	WELDED PIPE	Q235B	
7	LG, XLG, YC	FG	STEEL ANGLE	Q235B	

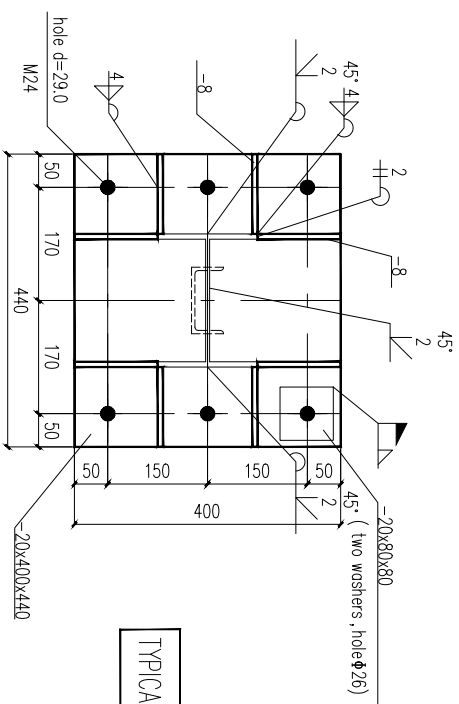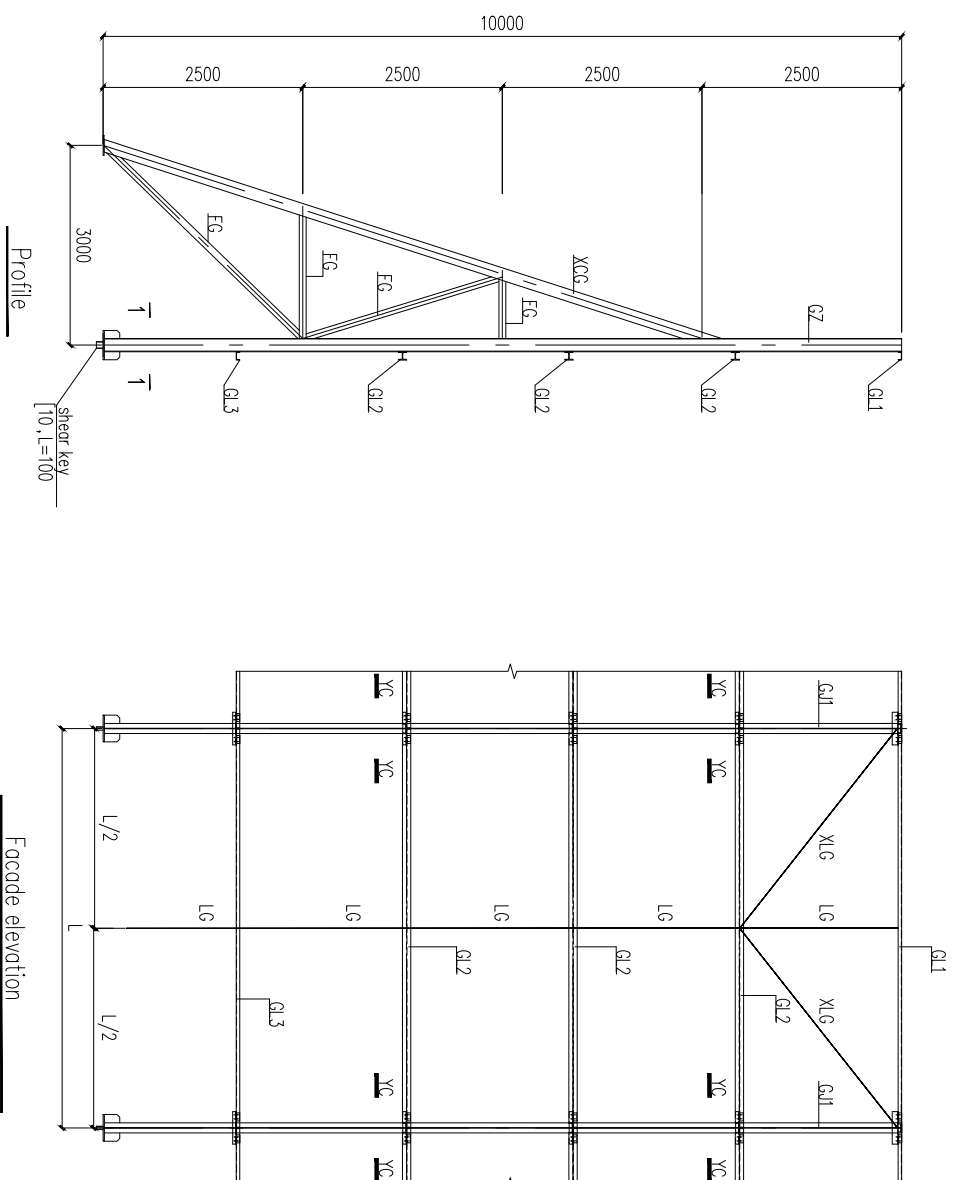

TYPICAL, FOR INFORMATION ONLY

detail drawing of YC

connection drawing
of steel beam and LG

2-2

the top of XLG should be
welded with the flange of column

	CONTRACTOR: SEPCCOIII ELECTRIC POWER CONSTRUCTION CORP.
	山东电力建设第三工程公司
	青岛鸿瑞电力工程咨询有限公司

PROJECT		SEPCCOIII – ACWA – Hussain IPP Extension Plant – 00			
APPRD		DESIGN PHASE		BID	
RVWD		STEEL FRAME INDICATIVE DRAWING			
CHKD					
DSGD					
SCALE					
DATE		DWG. NO.		REV.	0

STEEL FRAME INDICATIVE DRAWING

Example of noise barriers

1.The distributed energy station project in guangxi



2.Tongxiang gas power plant





3.Jiaming power plant in Zhongshan



APPENDIX V

BAT Analysis

BEST AVAILABLE TECHNIQUES

1.1.1 The Industrial Emissions Directive (IED, 2010/75/EU) requires that facility permits include all the measures necessary to achieve a high level of protection of the environment as a whole. To achieve this, the IED requires EU Member States to develop operational permit conditions on the basis of *Best Available Techniques* (BAT). Article 3, *Definitions*, of the IED define BAT as follows:

- (10) *'best available techniques' means the most effective and advanced stage in the development of activities and their methods of operation which indicates the practical suitability of particular techniques for providing the basis for emission limit values and other permit conditions designed to prevent and, where that is not practicable, to reduce emissions and the impact on the environment as a whole:*
 - (a) *'techniques' includes both the technology used and the way in which the installation is designed, built, maintained, operated and decommissioned.*
 - (b) *'available techniques' means those developed on a scale which allows implementation in the relevant industrial sector, under economically and technically viable conditions, taking into consideration the costs and advantages, whether or not the techniques are used or produced inside the Member State in question, as long as they are reasonably accessible to the operator.*
 - (c) *'best' means the most effective in achieving a high general level of protection of the environment as a whole.*

- 1.1.2 In order to define BAT for various industrial sectors, include power generation, *Bat Reference Documents* (BREFs) have been developed, resulting in an exchange of information between EU Member States. Amongst other things (such as present emissions and consumption levels), BREF documents describe techniques considered for the determination of best available techniques as well as BAT conclusions and any emerging techniques. The BREF documents are also developed cognisant of the criteria set out under Annex III of the IED¹.
- 1.1.3 The current adopted BREF document for Large Combustion Plant² was published in July 2006. It is noted that a formal draft was submitted during June 2013 and it is anticipated that a revised BREF will be made available in the near future.
- 1.1.4 The requirement for the Project to meet EU BAT, including related emissions and discharge standards, is stipulated under EBRD PR3³.
- 1.1.5 An analysis of the Project design against the adopted BREF is provided under Table 5.21., overleaf. In addition, the Project has produced a *Best Available Techniques (BAT) Analysis* report, (5 Capitals, June 2016). For completion, key changes in the 2013 draft BREF are also included; however, it remains to be seen whether these will be retained in future adopted BREF (i.e. removed, relaxed or made more stringent).
- 1.1.6 The most notable observation from the BAT review is that the Project's net electrical efficiency at design stage – 50.10% - falls below the 54-58% guideline. The BAT guideline is reflective of turbine technology (F-class gas turbines) which has been prevalent for the last 10-15 years in mature and large power grid systems.
- 1.1.7 The Project will be using E-class gas turbines, which due to power demand/grid constraints in Jordan, are more favourable than F-class turbines. This is primarily due to the improved flexibility, starting time and loading rates of E-class turbines – which in the context of Jordanian installed capacity (4,000MW), peak demand (3,000MW) and renewables (approaching 10% installed capacity) – are more favourable than F-class turbines.
- 1.1.8 Furthermore, it is noted that the Project is adopting Air Cooled Condenser (ACC) technology, which is estimated to have a negative overall impact on efficiency of approx. 1.5%.
- 1.1.9 In summary, whilst the plant's electrical efficiency is less than may be anticipated, it is considered that – in respect of local constraints and the broader BAT attributes – the Project is consider to generally meet the current BREF requirements.

¹ IED Annex III, *Criteria for determining best available techniques*, are as follows: (1) the use of low-waste technology; (2) the use of less hazardous substances; (3) the furthering of recovery and recycling of substances generated and used in the process and of waste, where appropriate; (4) comparable processes, facilities or methods of operation which have been tried with success on an industrial scale; (5) technological advances and changes in scientific knowledge and understanding; (6) the nature, effects and volume of the emissions concerned; (7) the commissioning dates for new or existing installations; (8) the length of time needed to introduce the best available technique; (9) the consumption and nature of raw materials (including water) used in the process and energy efficiency; (10) the need to prevent or reduce to a minimum the overall impact of the emissions on the environment and the risks to it; (11) the need to prevent accidents and to minimise the consequences for the environment; and, (12) information published by public international organisations.

² The Scope of the Large Combustion Plant BREF, in general, covers combustion installations with a rated thermal input exceeding 50MW, including the power generation industry. The BREF covers not only the combustion unit, but also upstream and downstream activities that are directly associated with the combustion process.

³ EBRD PR3 para. 9 states: Clients will structure the projects to meet relevant EU substantive environmental standards, where these can be applied at the project level. Certain projects that, due to their nature and scale, would be subject to the EU Industrial Emissions Directive will be required to meet EU Best Available Techniques (BAT) and related emission and discharge standards, regardless of location.

Table Error! No text of specified style in document..1 Project Analysis Against Adopted Large Combustion Plant BAT Reference Document (BREF)
 Adopted BREF July 2006, Section 7.40, *Techniques to consider in the determination of BAT for the combustion of gaseous fuels*, pp. 469.

Applicable Guidance Document	Techniques to Consider in the Determination of BAT		
	Environmental Benefit	Applied (Y / N)	Comments
TECHNIQUES FOR THE SUPPLY AND HANDLING OF GASEOUS FUELS AND LIQUID ADDITIVES			
Use of an expansion turbine to recover the energy content of the pressurised gases delivered by gas pipelines. If the pressure of the gas supply pipeline exceeds the required input pressure of the Large Combustion Plant, the gas needs to be decompressed. This normally takes place in an <i>expansion turbine</i> to recover some of the energy used for compression.	Most Efficient Use of Energy	N/A	Under Schedule 7, <i>Natural Gas Specifications</i> , of the PPA (Power Purchase Agreement, 2015), a minimum and maximum delivery pressure of 32barg and 65 barg is specified, respectively. Furthermore, the specification states that: "in emergency cases, the minimum gas pressure may decrease to below 30barg but gas pressure shall be provided at least at 28 barg". The Project is performing fuel gas supply pressure reduction via the use of valves in a typical reducing station arrangement. The Lender's Technical Advisors, <i>Lummus Consultants</i> , consider the Project's approach to be appropriate, noting: "From review of the gas supply parameters, recoverable energy would be minimal as well as variable. Therefore, with the additional operational requirements and the need to maintain a fairly constant and reliable fuel gas supply pressure to the gas turbines."
Preheating of fuel gas by recovering the off-gas energy content. Waste heat from the power plant can be used to heat up the decompressed gas, increasing electricity output. Typically, this involves capture and re-use of latent heat arising from steam turbines.	Increased Efficiency	Y	This is being adopted, as indicated from heat balance diagrams.
Regular checks of the gas delivering facilities and piping.	Reduce Risk of Fire Hazards	Y	The gas supply pipeline will be underground, however, NEPCO will be responsible for managing safety and security. The Project will undertake regular inspections of onsite infrastructure associated with fuel delivery. In addition, the Project refers to a gas supply safety system and appropriate gas detection and alarm equipment should be confirmed as part of this system
Sealed surfaces with drainage systems (including oil separators to avoid water and soil contamination caused by lubrication oil).	Prevention of Soil and Groundwater Contamination	Y	Drainage system will include oil separators to avoid contamination.
All screening, crushing, milling, briquetting and other plant for the pre-treatment and storage of raw materials prior to use in the process should be totally enclosed with extraction and arrestment plant, as appropriate, to prevent emissions to atmosphere.	Reduction of Air Emissions	N/A	There will be no screening, crushing, milling, or briquetting operations at the proposed CCGT plant.

Table Error! No text of specified style in document..1 Project Analysis Against Adopted Large Combustion Plant BAT Reference Document (BREF)
 Adopted BREF July 2006, Section 7.40, *Techniques to consider in the determination of BAT for the combustion of gaseous fuels*, pp. 469.

Applicable Guidance Document	Techniques to Consider in the Determination of BAT		
	Environmental Benefit	Applied (Y / N)	Comments
<p>Bulk Storage Tanks. Bulk storage tanks and areas where spillages are most likely, such as sampling points, should be bunded. Bunds should:</p> <ul style="list-style-type: none"> be impenetrable; have no outlet and drain to a sump; contain all parts of the tank; be hydraulically tested on a regular basis; have a capacity capable of containing 110% of the combined capacity of all tanks within the bund; where not frequently inspected, be fitted with a high-level probe and an alarm as appropriate; and, have the fill points within the bund where possible. 	Prevention of Soil and Groundwater Contamination	Y	Storage of hazardous materials and wastes will be suitably contained, including 110% bunding.
<p>For sub surface structures (storage tanks):</p> <ul style="list-style-type: none"> Engineer systems to minimise leakages from pipes and ensure swift detection if they do occur, particularly where hazardous (i.e. Groundwater-hazardous) substances are involved; Provide secondary containment and/or leakage detection for sub-surface pipework, sumps and storage vessels; For non-accessible pipes, double walled type pipes with automatic control of the spacing can be applied (liquid and gaseous fuels); and, Establish an inspection and maintenance programme for all subsurface structures, e.g. Pressure tests, leak tests, material thickness checks or CCTV 	Prevention of Soil and Groundwater Contamination	N/A	No underground storage tanks are proposed.
In the case of SCR, storage of ammonia as ammonia-water solution.	Higher Safety	N/A	SCR Not Proposed
TECHNIQUES TO INCREASE THE EFFICIENCY OF GASEOUS-FUEL-FIRED BOILERS AND TURBINES			
Use of advanced materials to reach high operating temperatures and thus increased gas turbine efficiencies. Typically, the adopted of modern gas turbine models include advanced materials.	Increased Efficiency	N/A	Not applicable for E-class gas turbine technology.
An automated combustion control unit should be in place to manage combustion efficiency, reduce CO formation and to optimise excess air to reduce NO _x formation.	Increased Efficiency	Y	A complete microprocessor based Distributed Control System (DCS) will be installed for automatic and safe control of the plant.

Table Error! No text of specified style in document..1 Project Analysis Against Adopted Large Combustion Plant BAT Reference Document (BREF)

Adopted BREF July 2006, Section 7.40, *Techniques to consider in the determination of BAT for the combustion of gaseous fuels*, pp. 469.

Applicable Guidance Document	Techniques to Consider in the Determination of BAT		
	Environmental Benefit	Applied (Y / N)	Comments
Preheating of combustion air using waste heat.	Increased Efficiency	N/A	Air pre-heating is more typically used in conventional oil or coal plants. The unit is configured to maximise heat recovery to the HRSG, therefore excess waste heat for pre-heating is not available. All exhaust heat from the gas turbine is fed to the HRSG to generate steam for the steam turbine, and in this way, thermal efficiencies of the overall process are optimised.
Waste heat should be utilised through the use of secondary steam generation in a combined cycle unit (HRSG), or through the use of Combined Heat & Power (CHP).	Increased Efficiency	Y	Waste gas exiting the gas turbine is fed to the HRSG to generate steam to drive a steam turbine.
<p>Combined cycle with/or without supplementary firing (HRSG) for net electrical efficiency in the region of 54-58%. The latest turbine developments are reported to achieve an overall efficiency approaching 60%.</p> <p>The net electrical efficiencies reported in the Draft BREF (June 2013) under ISO conditions are reported to be 46-60%.</p> <p>It should be borne in mind that these BAT levels are not achievable in all operation conditions. Quoted targets are based on operation at the design point of the plant, and will not take into account factors such as changes in operational load or fuel quality. Energy efficiency is also dependent on cooling-techniques.</p>	Increased Efficiency	Y*	<p>* Taking into account local constraints, E class turbines offer a solution that can fit the requirement of grid. Indeed, in order to be compliant with the norm, the size of each unit has to be lower than 10% of the system's peak load.</p> <p>Other Siemens and Alstom arrangement would result in a lower capacity, while GE arrangement with 3X3X1 configuration results in higher output and higher efficiency.</p> <p>Moreover, the selected technology is the most reliable, having a significant number of running hours. This gives more confidence on the reliability of steam turbine. It also complies with the environmental requirement at low load condition there are multiple machine configurations available.</p> <p>This gives flexibility to operate at around 25% of load at the same time complying the requirement of emission.</p> <p>(5 Capitals, June 2016)</p>

Table Error! No text of specified style in document..1 Project Analysis Against Adopted Large Combustion Plant BAT Reference Document (BREF)
 Adopted BREF July 2006, Section 7.40, *Techniques to consider in the determination of BAT for the combustion of gaseous fuels*, pp. 469.

Applicable Guidance Document	Techniques to Consider in the Determination of BAT		
	Environmental Benefit	Applied (Y / N)	Comments
Intercooled Recuperated Gas Turbine. A large part of the power that is generated by the turbine is required to drive the compressor. A way to improve the gas turbine efficiency is to reduce the compressor work by cooling the airflow through the compressor. Theoretically, cooling after each compressor stage will give the largest reduction of compressor work, however, in practice only a restrictive number of cooling stages is feasible. If the temperature of the gas turbine exhaust gas is higher than the outlet air temperature of the compressor, it is possible to transfer some of the heat from the exhaust gas to the compressors outlet air. This improves the gas turbine efficiency because less fuel is required to heat the gas to the desired turbine inlet temperature.	Increased Efficiency	N/A	This is not applicable technology for the Project.
Addition Fuel-firing in Turbine Exhaust: Overall thermal efficiencies of up to c.85% are possible, giving low emissions per unit of useful energy produced.	Increased Efficiency	N/A	This has not been adopted, reportedly due to size, configuration and cost, and is not required to allow the facility to have high levels of efficiency.
Heat Increase in the condensing cooling water (temperature increase BAT and energy efficiency BAT) of 7°C to 14°C is considered BAT.	Increased Efficiency	N/A	The plant utilises Air Cooled Condensers.
DRAFT LCP BREF (JUNE 2013) Combined Heat & Power (CHP) Readiness: Flexibility in combustion plant design to allow easy modifications e.g. implementing heat generation.	Increased Efficiency	N/A	The plant is configured for maximisation of electrical output rather than external eat supply.
TECHNIQUES FOR THE PREVENTION AND CONTROL OF AIR EMISSIONS The BAT associated emission levels are based on a daily average, standard conditions and represent a typical load situation. For peak-load, start-up and shut-down periods as well as for operational problems of the flue-gas cleaning systems, short-term peak values, which could be higher, have to be regarded.			
Low excess air: To reduce thermal NO _x ,	Reduction of NO _x and increased efficiency	Yes	Dry low Nox burners will be utilised, and the process control unit (DCS) will allow fully effective combustion control with optimisation of excess air.
Flue-gas recirculation.	Reduction of NO _x	N/A	Not applicable for gas-fired turbines using DLN technology.
Dry Low NO _x (DLN) burners for gas-fired boilers with emissions of NO _x in the range 20 - 50mg/Nm ³ . (IED Limit 50mg/Nm ³)	Reduction of NO _x	Y	For new gas turbines, DLN burners are BAT.

Table Error! No text of specified style in document..1 Project Analysis Against Adopted Large Combustion Plant BAT Reference Document (BREF)
 Adopted BREF July 2006, Section 7.40, *Techniques to consider in the determination of BAT for the combustion of gaseous fuels*, pp. 469.

Applicable Guidance Document	Techniques to Consider in the Determination of BAT		
	Environmental Benefit	Applied (Y / N)	Comments
Selective Catalytic Reduction (SCR). Beside DLN technique and the potential for water and steam injection, SCR is also considered to be part of the BAT conclusion.	Reduction of NO _x	N/A	For new gas turbines, the DLN burners can be seen as the standard technique so that the application of an additional SCR system is, in general, not necessary. Further, the plant can meet BAT associated emission levels without the employment of SCR (or SNCR) so this is not required in order to justify BAT.
CO Emissions 30 - 100 mg/Nm ³ (LCP BREF). IED Limit 100 mg/Nm ³ .	Reduction of CO	Y	
CO oxidation catalyst.	Reduction (conversion) of CO into CO ₂	N/A	*BAT for the minimisation of CO emissions is complete combustion, which goes along with good furnace design, the use of high performance monitoring and process control techniques and maintenance of the combustion system. This is demonstrated through the plant's commitment to keep CO emissions below 100mg/Nm³ CO. The application of an oxidation catalyst for CO can be seen as BAT when it is operated in densely populated urban areas – which is not the case in this Project.
Catalytic combustion.	Reduction of NO _x	N/A	Not applicable for gas-fired turbines using DLN technology.
Stack Height Optimisation.	Reduction of Ambient Air Impacts	Y	Stack height has been sized to optimise emission levels, but also to reduce as far as practicably reasonable, any back-pressure on the gas turbine to increase efficiency.
Continuous Emissions Monitoring System (CEMS)	Monitoring of Operation to Minimise Emissions	Y	Interlocked to the DCS.
Flue-gas Desulphurisation (FGD) is BAT for higher sulphur fuels, and therefore, particulate abatement of FGD + Electrostatic Precipitator (EP) is considered BAT.	Reduction of SO _x	N/A	The Plant will be primarily fired by natural gas. Whilst the plant will be capable of operating on Light Distillate Oil (LDO), and the plant will maintain a strategic supply in case of natural gas fuel supply interruption, it is not the intention to operate on fuel oil. Whilst the agreed LDO specification permits a maximum of 1.2% sulphur, the Client has agreed to restrict sulphur to ≤1.0%, by blending if necessary. It is noted that typically, LDO supplied is <0.5% sulphur.
The largest proportion of metals and compounds released to the air are included in the composition of particulate. Their release to the air is therefore best controlled by minimising particulate release levels and by selecting residual fuel oil with a low ash.	Reduction of Metals and Compounds	N/A	
For oil and oil emulsion fuels, releases of nickel and vanadium may be highly significant, whilst a number of other metals and compounds may also be released. Metal emissions are mainly in the particulate form for oil fuels.	Reduction of Metals and Compounds	N/A	

Table Error! No text of specified style in document..1 Project Analysis Against Adopted Large Combustion Plant BAT Reference Document (BREF)
 Adopted BREF July 2006, Section 7.40, *Techniques to consider in the determination of BAT for the combustion of gaseous fuels*, pp. 469.

Applicable Guidance Document	Techniques to Consider in the Determination of BAT		
	Environmental Benefit	Applied (Y / N)	Comments
Hydrogen chloride and fluoride emissions – FGD plant is effective for emissions reduction.	Reduction of Chloride and Fluoride Emissions	N/A	
Total PAH (unspecified) emissions for large coal and oil fired combustion plant are of the order of 10-100 ng/m ³ in the flue gas. Some PAH is associated with particles and thus particulate removal equipment will reduce emissions to air, although the ash and dust may be contaminated.	Reduction of PAH Emissions	N/A	
TECHNIQUES FOR THE PREVENTION AND CONTROL OF WATER POLLUTION & WASTE			
Regeneration of de-mineralisers and condensate polishers: Neutralisation and sedimentation.	Reduced Waste Water Discharge	Y	Included within Project's water management and treatment system.
Elutriation: Neutralisation	-	N/A	Only applicable in cases of alkaline operation.
Washing of Boilers, Gas Turbines, Air Pre-heater and Precipitator: Neutralisation and closed loop operation, or replacement by dry cleaning methods where technically possible.	Reduced Waste Water Discharge	Y	Oily water treatment system Included within Project's water management and treatment system.
Surface Run-off: Sedimentations or chemical treatment and internal re-use.	Reduced Waste Water Discharge	Y	Drainage from plant areas will be to the effluent treatment system, storm water.
The use of once-through systems is BAT , in particular for processes requiring large cooling capacities (e.g. > 10 MWth).	-	N/A	Not applicable as the plant utilises Air Cooled Condensers.
To prevent oil contaminating the water, oil separation wells are considered BAT .	Avoid Water Pollution	Y	Oil separators are included within the drainage design.
Combustion Residues: BAT is to divert from landfill and re-use combustion residues.	Reduction of Waste	N/A	As the plant is primarily gas fired should be no combustion residue.
ENVIRONMENTAL MANAGEMENT			
Environmental Management System (EMS): A formal system to demonstrate compliance with environmental objectives.	Improved Environmental Management	Y	The Project will develop an Environmental Management System (EMS) to ISO 14001.